



GuardLogix 5580 and Compact GuardLogix 5580 Controllers

Bulletins 1756 and 5069



Allen-Bradley

by ROCKWELL AUTOMATION

Safety Reference Manual

Original Instructions

Important User Information

Read this document and the documents listed in the additional resources section about installation, configuration, and operation of this equipment before you install, configure, operate, or maintain this product. Users are required to familiarize themselves with installation and wiring instructions in addition to requirements of all applicable codes, laws, and standards.

Activities including installation, adjustments, putting into service, use, assembly, disassembly, and maintenance are required to be carried out by suitably trained personnel in accordance with applicable code of practice.

If this equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

In no event will Rockwell Automation, Inc. be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment.

The examples and diagrams in this manual are included solely for illustrative purposes. Because of the many variables and requirements associated with any particular installation, Rockwell Automation, Inc. cannot assume responsibility or liability for actual use based on the examples and diagrams.

No patent liability is assumed by Rockwell Automation, Inc. with respect to use of information, circuits, equipment, or software described in this manual.

Reproduction of the contents of this manual, in whole or in part, without written permission of Rockwell Automation, Inc., is prohibited.

Throughout this manual, when necessary, we use notes to make you aware of safety considerations.



WARNING: Identifies information about practices or circumstances that can cause an explosion in a hazardous environment, which may lead to personal injury or death, property damage, or economic loss.



ATTENTION: Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss. Attentions help you identify a hazard, avoid a hazard, and recognize the consequence.

IMPORTANT: Identifies information that is critical for successful application and understanding of the product.

These labels may also be on or inside the equipment to provide specific precautions.



SHOCK HAZARD: Labels may be on or inside the equipment, for example, a drive or motor, to alert people that dangerous voltage may be present.



BURN HAZARD: Labels may be on or inside the equipment, for example, a drive or motor, to alert people that surfaces may reach dangerous temperatures.



ARC FLASH HAZARD: Labels may be on or inside the equipment, for example, a motor control center, to alert people to potential Arc Flash. Arc Flash will cause severe injury or death. Wear proper Personal Protective Equipment (PPE). Follow ALL Regulatory requirements for safe work practices and for Personal Protective Equipment (PPE).

The following icon may appear in the text of this document.



Identifies information that is useful and can help to make a process easier to do or easier to understand.

Rockwell Automation recognizes that some of the terms that are currently used in our industry and in this publication are not in alignment with the movement toward inclusive language in technology. We are proactively collaborating with industry peers to find alternatives to such terms and making changes to our products and content. Please excuse the use of such terms in our content while we implement these changes.

GuardLogix Safety Concept.....	8
SIL Requirements.....	9
GuardLogix Architecture.....	10
Safety Application Requirements.....	11
GuardLogix Safety Data.....	12
Safety Signature.....	16
Safety Signature Hierarchy.....	16
View Safety Signature Elements.....	17
Safety Signature States.....	19
Archive Safety Signature Reports for Audit.....	20
Signature Authentication.....	21
Settings that Do Not Affect the Safety Signature.....	22
Programmatic Changes to the Safety Application Signature.....	22
GuardLogix and Compact GuardLogix Controller Systems.....	23
GuardLogix 5580 Controller Hardware.....	23
Compact GuardLogix 5380 Controller Hardware.....	24
GuardLogix Communication on an EtherNet/IP Network.....	26
GuardLogix Communication on a DeviceNet Network.....	27
HMI Considerations in Safety Systems.....	28
Safety I/O.....	31
SIL 2 and SIL 3 Considerations.....	32
Ownership.....	33
Input Operation.....	34
Output Operation.....	35
Safety I/O Configuration Signature.....	36
Safety I/O Device Replacement.....	37
Safety I/O Configuration Variations.....	40
CIP Safety Systems and Safety Network Numbers.....	41
Safety Network Numbers (SNNs).....	41
Routable CIP Safety System.....	41
Considerations for Assigning SNNs.....	42
How SNNs Get to Safety Devices.....	44
SNN Formats.....	45
Safety Programming Considerations.....	47
Safety Task.....	47
Safety Programs.....	50

Safety Routines.....	50
Safety Tags.....	51
Safety Signature Elements.....	52
Standard Tags in Safety Routines (Tag Mapping).....	53
Create Tag Mapping Pairs.....	55
Custom Tag Initialization During Prescan.....	56
Safety Add-On Instructions.....	59
Generate the Instruction Signature.....	61
Safety Add-On Instruction Qualification Tests.....	61
Create Signature History Entry.....	62
Export and Import the Safety Add-On Instruction.....	62
Qualification and Verification.....	62
Safety Applications.....	63
Application Development and Testing.....	64
Commissioning Lifecycle.....	65
Specification of the Safety Function.....	66
Create the Project.....	67
Generate the Safety Signature.....	67
Validate the Project.....	69
Confirm the Project.....	70
Lock the Controller.....	71
Restrict Access to Safety-lock and Safety-unlock Functionality.....	72
Download/Upload a Safety Application Program.....	73
Store and Load a Project from a Memory Card.....	74
Force Data.....	74
Inhibit a Device.....	75
Edit a Safety Application.....	75
Monitor Safety Status and Handle Faults.....	79
System Status.....	79
Monitor GuardLogix Safety Status.....	80
Safety Faults.....	83
Fault Routine for Safety Applications.....	85
GSV/SSV Instructions in a Safety Application.....	86
Safety Partner Fault.....	86
Safety Application Instructions.....	88
Safety Instructions.....	88
Metal Form Instructions.....	89

Ladder Diagram Safety Instructions.....90

Drive Safety Instructions.....98

Safety Reaction Times.....101

 Connection Reaction Time Limit.....101

 System Reaction Time.....103

 Logix System Reaction Time.....103

 Factors That Affect Logix Reaction-time Components.....105

 Configure the Safety Input Module Delay Time.....106

 Configure the Input and Output Safety Connection Reaction Time Limits.....107

 Configure the Safety Task Period and Watchdog.....108

 Access Produced/Consumed Tag Data.....109

Checklists for Safety Applications.....111

 Checklist for the Controller System.....111

 Checklist for Safety Inputs.....112

 Checklist for Safety Outputs.....112

 Checklist to Develop a Safety Application Program.....113

History of Changes.....114

Preface

This manual describes safety considerations for GuardLogix® 5580 and Compact GuardLogix® 5380 controllers, which are type-approved and certified for use in safety applications.

Use this manual for the development, operation, and maintenance of a GuardLogix® 5580 or Compact GuardLogix® 5380 controller safety system. Read and understand the safety concepts and the requirements in this manual and familiarize yourself with applicable standards, such as IEC 61508, IEC 62061, IEC 61511, and ISO 13849-1.

Summary of Changes

The following is new or updated information. This list includes substantive updates only and is not intended to reflect all changes. Translated versions are not always available for each revision.

Topic	Page
Added hardware fault tolerance requirements for high-demand applications	SIL Requirements on page 9
Safety signatures can be generated in Remote Run mode	Generate the Safety Signature on page 67

Additional Resources

These documents contain additional information concerning related products from Rockwell Automation. You can view or download publications at rok.auto/literature.

Resource	Description
ControlLogix and GuardLogix Controllers Specifications Technical Data, publication 1756-TD001	Lists product specifications and certifications for ControlLogix® and GuardLogix® controllers.
CompactLogix 5380 and Compact GuardLogix 5380 Controllers Specifications Technical Data, publication 5069-TD002	Lists product specifications and certifications for CompactLogix® 5380 controllers and Compact GuardLogix® 5380 controllers.
ControlLogix 5580 and GuardLogix 5580 Controllers User Manual, publication 1756-UM543	Provides information on how to install, configure, program, and use ControlLogix® 5580 controllers and GuardLogix® 5580 controllers in Studio 5000 Logix Designer® projects.
CompactLogix 5380 and Compact GuardLogix 5380 User Manual, publication 5069-UM001	Provides information on how to install, configure, program, and use CompactLogix® 5380 controllers and Compact GuardLogix® 5380 controllers.
Logix 5000 Controllers Common Procedures Programming Manual, publication 1756-PM001	Provides information on programming Logix 5000® controllers, including how to manage project files, organize tags, program and test routines, and handle faults.
CIP Safety: Safety Networking for Today and Beyond White Paper, publication SAFETY-WP038	Describes the benefits and implementation of CIP Safety™ networks.
EtherNet/IP Device Level Ring Application Technique, publication ENET-AT007	Describes Device Level Ring (DLR) topologies, configuration considerations, and diagnostic methods.
EtherNet/IP Parallel Redundancy Protocol Application Technique, publication ENET-AT006	Describes Parallel Redundancy Protocol (PRP) topologies, configuration considerations, and diagnostic methods.

GuardLogix 5580 and Compact GuardLogix 5580 Controllers

Resource	Description
ControlLogix EtherNet/IP Network Devices User Manual, publication 1756-UM004	Describes how to use EtherNet/IP™ communication modules with a Logix 5000® controller and communicate with various devices on the EtherNet/IP™ network.
Safety Function Application Techniques (SFAT) Index, publication SAFETY-AT999	Lists the available application technique publications for safety functions.
GuardLogix® 5580 controllers technical documentation	Quickly access and download technical specifications, installation instructions, and user manuals.
Compact GuardLogix® 5380 controllers technical documentation	Quickly access and download technical specifications, installation instructions, and user manuals.
System Security Design Guidelines Reference Manual, SECURE-RM001	Provides guidance on how to conduct security assessments, implement Rockwell Automation products in a secure system, harden the control system, manage user access, and dispose of equipment.
Industrial Automation Wiring and Grounding Guidelines, 1770-4.1	Provides general guidelines for installing a Rockwell Automation industrial system.
Product Selection and Configuration tools, rok.auto/systemtools	Helps configure complete, valid catalog numbers and build complete quotes based on detailed product information.
Product Certifications website, rok.auto/certifications	Provides declarations of conformity, certificates, and other certification details.

GuardLogix Safety Concept

The Safety Integrity Level (SIL) is the relative level of risk-reduction that is provided by a safety function.

The following table provides the SIL and Performance Level (PL) standards for the controllers:

- The primary controller performs standard controller functionality and communicates with the safety partner to perform safety-related functions.
- The safety partner works with the primary controller to perform safety-related functions in a SIL 3 system.

Table 1. Safety Ratings for Safety Controllers

Controller System	IEC 61508	IEC 62061	IEC 61511	ISO 13849-1
	Type-approved and certified for use in safety applications up to and including:	Suitable for use in safety applications up to and including:	Suitable for use in safety applications up to and including:	Suitable for use in safety applications up to and including:

GuardLogix® 5580 Controller Systems

Primary controller without a safety partner	SIL 2	SIL CL 2	SIL 2	Performance Level PLd (Cat. 3)
Primary controller with a safety partner	SIL 3	SIL CL 3	SIL 3	Performance Level PLe (Cat. 4)

Compact GuardLogix® 5380 Controller System with a Safety Partner

Cat. no. ends with a 2 (5069-L3xxxxS2)	SIL 2	SIL CL 2	SIL 2	Performance Level PLd (Cat. 3)
Cat. no. ends with a 3 (5069-L3xxxxS3)	SIL 3	SIL CL 3	SIL 3	Performance Level PLe (Cat. 4)

In documentation, safety ratings are expressed as follows:

- SIL 2 represents SIL 2, SIL CL 2, and PLd
- SIL 3 represents SIL 3, SIL CL 3, and PLe

TÜV Rheinland has approved GuardLogix® 5580 and Compact GuardLogix® 5380 controller systems for use in safety-related applications where the de-energized state is considered to be the safe state.

All I/O examples in this manual are based on achieving de-energization as the safe state for typical machine safety and emergency shutdown (ESD) systems.

IMPORTANT:

As the system user, you are responsible for these items:

- The setup, SIL rating, and validation of any sensors or actuators that are connected to the GuardLogix® system
 - Project management and functional test
 - Access control to the safety system, including password handling
 - Programming the application and the device configurations in accordance with the information in this safety reference manual and these publications:
 - ControlLogix 5580 and GuardLogix 5580 Controllers User Manual, publication [1756-UM543](#)
 - CompactLogix 5380 and Compact GuardLogix 5380 User Manual, publication [5069-UM001](#)
-

When applying functional safety, restrict access to qualified, authorized personnel who are trained and experienced.

Use programming software for GuardLogix® 5580 and Compact GuardLogix® 5380 controllers. Only the safety task, not standard tasks, can be used for safety functions.

SIL Requirements

A risk assessment determines whether a safety function requires SIL 2 or SIL 3. For example, one machine has multiple safety functions with the maximum risk, which requires only SIL 2. In that case, a SIL 2-capable controller is acceptable. Another machine has multiple safety functions with at least one risk, which requires SIL 3. In that case, a SIL 3 capable controller is required.



ATTENTION: The safety signature is required for the controller to operate at a SIL 2 or SIL 3 rating. Controller operation without a safety signature is only suitable during development.

IMPORTANT:

High-demand SIL 2 applications that follow the IEC 61511 standard require a Hardware Fault Tolerance of 1 and must use the guidance for SIL 3 requirements throughout this documentation.

High-demand SIL 2 applications that follow the IEC 62061 standard require a Hardware Fault Tolerance of 0 and must use at least the guidance for SIL 2 requirements throughout this documentation.

SIL 2 Requirements

The following applies to SIL 2 safety functions:

- A SIL 2 GuardLogix® 5580 controller requires only the primary controller.
 - A SIL 2 Compact GuardLogix® 5380 controller requires a SIL 2-rated catalog number.
-

IMPORTANT: If operating above 55 °C (131 °F) in a SIL 2 application, modules greater than 6.2 W must not be installed in slots that are next to a safety controller.

SIL 3 Requirements

To following applies to SIL 3 safety functions:

- A SIL 3 GuardLogix® 5580 controller requires both the primary controller and the safety partner.
- A SIL 3 Compact GuardLogix® 5380 controller requires a SIL 3-rated catalog number.

IMPORTANT: The safety task can contain a number of safety functions. For a particular function to be SIL 3, the entire chain of devices and programming from the sensor to the actuator must be SIL 3. Be careful that you do not use a SIL 2 input signal for a safety function that requires SIL 3.

GuardLogix Architecture

The following examples of SIL 3 and SIL 2 systems show these features:

- The overall safety function
- The GuardLogix® portion of the overall safety function
- How other devices that operate outside the safety function, such as HMI, are connected

Figure 1. Example SIL 3 System


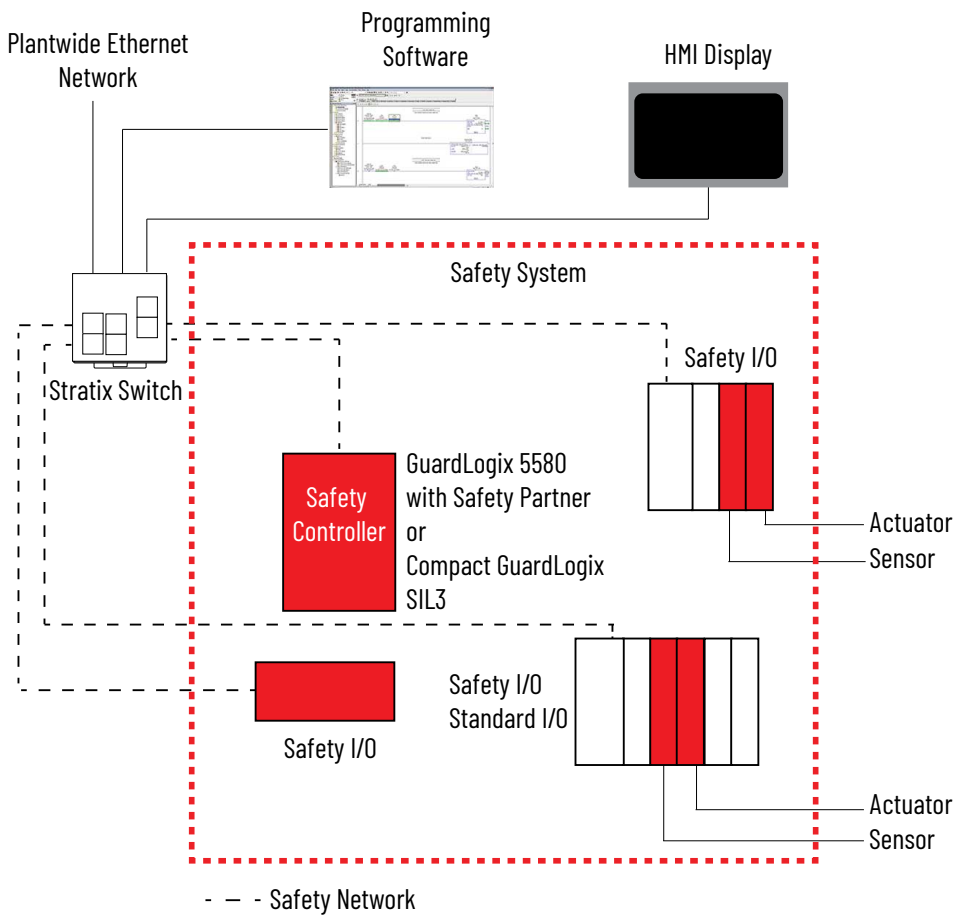


Figure 2. Example SIL 2 System

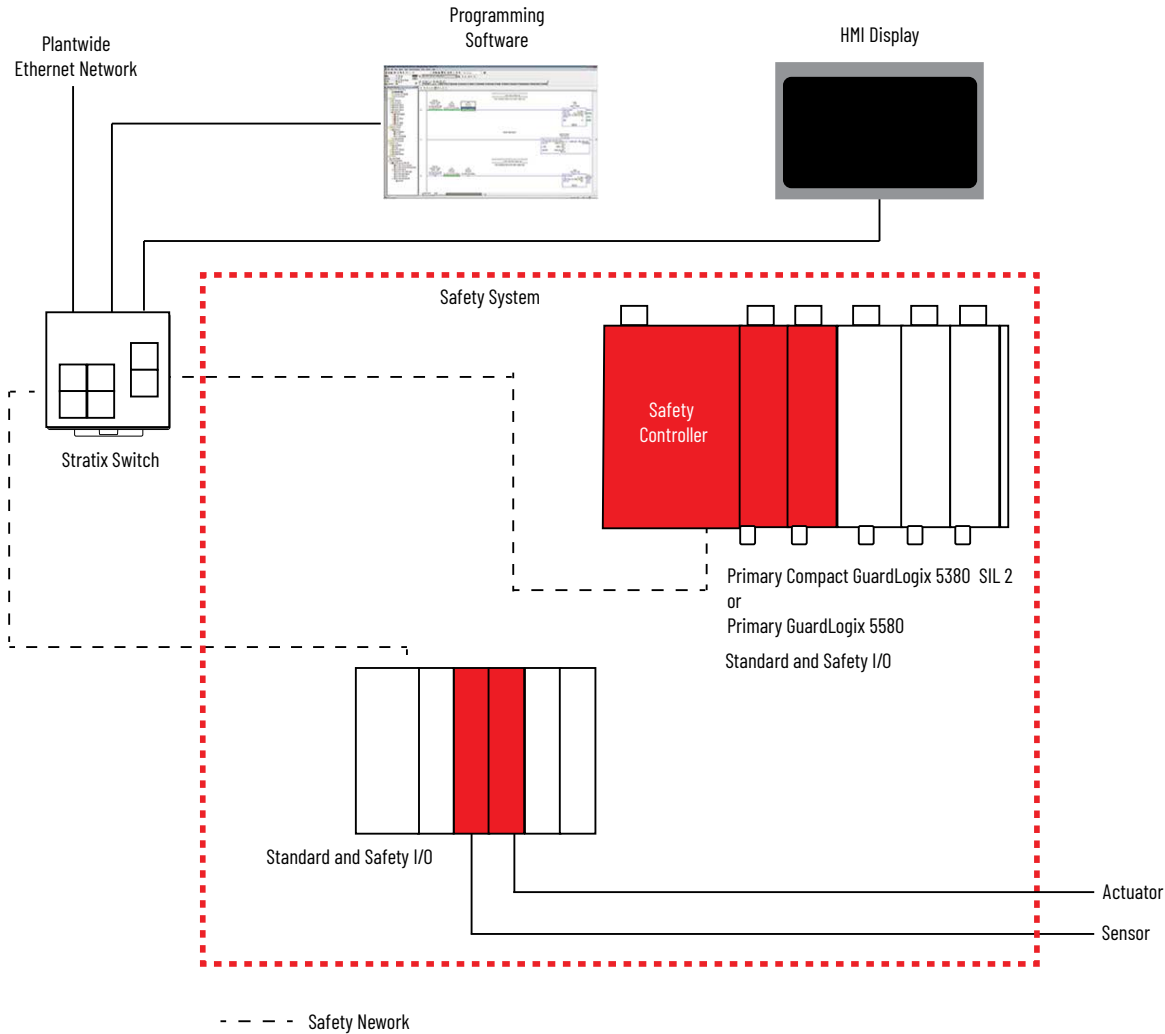

Safety Application Requirements

IEC 61508 requires you to perform various proof tests of the equipment that is used in the system. Proof tests are performed at user-defined times. For example, proof tests can be once a year, once every 15 years, or whatever time frame is appropriate. The controllers have a useful life of 20 years, and no proof test is required. Other components of the system, such as safety I/O devices, sensors, and actuators can have different useful life times.

IMPORTANT: Your specific applications determine the time frame for the useful life.

Controller Specifications and Certifications

For specifications and the agency certifications for the products, see the following:

- ControlLogix and GuardLogix Controllers Technical Data, publication [1756-TD001](#)
- CompactLogix 5380, Compact GuardLogix 5380, and CompactLogix 5480 Specifications Technical Data, publication [5069-TD002](#)


- Agency certifications on the product labels
- Declarations of conformity, certificates, and certification details at rok.auto/certifications

System Reaction Time

The system reaction time is the worst-case time from a safety-related event as input to the system or as a fault within the system, until the time that the system is in the safe state.

This worst-case definition includes the effects of asynchronous communications and multiple potential faults within the system. Actual reaction times are typically faster.

Figure 3. System Reaction Time

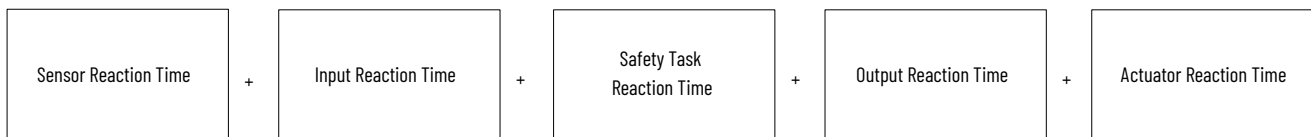

Each of the reaction times is dependent on factors such as the type of I/O device and instructions that are used in the program.

For more information about reaction time calculations, see [Reaction Times on page 101](#).

Contact Information if Device Failure Occurs

If you experience a failure with any device, contact Rockwell Automation Technical Support: rok.auto/knowledgebase

Your local Rockwell Automation sales office or Allen-Bradley distributor can also initiate the following actions:

- Return the device to us so the failure is logged for the affected catalog number and a record is made of the failure.
- Request a failure analysis to try to determine the cause of the failure.

GuardLogix Safety Data

The following examples show probability of a dangerous failure on demand (PFD) and average frequency of a dangerous failure per hour (PFH) values for GuardLogix® 1001 SIL 2 system or 1002 SIL 3 system:

- 1001 is a single-channel system.
- 1002 is a dual-channel system.

Useful Life

The useful life of GuardLogix controllers is 20 years.

Safety Data

For safety I/O devices safety data, including PFD and PFH values, see the manuals for those products, as listed in the [Additional Resources on page 6](#).

The library file is available for download at <https://www.rockwellautomation.com/en-us/capabilities/industrial-safety-solutions/safety-system-development-tools.html>.

Product Failure Rates

The data in the following tables applies to mission times up to and including 20 years. Mission time (MT) is the length of time over which the device maintains the stated PFD, PFH, and λ ratings before replacement is required.

A detected failure is a failure that is identified by diagnostic tests, proof tests, operator intervention, or normal operation.

Table 2. Safety Parameters

Attribute	GuardLogix 5580 Controllers and Safety Partner	GuardLogix 5580 Controller	Compact GuardLogix 5380 SIL 2 Controller	Compact GuardLogix 5380 SIL 3 Controller
Hardware Fault Tolerance (HFT) The hardware fault tolerance equals n , where $n+1$ faults could cause the loss of the safety function. An HFT of 1 means that 2 faults are required before safety is lost.	1	0	0	1
No Part/ No Effect Detected Failure Rate (λ_{NPED}) [hr]	2.80E-06	2.58E-06	4.04E-06	3.17E-06
Safe Failure Rate (λ) [failures/hr]	7.24E-07	6.61E-07	7.33E-07	6.26E-07
Dangerous Failure Rate (λ_D) [failures/hr]	7.10E-07	6.61E-07	7.33E-07	6.13E-07
Dangerous Detected Failure Rate (λ_{DD}) [failures/hr]	7.10E-07	6.54E-07	7.26E-07	6.13E-07
Dangerous Undetected Failure Rate (λ_{DU}) [failures/hr]	7.38E-11	6.40E-09	7.23E-09	6.45E-11
Automatic Diagnostic Test Interval (λ_D) [hr]	—	<SRT	<SRT	—
Useful Life [yr]	20	20	20	20
Systematic Capability (SC)	3	3	3	3

Table 2. Safety Parameters (continued)

Attribute	GuardLogix 5580 Controllers and Safety Partner	GuardLogix 5580 Controller	Compact GuardLogix 5380 SIL 2 Controller	Compact GuardLogix 5380 SIL 3 Controller
Systematic capability is defined in IEC 61508-4 as the confidence that the systematic safety integrity meets the requirements of the specified SIL rating.				

NOTE:

- GuardLogix 5580 controller values are product failure rates to be used when the product is represented as a block in a reliability block diagram (RBD).
- GuardLogix 5580 controller failure rates are valid for ambient temperatures up to 70 °C (158 °F) and altitudes of up to 2000 m (6561.7 ft). See publications [1756-TD001](#) and [1756-IN048](#).
- The HFT value in the preceding table is the product internal HFT.

Table 3. Safety Calculations

Attribute	GuardLogix® 5580 Controllers and Safety Partner	GuardLogix® 5580 Controller	Compact GuardLogix® 5380 SIL 2 Controller	Compact GuardLogix® 5380 SIL 3 Controller
PFD _{ave} (Mission Time 20 yr)	6.46E-06	5.61E-04	6.33E-04	6.26E-06
PFH	7.38E-11	6.40E-09	7.23E-09	6.45E-11
STR	4.23E-06	3.90E-06	5.50E-06	4.41E-06
MTTF _d [yr]	160.82	172.74	155.66	186.08

Assumptions for safety calculations:

- Component failure rates are constant over the life of the product.
- All detected failures (safe and dangerous) result in the safe state (MRT=0).
- Within the specified useful life (20 years), no proof test is needed.

$$PFD_{ave} = (\lambda_{DU} + \lambda_{DD})t_{CE}$$

$$t_{CE} = \frac{\lambda_{DU}}{\lambda_D} \left(\frac{T_I}{2} + MRT \right) + \frac{\lambda_{DD}}{\lambda_D} MTTR$$

$$PFH = \lambda_{DU}$$

$$STR = \lambda_S + \lambda_{DD} + \lambda_{NPED}$$

$$MTTF_d = \frac{1}{\lambda_d}$$

Safety Signature

A safety signature verifies the integrity of a safety application:

- The safety signature applies to the entire safety portion of the controller project. The ability to create, record, and verify the safety signature is a mandatory part of the safety-application development process. The safety signature must be present to operate as a SIL 2/PLd or SIL 3/PLe safety controller. Nothing in the standard application is included in the safety signature.
- The safety signature is a hierarchy of multiple safety signature elements. For example, the safety task, programs, and routines are examples of safety signature elements. Safety signature elements can help you during impact analysis by identifying the individual changes within a controller project. If your validation plan does not require revalidation of unchanged elements, your certification effort can be reduced. All safety signature elements are created at the time that you generate the safety signature for the project. To view all safety signature elements for a project, you can run the Safety Signature report.

The safety signature and each of its elements have the following:

- Safety signature—IDA unique 64-character alphanumeric identification number.
- Time stamp—The date and time that the safety signature was generated. For a safety signature element, the time stamp changes whenever its signature ID changes. The time stamp is based on the local clock of the computer that generated the signature.

Figure 4. Safety Signature

Safety ID	DCA0ACF6 - 4A899D32 - A9ABCAF3 - C2FFA9C0 - 21847338 - 855266DE - 8D05DB32 - 44DAAE06
Safety Updated	08/23/2023 12:29:41.076 PM

Safety Signature Hierarchy

The following image shows an example of the safety signature hierarchy:

- A signature with ID and time stamp exists for each element in the hierarchy.
- Expand the safety signature at the top to view its underlying elements.
- Expand a parent element to view its underlying child elements.

Figure 5. Safety Signature Hierarchy

	Signature for	Updated	ID
A	Controller CsrBaseline	08/23/2023 12:29:41.076 PM	303D5781 - 70A35C87 - 58538CCC - A5435D56 - 0A84FDE3 - D8610007 - C3857649 - 98EF6481
	▼ Safety Application	08/23/2023 12:29:41.076 PM	17F62989 - 6AE041D3 - D558C16C - 575D0B30 - 4358E3AD - A0DF6511 - E8832578 - 42F48735
	Safety Controller Attributes	08/23/2023 12:29:41.076 PM	1216A880 - 1064C1F9 - F95A694D - 8BA963E6 - 8A6F3449 - F0DEF09C - 59A65413 - 518C8E92
	Safety Tag Mapping	08/23/2023 12:29:41.076 PM	51F4A790 - 38C628C5 - 1C4F8C1D - 3D1E941E - 64948655 - 5D858478 - EF722809 - 3FA6A68E
	Controller Tags	08/23/2023 12:29:41.076 PM	EAEB684E - 5DAF9376 - 170E9A35 - E96CE77E - 14384E84 - 3953EC81 - B58C0D97 - 7EC6E1A6
	▼ SafetyTask	08/23/2023 12:29:41.076 PM	DCA0ACF6 - 4A899D32 - A9ABCAF3 - C2FFA9C0 - 21847338 - 855266DE - 8D05DB32 - 44DAAE06
	▼ SafetyProgram	08/23/2023 12:29:41.076 PM	7A75D175 - 47FE2CF8 - CDABA451 - 551F00F9 - 188CD8FD - 2C666D09 - 488941C8 - FD7D25D7
	Parameters and Local Tags	08/23/2023 12:29:41.076 PM	95A78CF1 - BE256AAA - 2A137EAF - 20A881F5 - 4A03CD76 - 70925805 - 535AF839 - 6EAEDE9F
	MainRoutine	08/23/2023 12:29:41.076 PM	DEF68C78 - EB49CF82 - 09C587FE - 131424C2 - 3FASCS5C - 79199D3C - 98361F72 - D854532A
B	▼ Add-On Instructions	08/23/2023 12:29:41.076 PM	9893982D - 2CE3AERC - CF08C539 - 88EE0C18 - A54083ED - D08E32E5 - A1558F01 - A163F2EF
	▼ SafetyAOI	08/23/2023 12:29:41.076 PM	6015A73B - 62945DEF - C85E8A8C - 0A472070 - 600B89A9 - 2318E3D - D648F33 - 70E85328
	Parameters and Local Tags	08/23/2023 12:29:41.076 PM	6085D642 - 81C776DE - FF41376F - 2C9E7C02 - 64E04807 - 8465C16C - A89582F6 - C71557D8
	Logic	08/23/2023 12:29:41.076 PM	57F8070 - C5E027AF - B86801E6 - 8757758F - ECC3229F - 25DC9E25 - 60E6C8FF - E097C0E9
	▼ I/O Configuration	08/23/2023 12:29:41.076 PM	EC1ED9A4 - 79EDC01A - 6578F0E6 - 7E140556 - D81FCFB - 4AACFFC5 - 3D158C24 - FE8F6E97
	Local	08/23/2023 12:29:41.076 PM	D2F28AF - 4EACDE70 - 208D4A3F - F558404C - 5F2AA792 - BF306388 - 88B1AE91 - E1FD0384
	▼ safety_in_out_io	08/23/2023 12:29:41.076 PM	F538E119 - 0283E5CA - B38A2B05 - C6360F57 - C693CFCC - 0196C05C - E8E2C1FA - 19D7C6D0
	▼ Connection	08/23/2023 12:29:41.076 PM	E1D57A2B - 5166F5A1 - F7CF3357 - 5F21EE21 - A07F46A6 - 88169C09 - 980830E8 - 722D431E
	Input	08/23/2023 12:29:41.076 PM	9D2A6881 - 488D286F - 5F18E74A - 78998A37 - 71CAF4A2 - 086DEA74 - C6785853 - SCCDDC15
	Output	08/23/2023 12:29:41.076 PM	1597E871 - EBF3C3D8 - 5EFA53C7 - FAA2855A - 52BF2FF1 - AFB494A6 - 497E7890 - 05C51223

Item	Description
A	Safety signature

Item	Description
B	Safety signature elements

Aggregate Signatures

Safety elements that include a collection of tags and parameters have aggregate signatures. An aggregate signature represents the validity of all tags and parameters within the element.

The following elements have aggregate signatures:

- Controller-scoped safety tags
- Safety program parameters and tags
- Safety Add-On Instructions
- Safety mapped tags
- Safety I/O connections

If one of the preceding elements has a collection with no members, such as no controller-scoped safety tags, the aggregate signature value appears as 64 zeros.

View Safety Signature Elements

There are multiple places where you can view safety signature elements:

- Quick View pane
- Safety Signature report
- Compare Tool

Quick View Pane

When you select a safety element in the Controller Organizer, such as a safety program, its signature appears in the Quick View pane. Before the safety signature is generated, the Safety ID and Safety Updated fields in the Quick View pane display <none>.



To display all 64 characters of the safety signature ID, hover over the ID in the Quick View pane. From the tooltip, you can copy the signature ID.

Before Safety Signature Generation	After Safety Signature Generation																																																
<table border="1"> <thead> <tr> <th>Class</th> <th>Safety</th> </tr> </thead> <tbody> <tr> <td>Safety ID</td> <td><none></td> </tr> <tr> <td>Safety Updated</td> <td><none></td> </tr> <tr> <td>Description</td> <td></td> </tr> <tr> <td>Status</td> <td>Scheduled</td> </tr> <tr> <td>Number of Routines</td> <td>8</td> </tr> <tr> <td>Main Routine</td> <td>SR00_Main</td> </tr> <tr> <td>Fault Routine</td> <td></td> </tr> <tr> <td>Max Scan</td> <td></td> </tr> <tr> <td>Last Scan</td> <td></td> </tr> <tr> <td>Parent</td> <td></td> </tr> <tr> <td>Scheduled In</td> <td>T01_Safety</td> </tr> </tbody> </table>	Class	Safety	Safety ID	<none>	Safety Updated	<none>	Description		Status	Scheduled	Number of Routines	8	Main Routine	SR00_Main	Fault Routine		Max Scan		Last Scan		Parent		Scheduled In	T01_Safety	<table border="1"> <thead> <tr> <th>Class</th> <th>Safety</th> </tr> </thead> <tbody> <tr> <td>Safety ID</td> <td>A9E417A8 - 469D75A7 - 953EC9BF - D...</td> </tr> <tr> <td>Safety Updated</td> <td>08/31/2023 10:47:39.893 AM</td> </tr> <tr> <td>Description</td> <td></td> </tr> <tr> <td>Status</td> <td>Scheduled</td> </tr> <tr> <td>Number of Routines</td> <td>8</td> </tr> <tr> <td>Main Routine</td> <td>SR00_Main</td> </tr> <tr> <td>Fault Routine</td> <td></td> </tr> <tr> <td>Max Scan</td> <td>62 us</td> </tr> <tr> <td>Last Scan</td> <td>51 us</td> </tr> <tr> <td>Parent</td> <td></td> </tr> <tr> <td>Scheduled In</td> <td>T01_Safety</td> </tr> </tbody> </table>	Class	Safety	Safety ID	A9E417A8 - 469D75A7 - 953EC9BF - D...	Safety Updated	08/31/2023 10:47:39.893 AM	Description		Status	Scheduled	Number of Routines	8	Main Routine	SR00_Main	Fault Routine		Max Scan	62 us	Last Scan	51 us	Parent		Scheduled In	T01_Safety
Class	Safety																																																
Safety ID	<none>																																																
Safety Updated	<none>																																																
Description																																																	
Status	Scheduled																																																
Number of Routines	8																																																
Main Routine	SR00_Main																																																
Fault Routine																																																	
Max Scan																																																	
Last Scan																																																	
Parent																																																	
Scheduled In	T01_Safety																																																
Class	Safety																																																
Safety ID	A9E417A8 - 469D75A7 - 953EC9BF - D...																																																
Safety Updated	08/31/2023 10:47:39.893 AM																																																
Description																																																	
Status	Scheduled																																																
Number of Routines	8																																																
Main Routine	SR00_Main																																																
Fault Routine																																																	
Max Scan	62 us																																																
Last Scan	51 us																																																
Parent																																																	
Scheduled In	T01_Safety																																																

Safety Signature Report

The Safety Signature Report includes all safety signature elements for the controller project. To view the report in the Logix Designer application, select Tools > Safety > Generate Signature Report. The report opens in a web browser and shows the following:

- The safety signature appears in the report header
- The safety signature elements appear in the report table.
- The state of the signature for an element is indicated by its color, tooltip, and icon.

Figure 6. Safety Signature Report

Safety Signature Report

Viewing Signatures from Project: C SSRBaseline

Logix Designer File: MySafetyProject.acd

Report Generated: Wed Aug 23 12:35:54 2023

Safety Signature

ID: 3D3D5781 - 70A35C87 - 58530CCC - A5435D56 - 0A84FDE3 - D86100D7 - C3857649 - 98EF6481
 Generated Date: 08/23/2023
 Generated Time: 12:29:41.076 PM

Note: All Safety signature dates are formatted with month first (mm/dd/yyyy).

The table below shows the elements that comprise the safety signature. Nothing in the standard application is included in the safety signature.

🕒 = Updated signature
 📄 = Unknown signature

Signature for	Updated	ID
▼ Controller C SSRBaseline	08/23/2023 12:29:41.076 PH 🕒	3D3D5781 - 70A35C87 - 58530CCC - A5435D56 - 0A84FDE3 - D86100D7 - C3857649 - 98EF6481
▼ Safety Application	08/23/2023 12:29:41.076 PH 🕒	17F02989 - 6AE041D3 - D558C16C - 575D283D - 4350E3AD - ADDF6511 - EB832578 - 42F4B735
Safety Controller Attributes	08/23/2023 12:29:41.076 PH 🕒	1216A880 - 1064C1F9 - F95A694D - BBA963E6 - 8A6F3449 - FBDEF09C - 59A65413 - 518C8E92

Logix Designer Compare Tool

The Logix Designer Compare Tool can compare safety signature elements in two controller projects. The following image compares two safety routine elements.

Figure 7. Logix Designer Compare Tool

Safety Signature States

A signature can have three states as indicated by its color: blue, black, or gray.

Blue Signature

A signature appears blue in these scenarios:

- After the first generation of the safety signature
- After any subsequent generation of the safety signature to indicate a change to a safety element or one of its child elements

In the following example, the Safety Signature report shows blue signatures as a result of the following workflow:

1. Generate a safety signature for the first time.
2. Create a safety tag in the S_DE1 program.
3. Generate the safety signature a subsequent time.
4. Generate the Safety Signature report.

The creation of the safety tag in step 2 results in blue signatures for these elements:

- Parameters and Local Tags child element
- S_DE1, T01_Safety, and Safety Application parent elements

Figure 8. Blue Parent and Child Signatures

Signature for	Updated	ID
▼ Controller_P15_000190_PLC	08/31/2023 10:56:56.448 AM	92EE81B3 - 605EEF2A - 973E5DF7 - D248CAE6 - 0B440298 - 25E8B0DF - 805528F4 - E62AC3D8
▼ Safety Application	08/31/2023 10:56:56.448 AM	2339FE8E - DFF40683 - D85E82D1 - 08DB24E5 - 8FD99865 - 798E3559 - 9E79172C - 1FC51B33
Safety Controller Attributes	08/31/2023 10:47:39.893 AM	CE50C9B5 - 404BA086 - C208F434 - 8445A05F - D6954D00 - E414236A - 56E9F065 - 4A148457
Safety Tag Mapping	08/31/2023 10:47:39.893 AM	7624105E - 14DC1627 - 70480CD0 - D149CB70 - CAF8ACF8 - F60FF95F - C3758865 - 607E245F
Controller Tags	08/31/2023 10:47:39.893 AM	94523844 - 802F6054 - 3E48F8BC - 2CD96795 - 84C96800 - 2E54924E - 558F470D - 8956086D
▼ T01_Safety	08/31/2023 10:56:56.448 AM	F95E9CFA - 7EE9096F - A61FC452 - C10379E0 - 934F5585 - 0514F05E - 33F87770 - BF788833
▼ S_DE1	08/31/2023 10:56:56.448 AM	84185D04 - 64F14011 - C29C8CF0 - 29C8A865 - 0F6C2163 - D31F8E93 - 72F81A0A - FD05E283
Parameters and Local Tags	08/31/2023 10:56:56.448 AM	01BCF740 - EEBE9E4A - 6AC84F8E - 7324005F - 57676C70 - EAAE008C - 0F417086 - 82C44D72
SR00_InstIn	08/31/2023 10:47:39.893 AM	07887482 - 58D02C57 - CCE231D5 - 9A8A344D - 17E49D47 - AC0A1D03 - 6FD68F96 - 052E95F8
SR02_PLC_I_O_0070	08/31/2023 10:47:39.893 AM	D48F3380 - 1350D53E - 7700A2F0 - 71346E41 - 80D46478 - 9A828ECB - 8C31F0E6 - 71044374
SR11_P51_DrivesSpoolChamber	08/31/2023 10:47:39.893 AM	7588CB8A - D89A0E17 - 80F8E133 - 63AF887C - 18FC8160 - 800AA734 - 99E9A629 - 812DE867
SR11_P52_DrivesCrossChamber	08/31/2023 10:47:39.893 AM	F71AF1F8 - 8515EF3A - CCF8E898 - 9AA938FC - 47750943 - 890560F4 - 4720012D - 87885D14
SR11_P53_DrivesPivotingPlatform	08/31/2023 10:47:39.893 AM	90DE48FE - 2E89FC2C - 46D03105 - 949951F5 - F2807F45 - 6325CC6C - 8148D062 - A32783C2
SR11_P54_DrivesReactor1	08/31/2023 10:47:39.893 AM	27027869 - 79F283CA - 07AEF4CF - 049A137E - 8A473F77 - E29A011C - 07980676 - 80E09793
SR11_P55_DrivesReactor2	08/31/2023 10:47:39.893 AM	0891D7B3 - 7988D678 - F765E09D - EA88C187 - A98D4750 - E0C769F2 - 8E1437F4 - 877EFDAC
SR11_P56_DrivesReactor3	08/31/2023 10:47:39.893 AM	8A8C1C8E - 51D7FCE2 - 2E801ABA - 11908CC4 - F35CE654 - 827F8D12 - 48D2194E - 312D02A6
SR20_CompressedAir	08/31/2023 10:47:39.893 AM	08919E67 - 69492280 - 102D9561 - 60189987 - 08F1E048 - 94448331 - E80A848A - 6880847D
SR21_DoorInterlock	08/31/2023 10:47:39.893 AM	C590CC40 - E6C5AA6A - 8DF88746 - C242D493 - 110FAF12 - 283E1A08 - 84172E68 - 08885DEF
SR22_SmokeDetection	08/31/2023 10:47:39.893 AM	17E183FF - 78480838 - 88A84206 - D6189781 - 330877CC - D1C2360C - 7EC0A1D4 - AAC576E0
▼ S_D01	08/31/2023 10:47:39.893 AM	CD18A425 - B2281202 - A9A181CC - 0EA18119 - F0F7D1F8 - 70797419 - 47507019 - AADEF6D3

Black Signature

A signature appears black after any subsequent generation of the signature when no change occurred to the safety element or any of its child elements.

Gray Signature

A gray signature is an unknown signature. An unknown signature occurs when the Logix Designer application cannot verify that the signature ID matches the associated value. Unknown signatures cannot be used for certification and must be updated.

A signature appears gray when you perform any of the following workflows:

- Delete the safety signature
- Create a controller project from an imported project with an existing safety signature
- Copy a safety signature element with an existing signature

Archive Safety Signature Reports for Audit

You can compare an original Safety Signature report to an updated Safety Signature report to show which elements changed and which elements did not change for auditing purposes. If your

validation plan does not require revalidation of unchanged elements, your certification effort can be reduced, such as in these scenarios:

- You want to migrate a validated safety application to a future release without revalidating the entire application.
- You want to add or update some elements of a validated safety application without revalidating the unchanged elements.
- You want to copy some validated elements to another project without revalidating the copied elements.

Safety Signature reports are archived as .htm files in the following default directory:

C:\Users\Public\Documents\Rockwell Automation\Studio 5000\Logix Designer\Safety Signature Reports

Signature Authentication

If a signature for an element cannot be authenticated, the following occurs:

- A warning appears in the Errors pane below the Controller Organizer.
- No signature is shown for the element in the Quick View pane.

For example, if you copy a main routine, but the routine was changed before the copy, warnings appear to indicate that the signature could not be authenticated. No signature appears for the copied routine in the Quick View pane.

Figure 9. Signature Authentication Failed—Warning


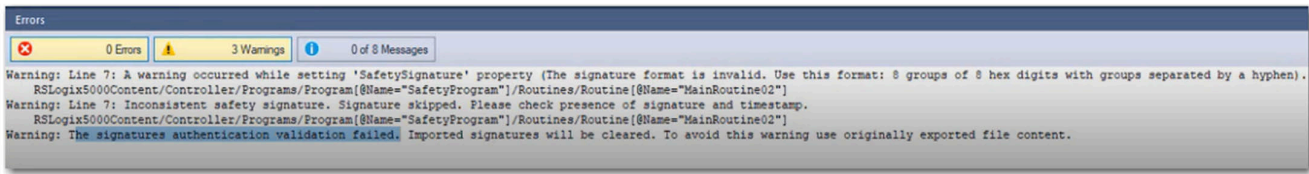


Figure 10. Signature Authentication Failed—No Signature

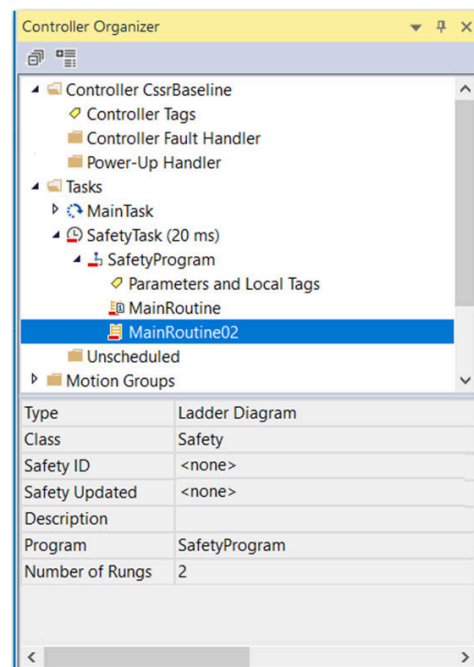

Settings that Do Not Affect the Safety Signature

In the Logix Designer application, version 36 or later, you can make the following changes to a safety project with no effect on the safety signature:

- Change the controller slot number, if applicable.
- Modify controller IP settings.
- Change the EtherNet/IP™ mode on a controller that support multiple modes.
To change the EtherNet/IP™ mode, you must first delete the safety signature. After changing the mode, you can regenerate the safety signature with the same value.

Programmatic Changes to the Safety Application Signature

If there are no changes to your safety application, then the safety application signature and all of its underlying elements remain constant across software and firmware releases with the following possible exceptions:

- You update the controller with a firmware revision that contains a change to the offline compiler or internal signature algorithm. These changes can trigger a change to the safety signature. These types of changes are infrequent.
- You use the copy/paste or import function in a way that causes an internal difference in a component. For example, if you copy a safety routine from Project1 to Project2 and TagA is program-scoped in Project1, but controller-scoped in Project2, then the safety signature for the routine changes.

Unlike the safety application signature, the controller safety signature always changes with any firmware release change, so that you complete some validation testing at the functional controller level, even if no changes were made to the safety project.

Figure 11. Controller and Safety Application Signatures

Signature for	Updated	ID
Controller P15_000190_PLC	08/31/2023 10:56:56.448 AM	92EE81B3 - 605EEF2A - 973E5DF7 - D248C4E6 - 08440298 - 25EB080F - 805528F4 - E62AC3D0
Safety Application	08/31/2023 10:56:56.448 AM	2339EBE5 - DFFA0683 - 0B5E82D1 - 080B24E5 - 8FD99865 - 790E3559 - 9E79172C - 1FC51833
Safety Controller Attributes	08/31/2023 10:47:39.893 AM	CB50C9B5 - 40A8A086 - C2DBF434 - 8445AD5F - D6954D00 - E414236A - 56EF9365 - 4A148457
Safety Tag Mapping	08/31/2023 10:47:39.893 AM	7624105E - 14DC1627 - 70480C08 - D149CB70 - CAF8ACF8 - F60FF95F - C3758865 - 607E245F
Controller Tags	08/31/2023 10:47:39.893 AM	94523844 - 802F6054 - 3E48F8BC - 2CD96795 - 84C96808 - 2E54924E - 558F47DD - 8956086D
T01_Safety	08/31/2023 10:56:56.448 AM	F95E9CFA - 7FE9096F - A61FC452 - C10379E0 - 934F5585 - 0514FD5E - 33F87770 - 8F788833
S_DE1	08/31/2023 10:56:56.448 AM	84185D04 - 64F14011 - C29C8CF0 - 29C48465 - 0F6C2163 - D31F8E93 - 72F81A0A - FD05E2B3
Parameters and Local Tags	08/31/2023 10:56:56.448 AM	01BCF740 - EEBE9E4A - 6AC848F8 - 7324005F - 57676C7D - EAAE080C - 0F417D86 - B2C44D72
SR00_Main	08/31/2023 10:47:39.893 AM	07887462 - 58D02C57 - CCE231D5 - 94BA344D - 17E49D47 - AC0A1DE3 - 6FD68F96 - 052E95F8
SR02_PLC_I_O_R070	08/31/2023 10:47:39.893 AM	D48F3380 - 1350053E - 7700A2F0 - 71346E41 - 8D046478 - 9A828ECB - 8C31F066 - 71044374
SR11_PS1_DrivesSpoolChamber	08/31/2023 10:47:39.893 AM	7588CB8A - D89A8E17 - B0FB8133 - 63AF887C - 18FC8168 - 800AA734 - 99E9A629 - 812DE867
SR11_PS2_DrivesCrossChamber	08/31/2023 10:47:39.893 AM	F71AF1FB - B515EF3A - CCF8E898 - 9AA938FC - 47750943 - 890560F4 - 4720012D - 87B85D14
SR11_PS3_DrivesPivotingPlatform	08/31/2023 10:47:39.893 AM	90DE48FE - 2E89FC2C - 46D03105 - 949951F5 - F2807F45 - 6325CC6C - 8146D062 - A32783C2
SR11_PS4_DrivesReactor1	08/31/2023 10:47:39.893 AM	27027869 - 79F283CA - 07AEF4CF - 048A137E - 8A473F77 - E29A011C - 07980676 - 8DE09793
SR11_PS5_DrivesReactor2	08/31/2023 10:47:39.893 AM	0891D783 - 7988D678 - F7E56890 - EA08C187 - A98D4750 - E8C769F2 - 0E1437F4 - 877EFDAC
SR11_PS6_DrivesReactor3	08/31/2023 10:47:39.893 AM	8A6C1C8E - 51D7FCE2 - 2E801ABA - 11908CC4 - F35CE654 - 827F8D12 - 48D2194E - 312D0246
SR20_CompressedAir	08/31/2023 10:47:39.893 AM	00919E67 - 69492280 - 102D9561 - 60168987 - 08F1ED48 - 04448331 - E804A84A - 68B08470
SR21_DoorInterlock	08/31/2023 10:47:39.893 AM	C590CC40 - E6C5AA6A - 80F80746 - C242D493 - 118FAF12 - 283E1A08 - 84172EE8 - 08B85DEF
SR22_SmokeDetection	08/31/2023 10:47:39.893 AM	17E183FF - 78480838 - 88A84206 - D6189781 - 330877CC - D1C2360C - 7EC0A1D4 - AAC576E0
S_D01	08/31/2023 10:47:39.893 AM	CD18AA25 - B2281202 - A9A181CC - 0EA18119 - FDF7D1FB - 70797419 - 47507019 - AADEF603

GuardLogix and Compact GuardLogix Controller Systems

For product certification information, see <https://rok.auto/certifications>. Use the filters to search for your products.

Firmware revisions are available from the Product Compatibility and Download Center at <rok.auto/pcdc>.

GuardLogix 5580 Controller Hardware

GuardLogix® 5580 controller hardware consists of the following:

- A primary controller (1756-L8xES, 1756-L8xESK, 1756-L8xEXTS, or 1756-L8xESXT), which can be used alone in SIL 2 applications
- A safety partner (1756-L8SP, 1756-L8SPK, 1756-L8XTSP, or 1756-L8SPXT), which you can add to the primary controller to create a SIL 3-capable controller

Both the primary controller and safety partner perform power-up and runtime functional diagnostic tests of all safety-related components in the controller:

- A primary controller without a safety partner is rated up to SIL 2.
- A primary controller with a safety partner is rated up to SIL 3.

Controller	Cat.No.
GuardLogix® 5580 controller	1756-L81ES, 1756-L82ES, 1756-L83ES, 1756-L84ES, 1756-L85ES ¹ , 1756-L8SP, 1756-L81ESK, 1756-L82ESK, 1756-L83ESK, 1756-L84ESK, 1756-L8SPK
GuardLogix-XT™ controllers	1756-L81EXTS, 1756-L82EXTS, 1756-L83EXTS, 1756-L84EXTS, 1756-L8XTSP, 1756-L81ESXT, 1756-L82ESXT, 1756-L83ESXT, 1756-L84ESXT, 1756-L8SPXT

You can fill slots of a SIL 2 or SIL 3 system chassis that are not used by the GuardLogix® SIL 2 or SIL 3 system with other ControlLogix® 1756 modules. The module must be certified for low voltage and EMC Directives.

Primary Controller

The primary controller is the processor that performs standard and safety control functions and communicates with the safety partner for safety-related functions in the GuardLogix® control system. The primary controller consists of a central processor, I/O interface, and memory.

Safety Partner

To satisfy SIL 3 requirements, you must install a safety partner in the slot immediately to the right of the primary controller. The safety partner is a co-processor that provides 1002 architecture for safety-related functions in the system. The 1002 system does not run degraded.

1. Supported by Studio 5000 Logix Designer® version 36 later.

Be aware of the following types of fault scenarios:

- If the two processors disagree, the result is a major nonrecoverable fault, which requires you to redownload the application.
- If the two processors cannot communicate, the result is a nonrecoverable safety fault, which may require you to redownload the application.

For information about how to respond to nonrecoverable faults, see the following.

IMPORTANT: This manual links to Logix 5000® Controller and I/O Fault Codes and Syslog Messages, [1756-RD001](#); the file automatically downloads when you click the link.

For SIL 2 requirements, do not install a safety partner. The primary controller configures the safety partner. Only one download of the user program to the primary controller is required. The primary controller controls the operating mode of the safety partner.

Chassis

The chassis provides the physical connections between modules and the 1756 GuardLogix® system. Any failure, though unlikely, would be detected as a failure by one or more of the active components of the system. Therefore, the chassis is not relevant to the safety discussion.

Power Supply

No extra configuration or wiring is required for SIL 2 or SIL 3 operation of the ControlLogix® power supplies. Any failure would be detected as a failure by one or more of the active components of the GuardLogix system. Therefore, the power supply is not relevant to the safety discussion.

Compact GuardLogix 5380 Controller Hardware

Compact GuardLogix® 5380 controller hardware consists of a SIL 2- or SIL 3-capable controller that performs standard and safety control functions for safety-related functions.

Controller	SIL Rating	Cat. No.
Compact GuardLogix® 5380	SIL 2	5069-L306ERMS2, 5069-L306ERS2, 5069-L310ERMS2, 5069-L310ERS2, 5069-L320ERMS2, 5069-L320ERS2, 5069-L320ERS2K, 5069-L320ERMS2K, 5069-L330ERMS2, 5069-L330ERS2, 5069-L330ERS2K, 5069-L330ERMS2K, 5069-L340ERMS2, 5069-L340ERS2, 5069-L350ERMS2, 5069-L350ERS2, 5069-L350ERS2K, 5069-L350ERMS2K, 5069-L380ERMS2, 5069-L380ERS2, 5069-L3100ERMS2, 5069-L3100ERS2
	SIL 3	5069-L306ERMS3, 5069-L310ERMS3, 5069-L320ERMS3, 5069-L330ERMS3, 5069-L340ERMS3, 5069-L350ERMS3, 5069-L380ERMS3, 5069-L3100ERMS3, 5069-L320ERMS3K, 5069-L330ERMS3K, 5069-L350ERMS3K

IMPORTANT:

This equipment is supplied as open-type equipment for indoor use. It must be mounted within an enclosure that is suitably designed for those specific environmental conditions that are present and appropriately designed to help prevent personal injury resulting from accessibility to live parts. The enclosure must have suitable flame-retardant properties to help prevent or minimize the spread of flame, complying with a flame spread rating of 5VA or be approved for the application if nonmetallic. The interior of the enclosure must be accessible only by the use of a tool.

For more information regarding specific enclosure type ratings that are required to comply with certain product safety certifications, see the following:

- Compact GuardLogix 5380 SIL 2 Controllers Installation Instructions, publication [5069-IN014](#)
 - Compact GuardLogix 5380 SIL 3 Controllers Installation Instructions, publication [5069-IN023](#)
-

Expansion slots of the system bus can be populated with Compact 5000® I/O expansion modules that are certified to the Low Voltage and EMC Directives and populated per the instructions that are listed under Power Supply.

Compact GuardLogix 5380 SIL 3 Controllers

For SIL 3/PLe safety applications, the Compact GuardLogix® 5380 SIL 3 controller system consists of a primary controller and an internal safety partner. The internal safety partner is a co-processor that provides 1oo2 architecture for safety-related functions in the system. The 1oo2 system does not degrade. If the two processors disagree or cannot communicate with each other, the result is a major nonrecoverable controller fault.

For information about how to respond to nonrecoverable faults, see the following:

IMPORTANT: This manual links to Logix 5000® Controller and I/O Fault Codes and Syslog Messages, [1756-RD001](#); the file automatically downloads when you click the link.

The primary controller configures the safety partner. Only one download of the user program to the primary controller is required. The primary controller controls the operating mode of the safety partner.

Power Supply

For Functional Safety applications, SELV/PELV-listed power supplies are required for both module power (MOD) and sensor actuator (SA) power.

Consider the following when you choose a power supply:

- The MOD power of the Compact GuardLogix® 5380 controller requires a 24V DC SELV/PELV-listed power supply.
 - All local 24V DC safety I/O require a SELV/PELV-listed power supply.
 - If the SA power connector of the Compact GuardLogix® 5380 controller is used, it requires a 24V DC SELV/PELV-listed power supply.
 - If local 120/240V AC I/O are used in the Compact GuardLogix® 5380 chassis, their 120/240V AC I/O SA power must be connected to a catalog number 5069-FPD module.
 - If any standard I/O are used that are not powered by a SELV/PELV-listed power supply, their I/O power must be connected to a catalog number 5069-FPD module.
-

IMPORTANT: For more information on how to power the 5069 platform when a CompactLogix® or Compact GuardLogix® controller is present, see the CompactLogix 5380 and Compact GuardLogix 5380 User Manual, publication [5069-UM001](#).

GuardLogix Communication on an EtherNet/IP Network


A GuardLogix® 5580 or Compact GuardLogix® 5380 controller can connect directly to an EtherNet/IP™ network through the onboard Ethernet port and supports 10/100/1000 Mbps network speeds. A separate Ethernet communication module is not required, but can be used in the local chassis.


Contact your local Rockwell Automation sales office or Allen-Bradley distributor for other communication interface modules available for use in the GuardLogix® 5580 or Compact GuardLogix® 5380 controller system.


Peer-to-peer safety communication between GuardLogix® controllers is possible via the EtherNet/IP™ network. GuardLogix® controllers can control and exchange safety data with safety I/O devices on an EtherNet/IP™ network, via the onboard Ethernet ports or EtherNet/IP™ bridges.

IMPORTANT: A remote GuardLogix® or Compact GuardLogix® controller that has firmware earlier than revision 28 cannot consume data from a GuardLogix® 5580 or Compact GuardLogix® 5380 controller. Older consumer controllers must be updated to at least to firmware revision 28, or use a dedicated, separate EtherNet/IP™ module in the same chassis as the GuardLogix® 5580 controller, making a connection for produced/ consumed tags that bridges through the Logix backplane. See Knowledgebase Article [Safety Tags produced by a GuardLogix 5580 controller consumed by an older GuardLogix 5570 controllers](#).

Figure 12. GuardLogix 5580 Peer-to-peer Communication via the EtherNet/IP Network

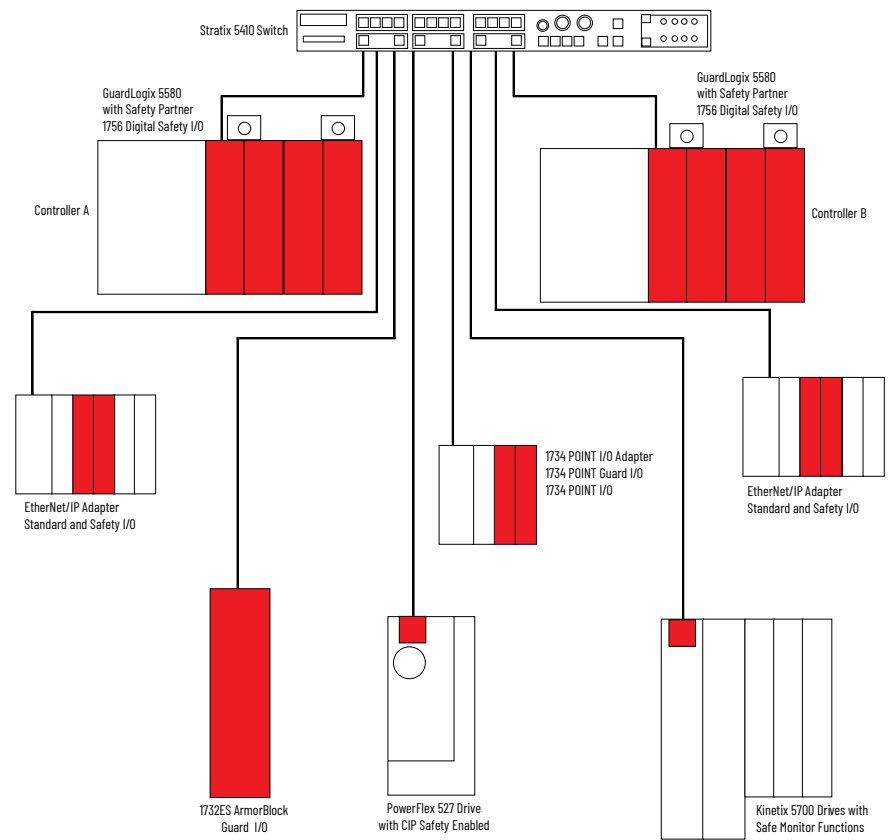


 Peer-to-peer safety communication between two GuardLogix® 5580 controllers in the same chassis is also possible via the backplane.

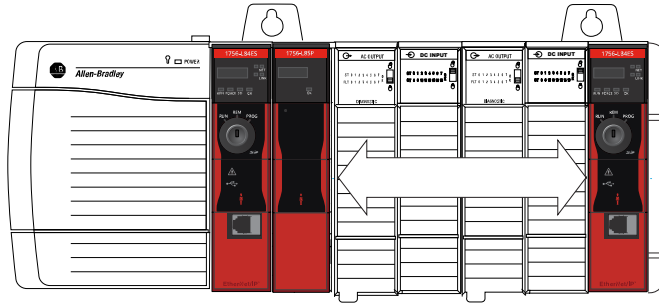

Compact GuardLogix® 5380 controllers connect directly to the EtherNet/IP™ network through the onboard Ethernet ports. They also support 10/100/1000 Mbps network speeds. A local Ethernet communication module is not used.


Figure 13. Compact GuardLogix 5380 Peer-to-peer Communication via the EtherNet/IP Network

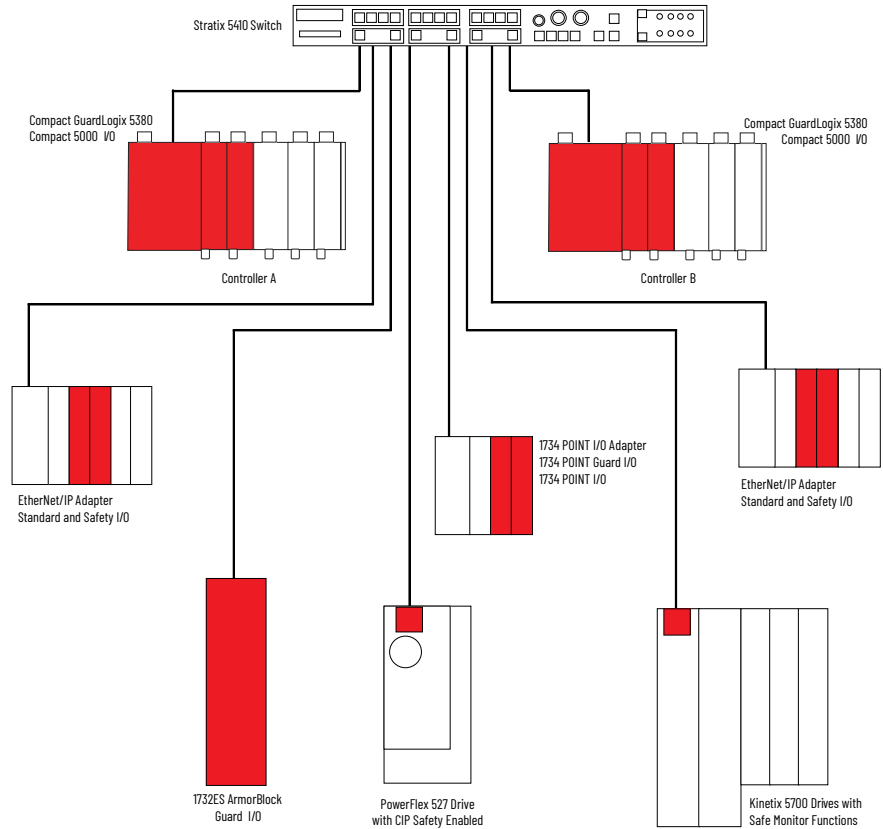

GuardLogix Communication on a DeviceNet Network


DeviceNet® bridges let the GuardLogix® controller control and exchange safety data with safety I/O modules on a DeviceNet® network.

Figure 14. GuardLogix 5580 Communication via a DeviceNet Bridge

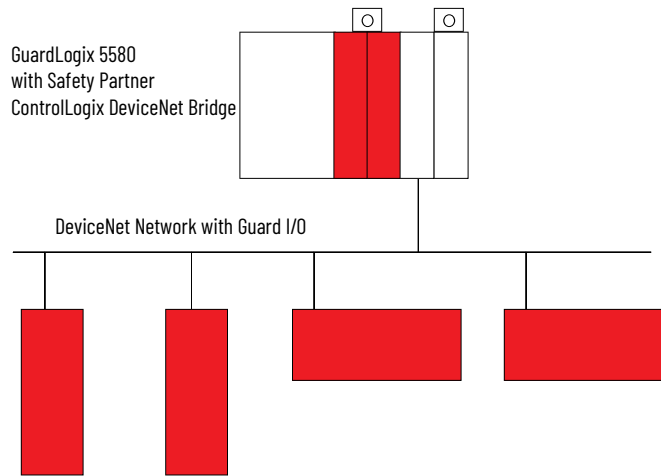

Compact GuardLogix® 5380 controllers can communicate with safety devices on a DeviceNet® network via a 1788-EN2DNR EtherNet/IP™ to DeviceNet® linking device.

Figure 15. Compact GuardLogix 5380 Controller with a DeviceNet Network

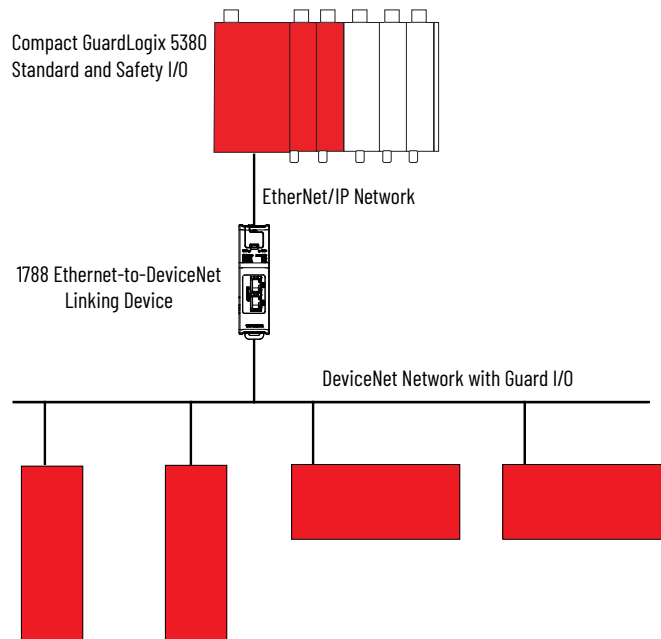

HMI Considerations in Safety Systems

Follow these precautions and guidelines for HMI devices in SIL-rated safety systems.

Precautions

You must exercise precautions and implement specific techniques on HMI devices. These precautions include, but are not restricted to the following:

- Limited access and security
- Specifications, testing, and validation
- Restrictions on data and access
- Limits on data and parameters

Use sound techniques in the application software within the HMI and controller.

Access to Safety-related Systems

HMI-related functions consist of two primary activities: reading and writing data.

Reading data is unrestricted because reading doesn't affect the behavior of the safety system. However, the number, frequency, and size of the data being read can affect controller availability. To avoid safety-related spurious trips, use good communication practices to limit the impact of communication processing on the controller. Do not set read rates to the fastest rate possible.

Writing data, or changing parameters, in a safety-related loop via a device that operates outside the safety loop, such as HMI, is allowed only with the following restrictions:

- Only authorized, specially trained operators can write data in safety-related systems via an HMI.
- The operator that writes data in a safety-related system via an HMI is responsible for the effect of those changes in the safety loop.
- You must clearly document the variables that are to be written.
- You must use a clear, comprehensive, and explicit operator procedure to make safety-related changes via an HMI.
- Writing data can be accepted in a safety-related system only if the following sequence of events occurs:
 1. The new value must be sent twice to two different standard tags. Both values must not be changed with one command.
 2. The two standard tags that receive the value from the HMI must be mapped into two safety tags.
 3. Safety-related code that executes in the controller, must check both safety tags for equivalency and make sure that they are within range (boundary checks).
 4. Both new variables must be read back and displayed on the HMI device. The HMI display reads the safety tags that received the mapped tag values from the standard tags.
 5. Trained operators must visually check that both variables are the same and are the correct value.
 6. Trained operators must manually acknowledge that the values are correct on the HMI display that sends a command to the safety logic, which allows the new values to be used in the safety function. In every case, the operator must confirm the validity of the change before they are accepted and applied in the safety loop.
- Test all changes as part of the safety assessment procedure.
- Sufficiently document all safety-related changes that are made via the HMI, including the following:
 - Authorization
 - Impact analysis
 - Execution
 - Test information
 - Revision information
- Process Safety changes to the safety-related system must comply with IEC 61511 requirements.
- Machine safety changes to the safety-related system must comply with IEC 62061 requirements.
- The developer must follow the same sound development techniques and procedures that are used for other application software development, including the verification and test of the operator interface and its access to other parts of the program. In the controller

application software, create a table that is accessible by the HMI and limit access to only required data points.

- Similar to the controller program, the HMI software is secured and maintained for SIL-level compliance after the system has been validated and tested.

Safety I/O

Safety I/O has most of the attributes of standard I/O except it features mechanisms that are certified to SIL 2 or SIL 3 for data integrity.

Before you use safety I/O, do the following:


- Read, understand, and follow all safety information in the product documentation for those products.
- Commission all devices with a node or IP address and communication rate before their installation on a safety network.

Safety I/O devices, like sensors and actuators, can be connected to safety input and output modules. The controller monitors and controls the devices. For safety data, I/O communication is performed through safety connections by using the CIP Safety™ protocol. Safety logic is processed in the controller.

Safety I/O treats the following as the safe state:

- Safety outputs: OFF
- Safety input data to controller: OFF

Figure 16. Safe State

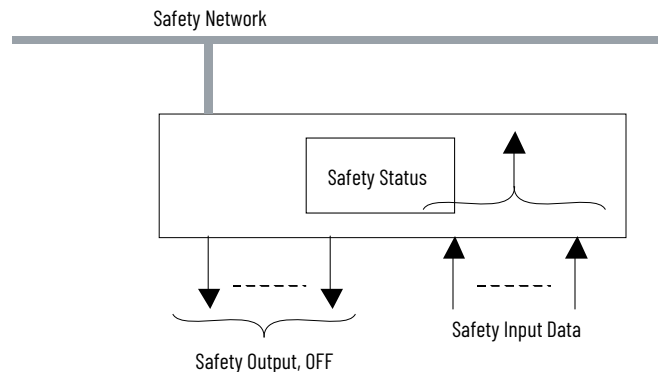

Use safety I/O devices for applications that are in the safe state when the safety output turns OFF.

Diagnostics

Safety I/O devices perform self-diagnostics when the power is turned ON and periodically during operation. If a diagnostic failure is detected, safety input data to the controller and local safety outputs are set to their safe state (OFF).

Status Data

Safety I/O devices support status data to monitor device and I/O circuit health. For specific product capabilities, see the product documentation for your device.

Status Indicators

Safety I/O devices include status indicators. For details on status indicator operation, see the product documentation for your specific device.

On-delay or Off-delay Function

Some safety I/O devices support on-delay and off-delay functions for input signals:

- Safety inputs can require an on-to-off delay to filter out the low pulse test in an output signal switching device (OSSD). Though the pulse test duration is measured in microseconds, the safety inputs can detect the low pulse as a transition to the safe state. The smallest configurable millisecond delay can be enough to filter out the pulse test.
- An on-to-off delay filter can help to filter out noise that affects the input logic level.
- Be sure to count any configured delays into the system reaction time.

SIL 2 and SIL 3 Considerations

The following information is only typical and may not be required for all safety I/O that can be used with safety controllers. For information specific to your I/O product, see the product user manual.

A difference between the safety integrity levels is that single-channel I/O devices are possible for SIL 2, and dual-channel I/O devices are typically required for SIL 3.

From a safety architecture perspective, one channel means that the hardware fault tolerance (HFT) is zero. When the HFT is zero, there are guidelines that state that faults must be detected and the safety function must be taken to a safe state within the process safety time. An exception applies if the diagnostic test rate is 100 times the demand rate. If you use safety I/O modules in single channel SIL 2 applications, consider the following:


- The input or output channel must be configured for Safety Pulse Test
- A process safety time greater than 600 ms (the typical safety I/O pulse test interval) or the demand rate must be less than one demand per minute, such as one per hour

Digital safety input modules support single-channel SIL 2 and dual-channel SIL 3 safety input circuits. Because these modules are rated for both SIL 2 and SIL 3 operation, you can mix SIL 2 and SIL 3 circuits on the same module.

The following figure shows how to wire SIL 2 safety circuits to safety input modules.


IMPORTANT: The test source must be configured for pulse testing.

Figure 17. Input Wiring

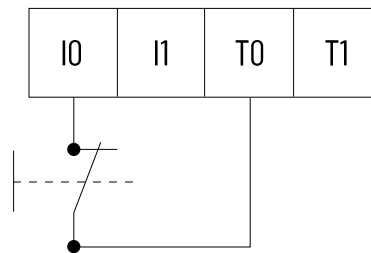


If you have two SIL 2 safety circuits, you can add a second as shown below.

Figure 18. Input Wiring Pairs

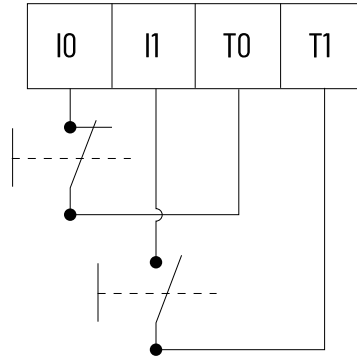

A typical SIL 3 wiring diagram is shown below.

Figure 19. SIL 3 Input Wiring

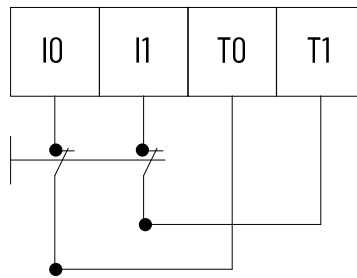

IMPORTANT: These wiring drawings are examples of possible wiring configurations. Depending on your I/O device and system configuration, other wiring configurations can also be used.

IMPORTANT: The onboard pulse test outputs (T0...Tx) are typically used with field devices that have mechanical contacts. If a safety device that has electronic outputs is used (to feed safety inputs), they must have the appropriate safety ratings.

Ownership

One controller owns each safety I/O device in a non-redundant safety system. Multiple controllers and multiple safety I/O devices can be used without restrictions in chassis or on networks. When a controller owns an I/O device, it stores the configuration data that you define for that device. This configuration controls how the devices operate in the system.


From a control standpoint, one controller controls safety output devices. One controller also owns each safety input device. However, safety input data can be shared (consumed) by multiple controllers.

Input Operation

Some safety input modules, such as Bulletin 1732, 1734, and 1791, have safety inputs that can be configured as single or dual (Equivalent or Complement) point operation types. The selected type configures the safety module to view the inputs individually or as a pair:

- A single configuration is appropriate for single channel inputs or dual channel inputs that are monitored by a dual channel safety instruction like the Dual Channel Stop (DCS).
- A dual configuration configures dual channel discrepancy checking to take place at the module level. The channel data from the input module is sent to the GuardLogix® controller as either the safe state or energized state. For example, equivalent inputs are either both low (0) or both high (1).

Figure 20. Input Point Operation Types

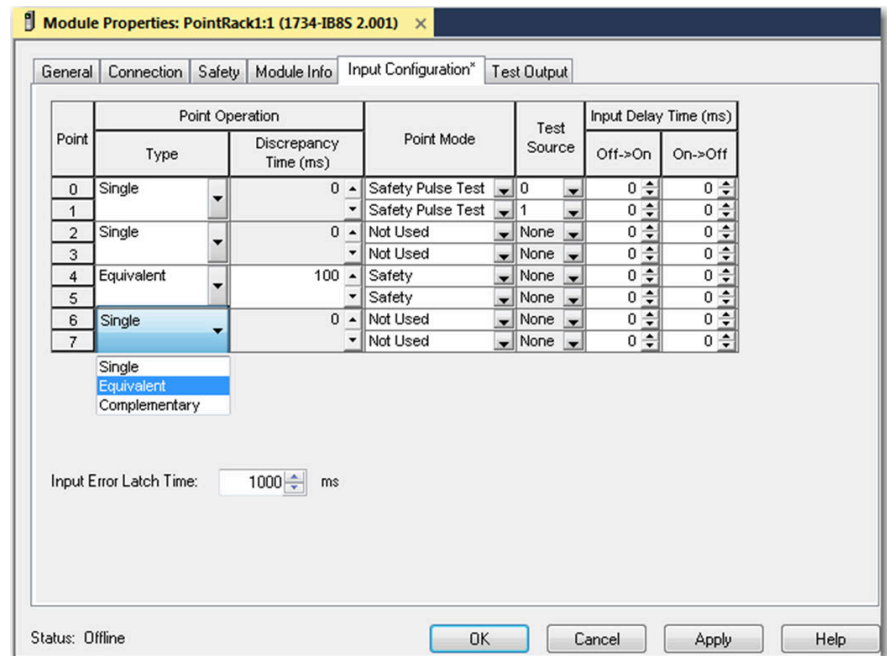


IMPORTANT: When inputs are configured for a dual point operation type and monitored by dual channel safety instructions, the instruction is unable to detect discrepancy faults.

The method of monitoring discrepancy has no impact on the safety rating. The main effect is the availability of diagnostic information:

- Module level diagnostics—Status indicators, input status bit, and application code can be written to message the I/O module to monitor 1 bit for a discrepancy fault.
- Dual channel instruction diagnostics—Fault codes include channel-specific discrepancy and whether the cause of a discrepancy is a delay or a change in state to a specific channel.

Some safety input modules, such as Bulletin 1756, 5069, and 5094, have no point operation type. All inputs are treated as single.

Figure 21. No Input Point Operation Types

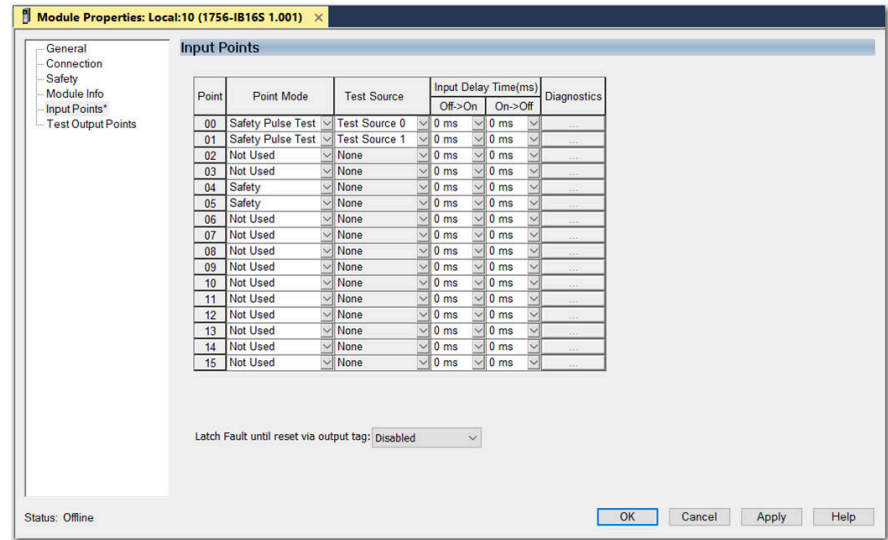


Output Operation

For output modules, sourcing safety outputs can be configured as point operation type single or dual. The selected type configures the safety module to treat the outputs individually or as a pair:

- A single configuration allows the outputs to turn on and off individually and to fault independently.
- A dual configuration verifies that safety task logic operates both outputs as a pair. If one output has a module fault, the other output goes to the safe state.

Figure 22. Output Point Operation Types

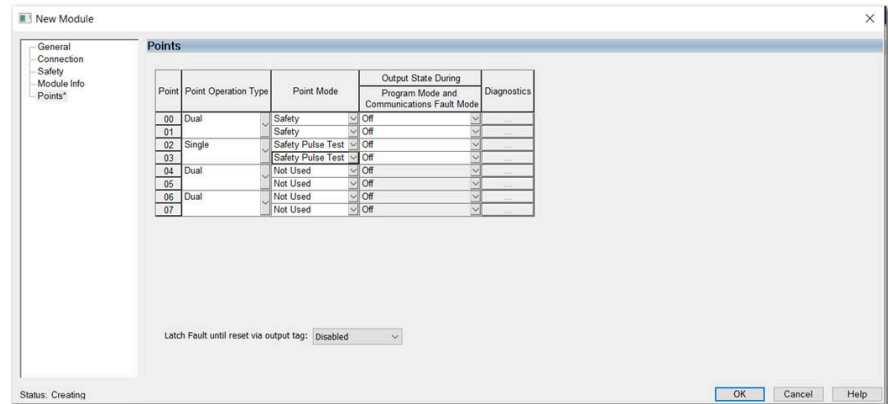

Bipolar outputs have no configuration for point operation type and must operate as a sinking sourcing pair.

IMPORTANT: The point operation type affects the PFH safety rating of the module. The PFH is the average frequency of a dangerous failure per hour.

Safety I/O Configuration Signature

The safety I/O configuration signature is a number that uniquely identifies the configuration of a device and verifies that the device is configured as expected by the safety application. The configuration signature consists of the following:


- A signature ID that represents the I/O module configuration
- The time and date that the module configuration was last applied

IMPORTANT:

The safety I/O configuration signature applies to individual safety modules.

The safety I/O configuration signature is different than the controller safety signature, which applies to the entire safety portion of the controller.

Figure 23. Safety I/O Configuration Signature

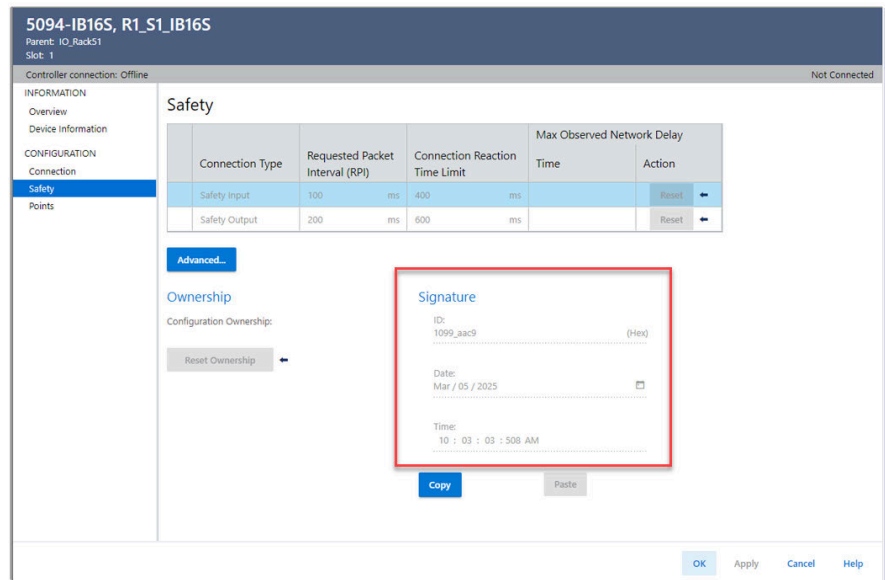

For a controller to establish a connection to a safety I/O module, the configuration signature in the controller must match the configuration signature in the safety I/O module. The process of synchronizing the configuration signatures requires these steps:

1. Create a safety I/O module in a Logix Designer application project.
2. Configure the I/O module in the module profile.
3. Download the project to the controller.

Online changes to the module configuration change the configuration signature. When online changes are applied, the controller downloads the configuration to the I/O module.

Offline changes to the I/O module configuration change the time and date. Once altered, the time and date remain changed even if the configuration is returned to the current running configuration. Offline changes to the time and date require one of these actions:

- Upload to keep the existing configuration.
- Download to push the new configuration to the I/O modules.

If a safety I/O module was previously configured in another location, the I/O module retains the configuration signature from the previous location. When a controller and a safety I/O module attempt to establish a safety connection, a mismatch of the configuration signatures can cause the connection to fail. To clear the safety I/O module configuration and enable the controller to download the module configuration to the safety I/O module, you must reset ownership.

The controller verifies that configuration signatures match, so there is no requirement to monitor or document the configuration signature. If the configuration signature changes unexpectedly, the safety connection between the controller and I/O module fails and causes the I/O module to enter its safe state.

When using a third-party module, if you connect to a safety I/O device without a configuration signature, you must verify that a valid configuration exists in the safety I/O device.

IMPORTANT: Safety I/O modules default to using a configuration signature and do not allow your system to run without a configuration signature.

Safety I/O Device Replacement

The process for making a connection to replacement safety I/O is dependent upon multiple factors including the following:

- Node address
- Electronic keying compatibility
- Whether the I/O module configuration is empty (out-of-box) or previously configured
- The Automatic Configuration setting for the safety controller



ATTENTION: During replacement or functional testing of a device, the safety of the system must not rely on any portion of the affected device.

The electronic keying configuration affects the process for replacing safety I/O modules. Carefully consider the implications of each of the following electronic keying options.

Table 4. Electronic Keying Settings

Keying Setting	Description	I/O Replacement Consideration
Compatible Module	Lets the installed device accept the key of the device that is defined in the project when the installed device can emulate the defined device. With Compatible Module, you can typically replace a device with another device that has the following characteristics: <ul style="list-style-type: none"> • Same catalog number • Same or higher major revision • Minor revision as follows: <ul style="list-style-type: none"> - If the major revision is the same, the minor revision must be the same or higher. - If the major revision is higher, the minor revision can be any number. 	To maintain the safety signature, the replacement module must meet Compatible Module requirements.
Disable Keying	Indicates that the keying attributes are not considered when attempting to communicate with a device. With	Many safety devices do not have a Disable Keying option. Disabled

Table 4. Electronic Keying Settings (continued)

Keying Setting	Description	I/O Replacement Consideration
	<p>Disable Keying, communication can occur with a device other than the type specified in the project.</p> <p>ATTENTION: Be cautious when using Disable Keying. If used incorrectly, this option can lead to personal injury or death, property damage, or economic loss.</p> <p>We strongly recommend that you do not use Disable Keying. If you use Disable Keying, you must take full responsibility for understanding whether the device being used can fulfill the functional requirements of the application.</p>	<p>Keying is not recommended for safety applications.</p>
Exact Match	<p>Indicates that all keying attributes must match to establish communication. If any attribute does not match precisely, communication with the device does not occur.</p>	<ul style="list-style-type: none"> • To maintain the safety signature, the replacement module must be Exact Match. • After a firmware change, keying in the safety application must be updated. Updating cannot be done without removing the controller safety signature. • Exact Match is often used to meet specific industry requirements.


Automatic configuration enables the safety controller to establish a connection with replacement safety I/O without online user interaction. Automatic configuration is enabled when there is no controller safety signature. Allowing automatic configuration with no safety signature facilitates commissioning and maintenance activities when the safety controller is not being used for SIL-rated functions. Following I/O replacement, you must validate proper operation before using SIL-rated functions.

Two options for I/O device replacement are available on the Safety tab of the Controller Properties dialog box in the Studio 5000 Logix Designer® application:

- Only Allow Automatic Configuration When No Safety Signature Exists
- Always Allow Automatic Configuration

Choosing an automatic configuration setting requires an understanding of the safety network topology and the intended use of the safety system during I/O replacement.

Figure 24. Safety I/O Replacement Options

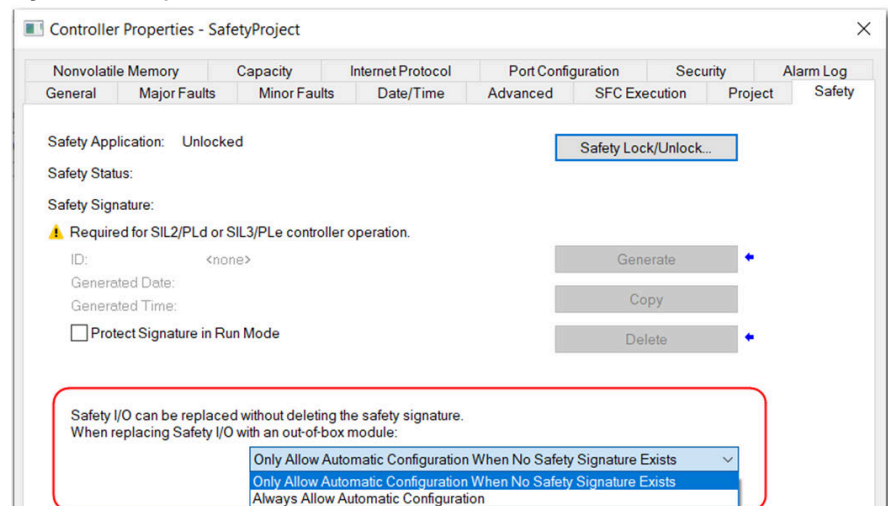

Only Allow Automatic Configuration When No Safety Signature Exists

This option instructs the safety controller to configure a safety device when the safety task does not have a safety signature, and the replacement device is in an out-of-box condition with no safety network number.

If the controller has a safety signature, the safety controller automatically configures the replacement safety I/O device if the following are true:

- The device already has the correct safety network number.
- The device electronic keying is correct.
- The node or IP address is correct.

To set the proper safety network number (SNN) when a controller safety signature exists, manual action is required to download the proper SNN:

1. In the Studio 5000 Logix Designer®, go online with the safety controller.
2. Open the Module Properties dialog box.
3. On the General tab, click Browse (...) next to the safety network number.
4. Click Set to write the SNN to the module manually.
5. Verify that the Network Status (NS) indicator is alternating red/green on the correct device.
6. Click Yes on the confirmation dialog box to set the SNN and accept the replacement device.
7. Follow your company-prescribed procedures to functionally test the replacement I/O device and system.

For more information, follow the safety I/O device replacement procedure in the controller user manual.

Always Allow Automatic Configuration

The controller attempts to configure a replacement safety I/O device automatically if the device is in an out-of-box condition. When a safety network number does not exist in the replacement safety device, and the node number and I/O device keying matches the configuration of the controller.



ATTENTION:

Select the Always Allow Automatic Configuration option only if the entire routable safety control system is not being relied on to maintain SIL 2 or SIL 3 behavior during the replacement and functional testing of a device. The routable safety control system includes any device that can have safety connections opened on it by the controller.

If other parts of the safety control system are being relied upon to maintain SIL 2 or SIL 3, make sure that the Always Allow Automatic Configuration option is not selected.

It is your responsibility to implement a process to make sure that proper safety functionality is maintained during device replacement.



ATTENTION: To place a device in the out-of-box condition on a safety network when the Always Allow Automatic Configuration option is selected, follow the device replacement procedure in the controller user manual.

Automatic Configuration Use Cases

Consider the following examples of when to use a particular automatic configuration setting.

Only Allow Automatic Configuration When No Safety Signature Exists	Always Allow Automatic Configuration
<ul style="list-style-type: none"> • Multi-zone safety system where I/O replacement is required in one zone, while other zones maintain SIL functionality. • Multiple controllers with safety I/O on the same routable network. 	<ul style="list-style-type: none"> • The safety system provides no safety function during I/O replacement: <ul style="list-style-type: none"> - Use of energy isolation or other application-specific procedure - Other application-specific safeguards are in place • The network for safety I/O communication is isolated from external safety devices.

Safety I/O Configuration Variations

As the range of products using the CIP Safety™ protocol continues to expand, there are variations to the typical safety I/O configuration steps. Product specific procedures and requirements can include the following:

- Reset of ownership
- Setting the safety network number (SNN)
- Configuration signature generation
- Request packet interval (RPI) limits
- Device-specific configuration settings

For more information, see the user manual for your I/O device.

CIP Safety Systems and Safety Network Numbers

CIP Safety™ control systems are composed of CIP Safety™ devices that are interconnected via communication networks. These networks consist of devices, such as bridges, switches, routers, adapters, and redundancy modules, which may not be SIL 2 or SIL 3 certified. The secure transmission of safety-related data through standard infrastructure devices is known as black channel communication.

CIP Safety™ devices must be inherently protected from network delivery errors. The CIP Safety™ protocol is an end-node to end-node safety protocol. This configuration allows the routing of CIP Safety™ messages to and from CIP Safety™ devices through non-certified bridges, switches, routers, adapters, and redundancy modules.

For more information about CIP Safety™ functionality and related concepts, see the following:

- ODVA website at <https://www.odva.org>
- CIP Safety: Safety Networking for Today and Beyond White Paper, publication [SAFETY-WP038](#)

Unique Node Reference

A key element of the CIP Safety™ protocol is the concept of a Unique Node Reference (also called Unique Node ID or UNID). Every CIP Safety™ device must have a UNID value that is assigned to each CIP Safety™-capable port.

IMPORTANT: It is your responsibility to make sure that all UNIDs are unique within the scope of all devices that could possibly communicate with each other.

Safety Network Numbers (SNNs)

Communication within a control system travels over subnets that are interconnected with bridging or routing components. The following are examples of subnets:


- The backplane of a chassis
- A bank of I/O modules
- An Ethernet subnet within a LAN

Rather than creating a UNID directly for each CIP Safety™ device, which can be prone to error in a large system, each subnet has a unique safety network number (SNN), and the UNID is created from the SNN + the node address.

Routable CIP Safety System

The following example illustrates the extent of a routable CIP Safety™ system. In this example, the system is not interconnected to another CIP Safety™ system through a larger, plant-wide Ethernet backbone.

Figure 25. Routable CIP Safety System

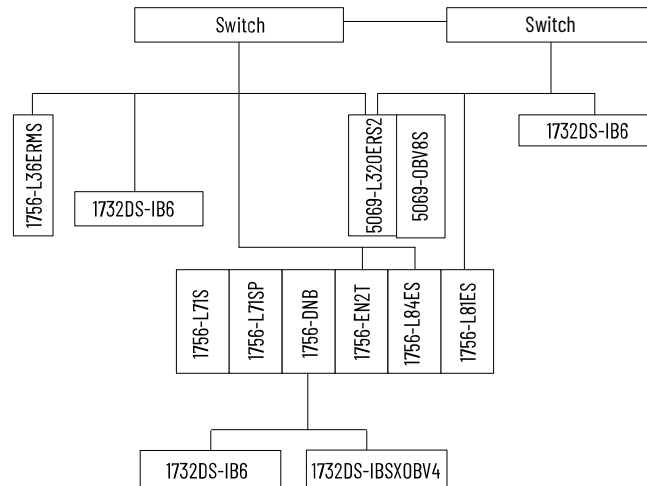

Note the following:

- For a backplane port, an SNN is assigned to the backplane and the node address is the slot number of the device.
- For an Ethernet port, an SNN is assigned to the EtherNet/IP™ network and the node address is the IP address of the device.
- For a controller in Dual-IP mode and connected to two separate EtherNet/IP™ networks, they must not share SNN values because the switches can incorrectly route packets between them.

Considerations for Assigning SNNs

When you create a controller project, the Studio 5000 Logix Designer® application generates an SNN value automatically whenever a new subnet contains CIP Safety™ devices:

- Each CIP Safety™-capable port on the controller is assigned an SNN.
- If a bridge or adapter device is in the I/O tree and a child CIP Safety™ device is added, the subnet that is created by the bridge or adapter is assigned an SNN.


If the entire CIP Safety™ system consists of one controller project, these automatically generated SNN values are sufficient.

If there are multiple controllers that must interact or access the same safety I/O, the CIP Safety™ system designer must coordinate the SNN values between the separate project files. The Studio 5000 Logix Designer® application provides copy/paste access to the SNN assignments to enable this coordination.

You can also choose to map out the entire routable system (perhaps for the entire plant), and manually assign SNN values to each subnet. The Studio 5000 Logix Designer® application provides a manual entry method for assigning SNN values to enable this design methodology.

The following example shows how SNNs can be assigned to subnets.


Figure 26. SNN Assignment Example

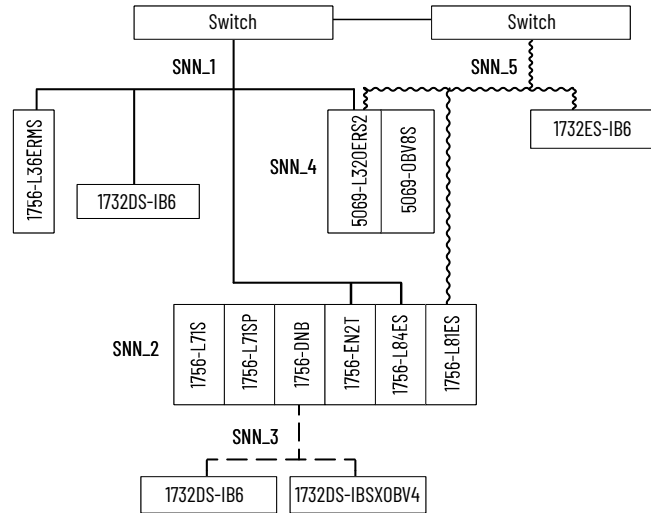

Subnet	Type	SNN Assignment
SNN_1	EtherNet/IP™	1769-L36ERMS Ethernet port, 1791ES-IB16, 5069-L320ERS2 Ethernet port A1, 1756-EN2T, and 1756-L84ES Ethernet port
SNN_2	Backplane	1756-L71S, 1756-L84ES backplane port, and 1756-L81ES backplane port
SNN_3	DeviceNet®	1732DS-IB6, 1732DS-IBSX0BV4
SNN_4	Backplane	5069-L320ERS2 backplane and 5069-OBV8S
SNN_5	EtherNet/IP™	5069-L320ERS2 Ethernet port A2

The following figure shows how the preceding example corresponds to the Controller Organizer I/O tree.

Figure 27. Controller Organizer

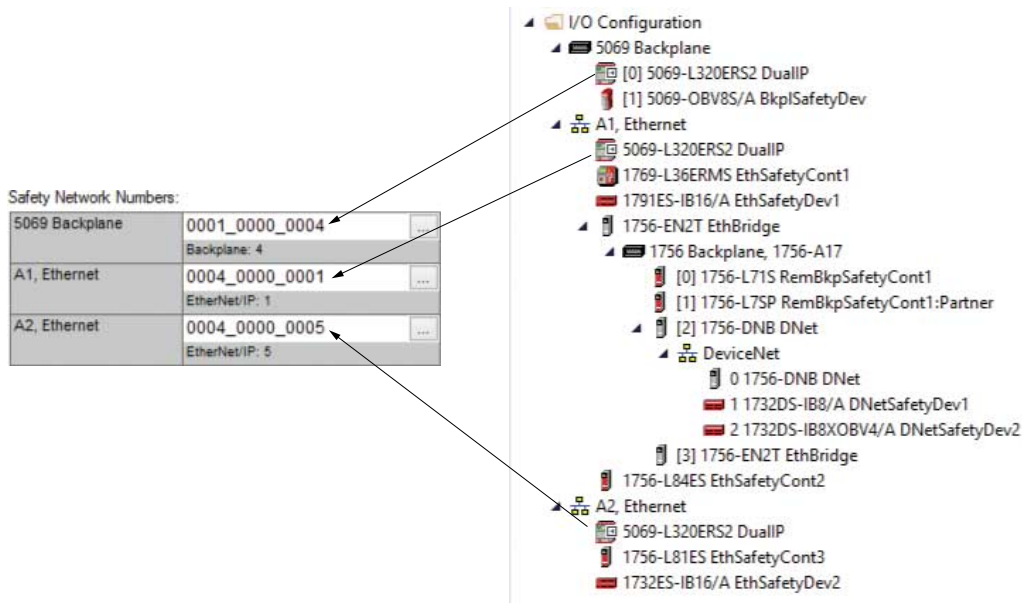

The configuration profile for each CIP Safety™ device in the I/O tree includes a parameter for the SNN value that the controller uses when it opens the CIP Safety™ connection to that device. This parameter automatically adopts the SNN value that is already established by the SNNs known to the project:

- Safety devices, including controllers, that are direct children of a controller adopt the SNN that matches the controller for the port that is used to connect to the safety module.
 - Safety devices directly under the backplane port adopt the backplane port SNN of the controller.
 - Safety devices directly under an Ethernet port adopt that Ethernet port SNN of the controller.
- Safety devices, including controllers, on a remote subnet adopt the SNN value that is already assigned to that subnet, or a new SNN is generated for the first CIP Safety™ device on that subnet.

We recommend that you assign each controller SNN to the already established SNN for the subnet. This recommendation enables the Logix Designer application to assign the correct SNN to each safety I/O module and safety controller that are added to the project.

If safety I/O is copied from an existing project during controller program development, the SNN value from the original location is retained. To create an SNN structure that resembles the newly created I/O, you can manually change the SNN of copied devices to follow the SNN structure of the new project by using copy/paste SNN from other I/O on the subnet or parent device. If you copy safety I/O into a new remote rack, then a new time-based SNN can be established and populated throughout the remote rack.

How SNNs Get to Safety Devices

Most CIP Safety™ I/O modules in the factory default state accept an SNN that is assigned by the controller that owns that module. The SNN value that the programming software automatically adopts for the connection of that module is accepted when the controller opens the initial connection to the module.

IMPORTANT: CIP Safety™ I/O modules retain their UNID (SNN + node) once it has been assigned and must be reset before they can be reused with another value.

Some devices, such as another safety controller in the I/O tree, receive their SNN configuration from a programming workstation. For these devices, you must manually configure the connection to use the same SNN that has been programmed into that device if the programming software did not automatically assign the correct SNN.

SNN Formats


SNNs used by the system are 6-byte hexadecimal numbers. SNNs can be set and viewed in one of two formats:

- Time-based
- Manual

Time-based SNN Format and Assignment

When the time-based format is selected, the SNN represents a date and time based on the local clock of the computer that generated the SNN.

Figure 28. Time-based SNN Format

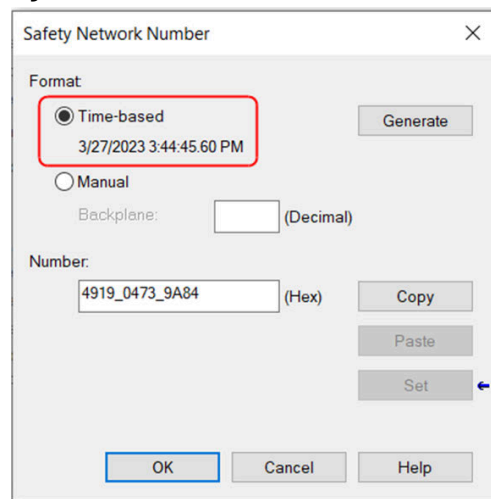

The assignment of time-based SNNs is automatic when you create a safety project or add EtherNet/IP™ by changing the IP mode or controller type. Time-based SNNs generated by the software are always unique to the project, whether generated by project creation or IP mode change. Devices that are created directly under the controller port default to having the same SNN as that port on the controller.

IMPORTANT: If you have a network diagram for your application, you must edit the SNNs of the controller to match your network diagram. We recommend that you edit the SNNs before you add devices to the I/O configuration in Controller Organizer.

When you add CIP Safety™ I/O devices to ports under an adapter, as opposed to the controller, the following applies:

- If no other device under the port uses an SNN, a time-based SNN is automatically assigned.
- If another device under the port uses an SNN, the device is assigned the same SNN as the first device in address order.

Manual SNN Format and Assignment

When the manual format is selected, the SNN represents a network type and must have a decimal value from 1...9999.

Figure 29. Manual SNN Format

The screenshot shows a dialog box titled "Safety Network Number". Under the "Format" section, the "Manual" radio button is selected and highlighted with a red rectangular box. Below it, the "Backplane:" label is followed by a text input field containing the number "0" and the text "(Decimal)". Under the "Number:" section, a text input field contains "0001_0000_0000" and is labeled "(Hex)". To the right of this field are buttons for "Copy", "Paste", and "Set". At the bottom of the dialog are "OK", "Cancel", and "Help" buttons. A blue arrow points to the "Set" button.

Manual manipulation of an SNN is required for the following reasons:

- To make sure that each safety controller port on the same subnet has the same SNN in all projects
- To copy safety projects



ATTENTION: If a safety project is copied into another project with different hardware or in another physical location, and the new project is within the same routable safety system, every SNN must be changed in the second system. SNN values cannot be repeated. For information about how to change the SNN, see the controller user manual.

IMPORTANT:

If you assign an SNN manually, make sure that system expansion does not result in a duplication of SNN and unique node reference combinations.

A warning appears if your project contains duplicate SNN and unique node reference combinations. You can still verify the project, but we recommend that you resolve the duplicate combinations.

However, there can be safety devices on the routable safety network that have the same SNN and node address and are not in the project. In this case, these safety devices are unknown to the Studio 5000 Logix Designer® application, and you may not see a warning.

If there are duplicate unique node references, as the system user, you are responsible for proving that an unsafe condition cannot result.

Safety Programming Considerations

Complete these programming tasks for safety applications:

- Define the location, ownership, and configuration of I/O devices and controllers.
- Create, test, and debug program logic. Only ladder diagram is supported in the safety task.

IMPORTANT: When the controller is in Run or Program mode and you have not validated the application program, you are responsible for maintaining safe conditions.

Programming Restrictions

The Logix Designer application limits the availability of some menu items and features, such as cut, paste, delete, and replace, to protect safety components from being modified whenever any of these are true:

- The controller is safety-locked
- A safety signature exists
- Safety faults are present
- Safety status is in any of these states when online:
 - Partner missing
 - Partner unavailable
 - Hardware incompatible
 - Firmware incompatible

IMPORTANT: The maximum and last scan times of the safety task and safety programs can be reset when online.


If even one of these conditions applies, you cannot do the following:

- Create or modify safety objects, including safety programs, safety routines, safety tags, safety Add-On Instructions, and safety I/O devices
- Apply forces to safety tags
- Create safety tag mappings
- Modify or delete tag mappings
- Modify or delete user-defined data types that are used by safety tags
- Modify the controller name, description, chassis type, slot, and safety network number
- Create, modify, or delete a safety connection

When the controller is safety-locked, you cannot modify or delete the safety signature.

Safety Task

A safety application includes a safety task with a safety program and main routine.

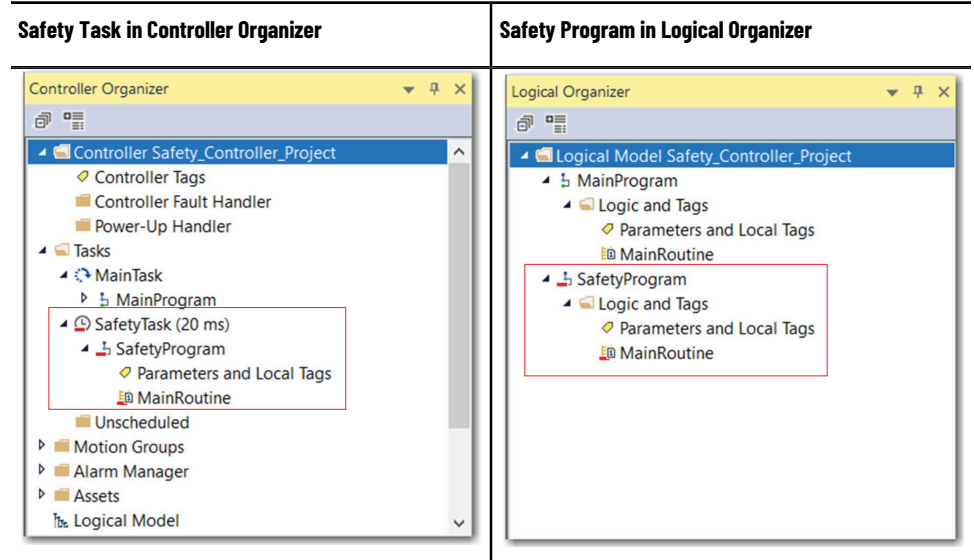

A safety task has these characteristics:

- The safety task is a periodic timed task. A periodic task is triggered at repetitive intervals. When triggered, the period task and its programs are executed. Data and outputs that the programs in the task establish retain their values until the next execution of the task or until another task manipulates them. Periodic tasks always interrupt the continuous task.
- The safety task cannot be deleted.
- Within the safety task, you can use multiple safety programs that are composed of multiple safety routines.
- You cannot execute standard routines from within the safety task.
- There can be only one safety task for a controller.
- You must configure the period and the priority of the safety task. The safety task can be interrupted according to the same rules as standard tasks, such as interruptions by the motion task. The motion task is always a higher priority than any user task.

IMPORTANT: Large amounts of mapped safety tags or large amounts of safety produce/consume tag data can cause fluctuations in the safety task scan time of the controller.

IMPORTANT: If the controller is configured for SIL 2 and the next slot to the right is empty or populated by a non-safety module, execution of the safety task can be delayed during powerup by five seconds or more.

Safety Task Parameters

You can configure the following safety task parameters:

- **Period**—The safety task period is the time interval between successive executions of the safety task. The safety task period directly affects system reaction time. You cannot edit the safety task period online.
- **Priority**—Configure the safety task with a higher priority (lower number) to reduce fluctuations in execution time. A higher priority can allow a lower setting for the safety task watchdog, which improves the reaction time of the safety system.
- **Watchdog**—The safety task watchdog is the maximum time that is allowed from the start of the safety task to its completion. If a safety task watchdog timeout occurs, a nonrecoverable safety fault is generated in the controller.

To configure the safety task, right-click the safety task and choose Properties.

IMPORTANT: The values that you define for the safety task parameters must meet the requirements that are defined in the following table.

Figure 30. Safety Task Parameters

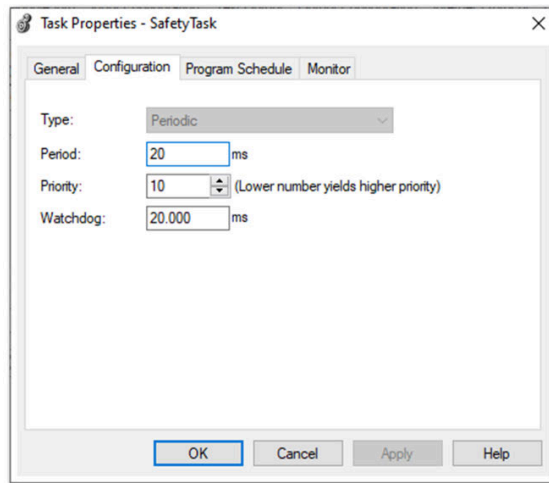


Table 5. Safety Task Requirements

Parameter	Requirement
Period	Be sure that the safety task has enough time to execute its logic before it restarts. Enter a value of 2...500 ms.
Priority	To get the most consistent safety task execution time and to minimize safety task watchdog faults, we recommend that you enter a value of 1 to make the safety task the highest priority user task.
Watchdog	Enter a value of 2...500 ms.

Safety Task Execution Details

The safety task executes like standard periodic tasks with these exceptions:

- Safety input tags and safety-consumed tags are updated only at the beginning of safety task execution. This process means that even though the I/O RPI can be faster than the safety task period, the data in the Safety Input tag only updates once at the beginning of each safety task execution. Safety input and consumed packets that arrive after the start of the safety task are buffered until the next execution of the safety task.
- Time is frozen at the start of safety task execution. As a result, timer-related instructions, such as TON and TOF, are not updated during a safety-task execution. They keep accurate time from one task execution to another, but the accumulated time is not changed during safety task execution.

IMPORTANT: This behavior differs from standard Logix task execution.

- For standard tags that are mapped to safety tags, the standard tag values are copied to the safety tags at the start of the safety task:
 - The standard tag is free to continue changing.
 - Programming logic can change the safety tag within the safety task, but the change is not reflected back to the standard tag.

IMPORTANT: The addition of more mapped tags can increase the scan time.

- Safety output tag values can be changed during the safety task scan by the safety programming logic. The final value is transmitted to safety modules at the end of the safety task scan. Likewise, safety produced values are transmitted to consuming safety controllers at the end of the safety task scan.

IMPORTANT:

While safety-unlocked and without a safety signature, the controller helps prevent simultaneous write access to safety memory from the safety task and communication commands. As a result, the safety task can be held off until a communication update completes. The time that is required for the update varies by tag size. Insufficient time can result in safety connection and safety watchdog timeouts.

To compensate for the hold-off time due to a communication update, you must increase the safety watchdog time.

Depending on the edit, a watchdog timeout can occur if there is insufficient time to complete the safety task operation.

When the controller is safety-locked or a safety signature exists, the scenarios that are described in this note cannot occur.

Safety Programs

A safety program has the attributes of a standard program, except that it can be scheduled only in the safety task:

- A safety program can also define program-scoped safety tags.
- A safety program can be scheduled or unscheduled.
- A safety program can contain only safety components.
- All routines in a safety program are safety routines. One safety routine must be designated as the main routine, and another safety routine can be designated as the fault routine.
- A safety program cannot contain standard routines or standard tags.
- For program parameters, a safety parameter cannot be connected with or bound to a standard parameter or controller-scoped tag.

Safety Routines

Safety routines have the same attributes of standard routines, except for the following:


- Safety routines can exist only in safety programs.
- Safety routines cannot read or write standard tags.
- Safety routines can only be done in Ladder Logic.

One safety routine must be designated as the main routine in each safety program. Another safety routine can be designated as the fault routine for that safety program.

Only safety-certified instructions or Add-on Instructions composed from them are used in safety routines. For a list of instructions, see [Safety Instructions on page 88](#).

A watermark visually distinguishes a safety routine from a standard routine.

Figure 31. Safety Routine Watermark

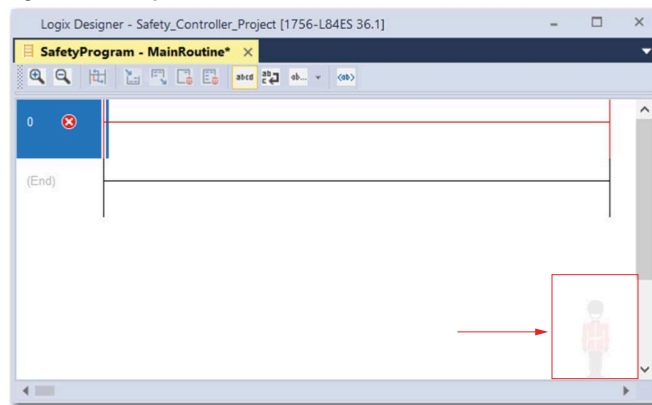

Safety Tags

The controller supports the use of both standard and safety tags in the same project. However, the programming software operationally differentiates standard tags from safety tags.

Safety tags have the same attributes as standard tags with the addition of mechanisms that are certified to provide SIL 2/PLD and SIL 3/PLC data integrity.

When you create a tag, you assign the following properties:

- Name
- Description (optional)
- Tag type
- Data type
- Scope
- Class
- Style
- External Access
- If the tag value is a constant

The Studio 5000 Logix Designer® application helps prevent the direct creation of invalid tags in a safety program. If invalid tags are imported, they cannot be verified.

IMPORTANT: You cannot create a standard alias tag of a safety tag. Instead, standard tags can be mapped to safety tags using safety tag mapping. See [Standard Tags in Safety Routines on page 53](#).

The Logix Designer application can write to safety tags directly via the Tag Monitor when the controller is safety-unlocked, does not have a safety signature, and is operating without safety faults.

The controller does not allow writes to safety tag data from external human machine interface (HMI) devices or via message instructions from peer controllers. HMI devices can have read-only access to safety tags depending on the External Access setting.

Valid Data Types

The data type defines the type of data that the tag stores, such as bit or integer.

Data types can be combined to form structures. A structure provides a unique data type that matches a specific need. Within a structure, each individual data type is called a member. Like

tags, members have a name and data type. You can create your own structures, such as arrays or user-defined data types.

Logix controllers contain predefined data types for use with specific instructions. Safety tags can be composed of the following:

- All primitive data types (for example, BOOL, SINT, INT, DINT, LINT, REAL)
- Predefined types used for safety application instructions
- User-defined data types or arrays that are composed of the two preceding types

Scope

The scope of a tag determines where you can access the tag data. When you create a tag, you define it as a controller tag (global data) or a program tag for a specific safety or standard program (local data).

Safety tags can be controller-scoped or safety program-scoped:

- Controller-scoped safety tags can be read by either standard or safety logic or external communication devices, but can be written by only safety logic or another GuardLogix controller.
- Program-scoped safety tags can be read by external communication devices, but only local safety routines within the safety program can write to them.

When you create program-scoped tags, the class is automatically specified, depending on whether you created the tag in a standard or a safety program. When you create controller-scoped tags, you must manually select the tag class.

When safety tags are controller-scoped, all programs have access to the safety data. Tags must be controller-scoped if they are used in the following ways:

- Multiple programs in the project
- In safety tag mapping
- To produce or consume data

Controller-scoped safety tags can be read, but not written to, by standard routines.

IMPORTANT: Safety input tags and safety consumed tags are readable by any standard routine, but the update rate is based on the execution of the safety task. These tags are updated at the beginning of the safety task execution, which differs from standard tag behavior.

Safety Signature Elements

Safety tags, the safety task, and safety programs are safety signature elements. Each element has a safety signature. The signature changes when its associated element is modified and requires revalidation.

To view the safety signature for a safety tag, the safety task, or a safety program, select the element in the Controller Organizer. The safety signature ID and timestamp appear in the Quick View pane at the bottom of the Controller Organizer.

Figure 32. Safety Signature for Safety Task Element

The screenshot shows the 'Controller Organizer' window with a tree view on the left and a properties table at the bottom. The tree view is expanded to show 'SafetyTask (20 ms)'. A red arrow labeled 'Safety Task' points to this entry. Below the tree view, a table displays the following information:

Type	Periodic
Class	Safety
Safety ID	DCA0ACF6 - 4A899D32 - A9ABCAF3 - C2FFA9C0 - 21B47338 - 855266DE - 8D05D832 - 44DAAE06
Safety Updated	08/23/2023 12:29:41.076 PM

A second red arrow labeled 'Safety Task Signature' points to the 'Safety ID' field in the table.

Standard Tags in Safety Routines (Tag Mapping)

A safety routine cannot directly access standard tags. To allow standard tag data to be used within safety routines and synchronize standard and safety actions, safety controllers provide a safety tag-mapping feature that copies standard tag values into safety task memory.



Mapped tags are copied from the standard tags to their corresponding safety tags at the beginning of the safety task. The copying process can increase the safety task scan time.



Standard task routines can directly read safety tags.

Because a download is required to change tag mapping, mapping a structure of information provides programming standardization and flexibility during commissioning.



Figure 33. Mapped Tag Structure Example

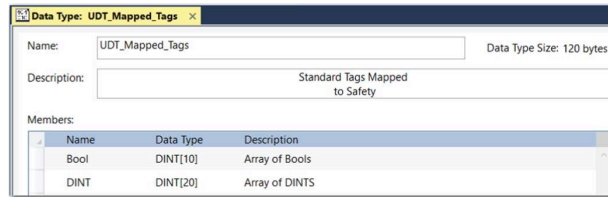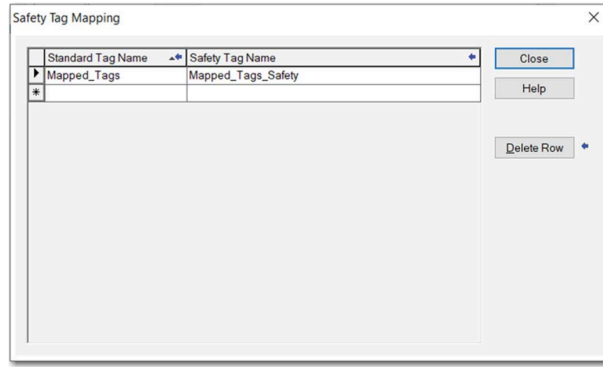

ATTENTION: If you use standard data in a safety routine, you must verify that the data is used in an appropriate manner. Standard data in a safety tag is not safety data. Do not directly control a SIL 2 or SIL 3 safety output by using standard data.

The following example shows how to qualify standard data with safety data.

Figure 34. Qualify Standard Data with Safety Data

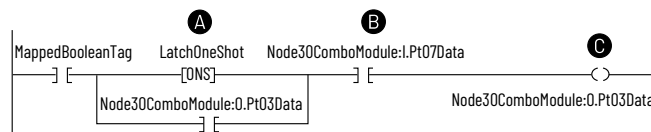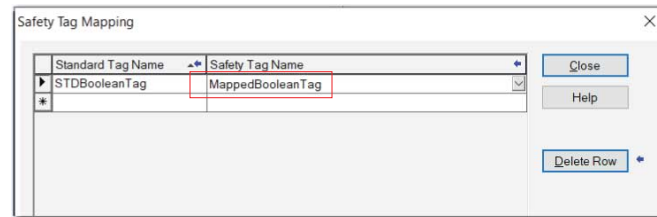

Item	Description
A	Latch circuit to help prevent automatic restart if the standard input (MappedTag) is failed in a 'stuck at 1' state.
B	Safety input qualifier for mapped tag
C	Safety output

Restrictions

Safety tag mapping has these restrictions:

- The safety tag and standard tag pair must be controller-scoped.
- The data types of the safety and standard tag pair must match.
- Alias tags are not allowed.
- Mapping must take place at the whole tag level. For example, myTimer.pre is not allowed if myTimer is a TIMER tag.
- A mapping pair is one standard tag that is mapped to one safety tag.
- You cannot map a standard tag to a safety tag that has been designated as a constant.
- Tag mapping cannot be modified when any of the following are true:
 - The project is safety-locked.
 - A safety signature exists.
 - The keyswitch is in RUN position.
 - A nonrecoverable safety fault exists.
 - An invalid partnership exists between the primary controller and safety partner.




ATTENTION: If you use standard data in a safety routine, you must verify that the data is used in an appropriate manner. Standard data in a safety tag is not safety data. Do not directly control a SIL 2 or SIL 3 safety output by using standard data.

Create Tag Mapping Pairs

1. From the Logic menu, select Map Safety Tags.



2. In the Standard Tag Name or Safety Tag Name column, enter or select an existing tag:
 - To show only controller-scoped standard tags, click the arrow in the Standard Tag Name column.
 - To show only controller-scoped safety tags, click the arrow in the Safety Tag Name column.

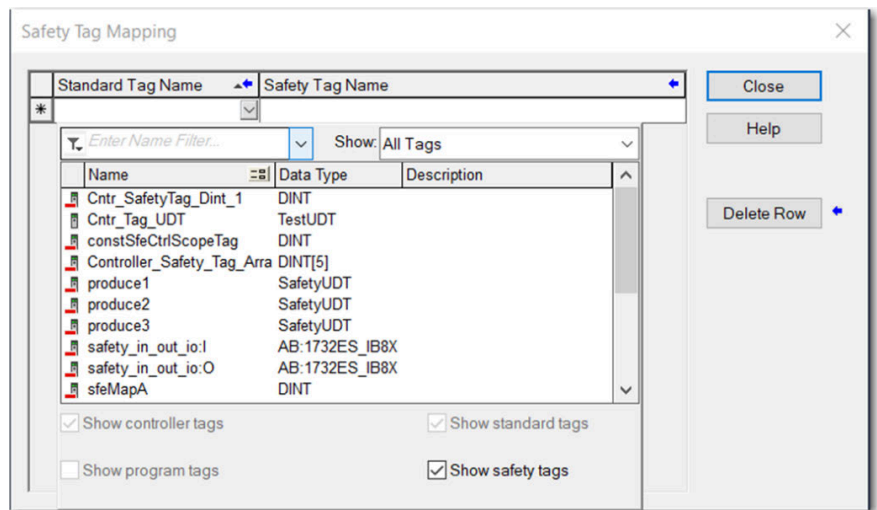

3. In the Standard Tag Name or Safety Tag Name column, add a new tag:
 - a. Right-click in the empty cell.
 - b. Select New Tag.
 - c. Enter the tag name into the field.
4. Right-click the field and select New tagname, where tagname is the text you entered in the field.

Custom Tag Initialization During Prescan

Only safety tags that are configured as constant value tags are captured as part of the safety signature.

IMPORTANT: When you use non-constant safety tag values for a safety critical operation, you must initialize the non-constant safety tags before Run mode.

Give special consideration to instructions that use pseudo-operands, such as the following:

- .PRE value for TON, TOF, RT0, CTD, and CTU
- .LEN value for FAL and FSC

Unless modified by the application, pseudo-operands are initialized only once when the application is downloaded. For details, see the 'Pseudo-operand Initialization' online Help topic. Before the controller is in Run mode, you must initialize the .PRE and .LEN values for the preceding instruction tags and other non-constant safety tags that are used in a safety critical operation. Initialize these values by using one of these methods:

- A first scan subroutine
- An Add-On Instruction prescan routine

For more information about how to perform a custom tag initialization during prescan, see the Logix 5000 Controllers Design Considerations Reference Manual, publication [1756-RM094](#).

You can use the SaveSnapshot routine to copy non-constant safety tag values to the safetyPrescanInitUDT backup, which consists of safety tag types, such as CTU preset, FAL length, TON preset, DINT array, REAL, and BOOL. For example, once the application is downloaded and configured, toggle the saveSnapshot tag to call the SaveSnapshot routine to initialize safetyPrescanInitUDT. Upon subsequent transitions to RUN mode, the prescan routine of safetyPrescanInitAOI reinitializes the non-constant safety tag values from the safetyPrescanInitUDT backup.

Figure 35. Main Routine

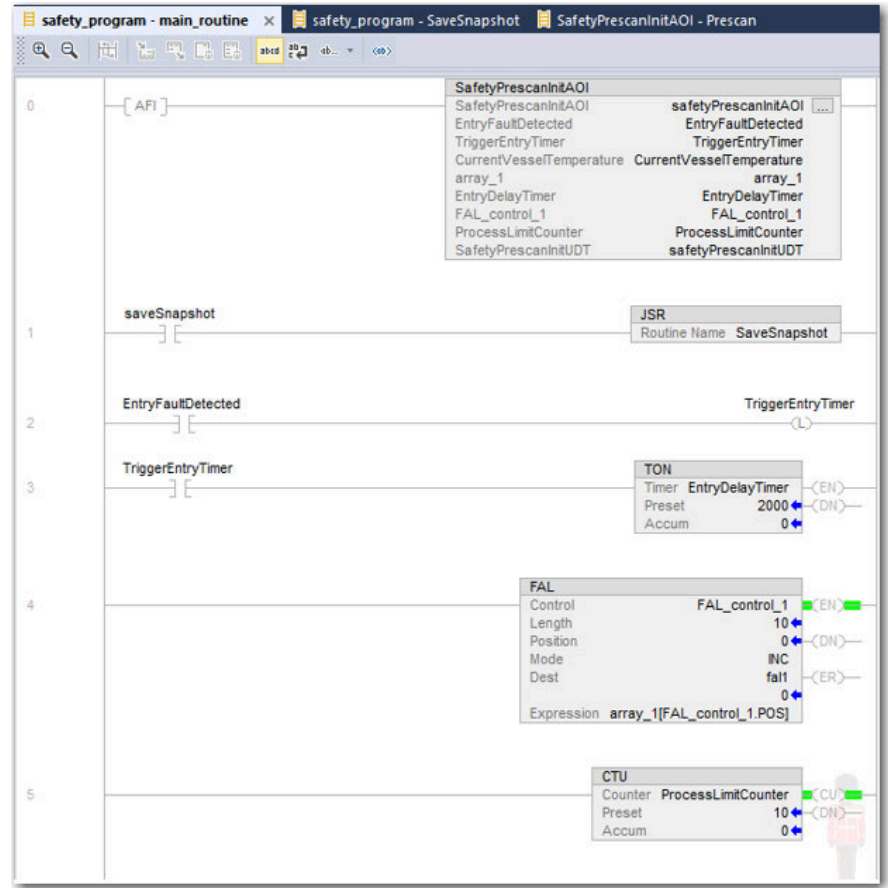


Figure 36. SaveSnapshot Routine


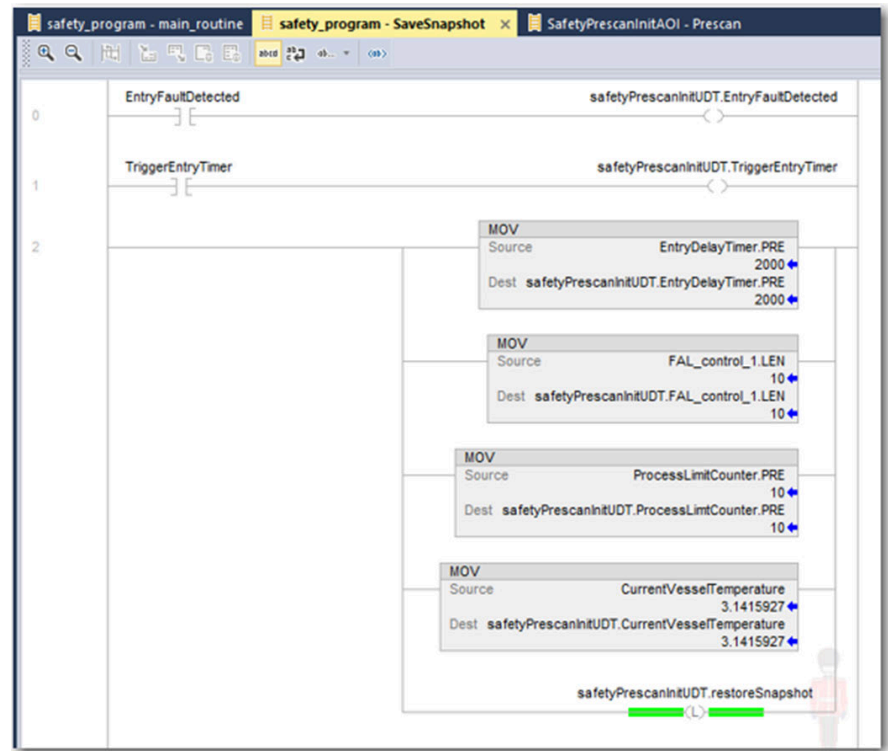


Figure 37. Add-On Instruction Prescan Initialization Routine

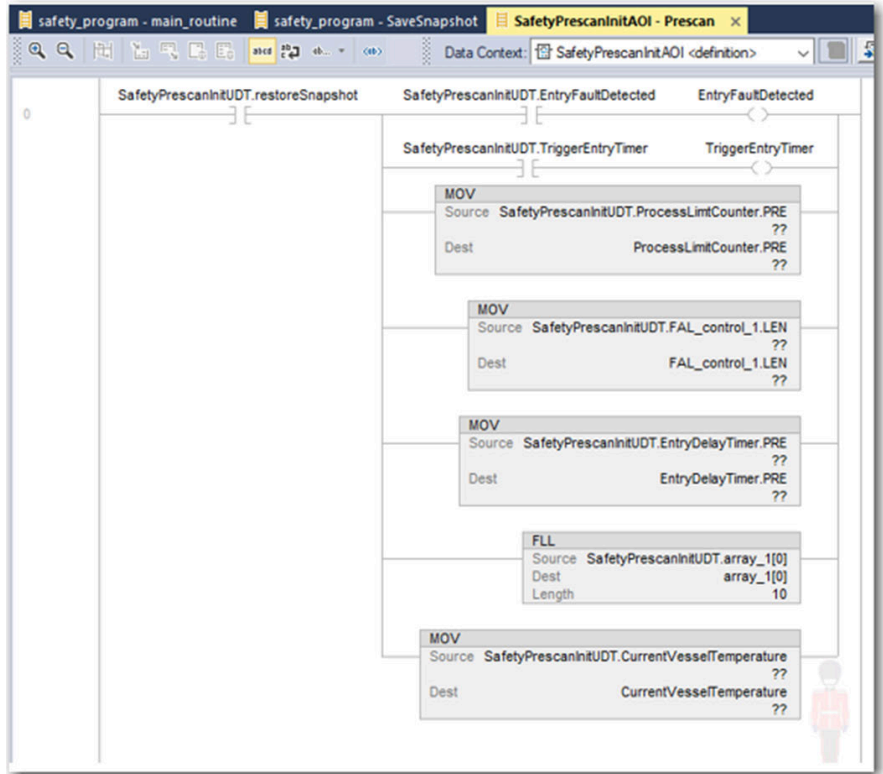

Safety Add-On Instructions


You can create safety Add-On Instructions to be used in safety applications. Safety Add-On Instructions enable you to put commonly used safety logic into one instruction, which makes it modular and easier to reuse. An Add-On Instruction is composed of parameters, local tags, logic routine, and optional scan-mode routines.

Safety Add-On Instructions feature a safety instruction signature for use in safety-related applications up to and including SIL 3-rated applications. The safety instruction signature is an ID number that identifies the execution characteristics of the safety Add-On Instruction. The signature is used to verify the integrity of the safety Add-On Instruction during downloads to the controller.

IMPORTANT: You must initialize safety critical Add-On Instruction tag values in the Add-On Instruction prescan logic.

The following figure shows the steps that are required to create a safety Add-On Instruction and then use that instruction in a safety application program. The shaded items are steps unique to Add-On Instructions.

Figure 38. Safety Add-On Instruction Workflow

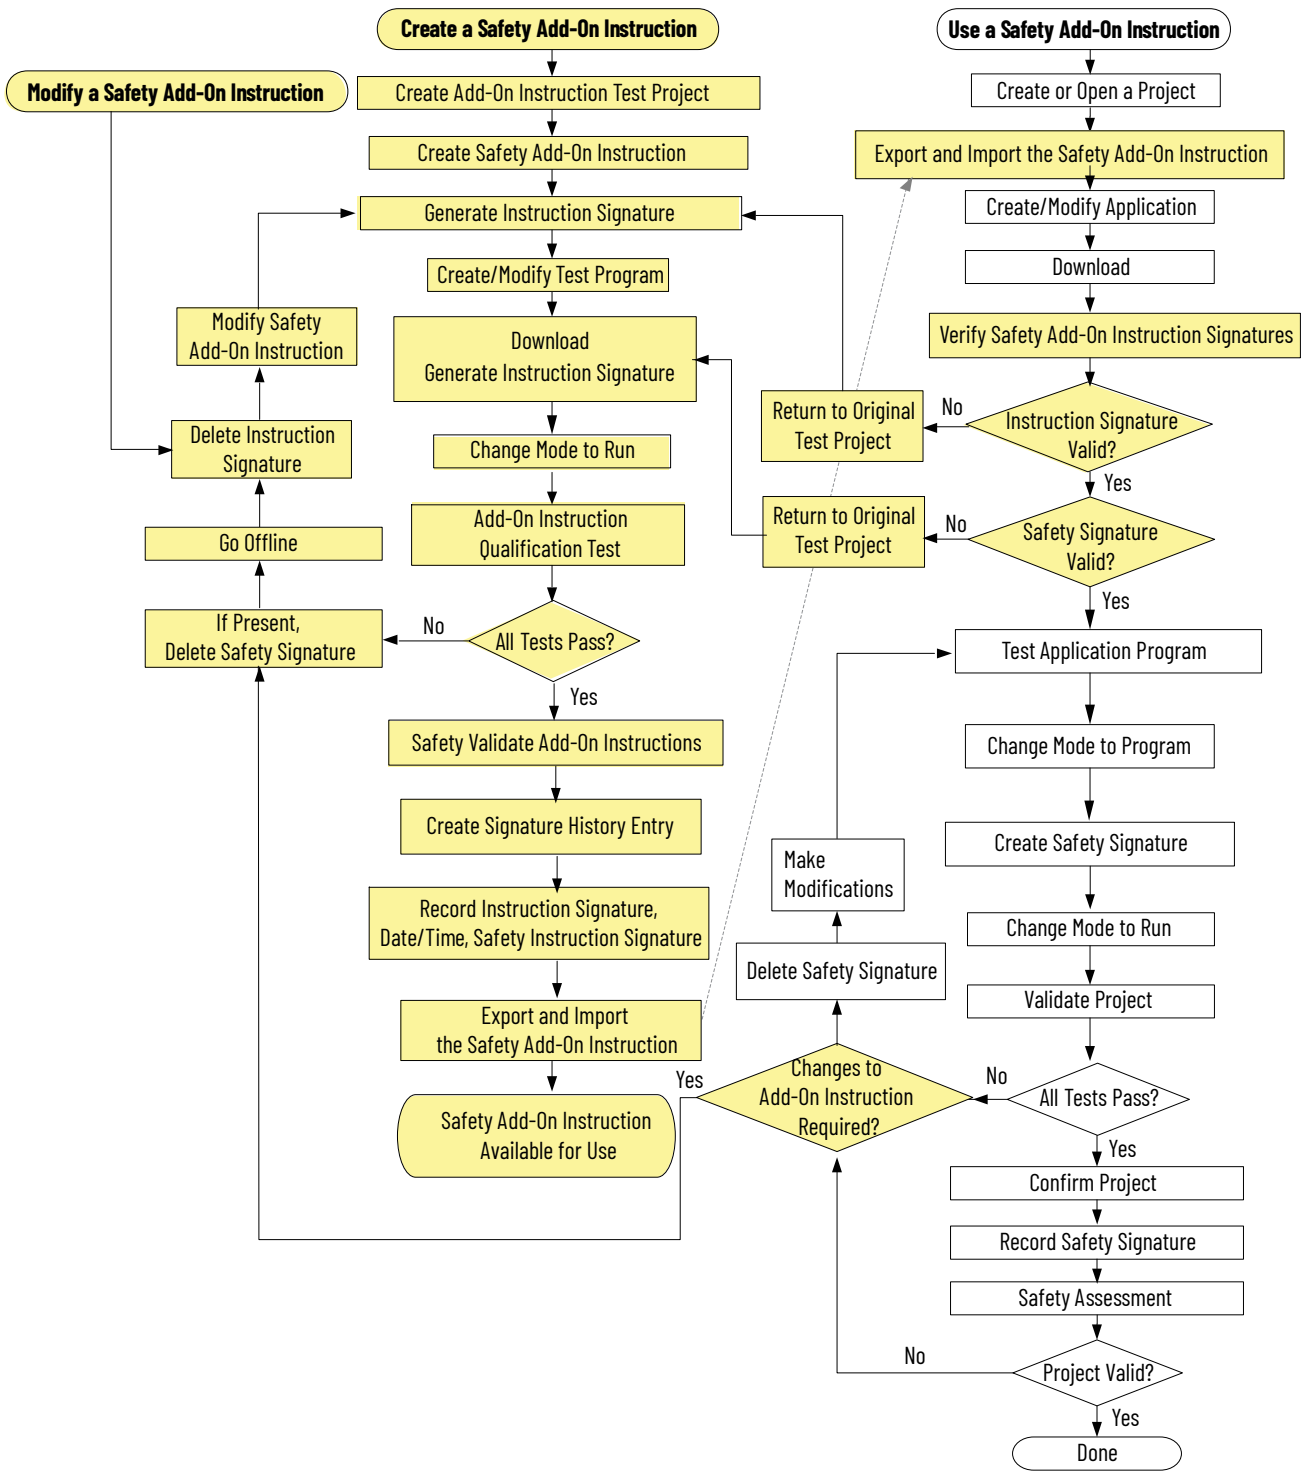

Create an Add-On Instruction Test Project

You must create a unique test project to create and test the safety Add-On Instruction. This project must be a separate and dedicated project to minimize any unexpected influences. Follow the guidelines for projects that are described in [Create the Project on page 67](#).

Create a Safety Add-On Instruction

For guidance in how to create Add-On Instructions, see the Logix 5000 Controllers Add-On Instruction Programming Manual, publication [1756-PM010](#).

Generate the Instruction Signature

The instruction signature consists of an ID number and time stamp that identifies the contents of the Add-On Instruction at a given point in time. The source of the date and time is from the local clock on the computer generating the signature.


The instruction signature enables you to quickly determine if the instruction has been modified. Each Add-On Instruction can have its own signature. The instruction signature is required when an Add-On Instruction is used in safety-related functions, and can sometimes be required for regulated industries. Use it when your application calls for a higher level of integrity.

Once generated, the instruction signature seals the Add-On Instruction, which helps prevent it from being edited while the signature is in place. This restriction includes rung comments, tag descriptions, and any instruction documentation that was created. When the instruction is sealed, you can perform only these actions:

- Copy the instruction signature
- Create or copy a signature history entry
- Create instances of the Add-On Instruction
- Download the instruction
- Remove the instruction signature
- Print reports

When you generate an instruction signature, the Studio 5000 Logix Designer® application displays the instruction definition with the seal icon.

Figure 39. Add-On Instruction Icon



IMPORTANT: If you protect your Add-On Instruction with the source protection feature in the Studio 5000 Logix Designer® application, enable source protection before you generate the instruction signature.

When you generate a safety signature for a controller project, the Quick View Pane and Safety Signature Report show a safety signature element for Add-On Instructions even if the instruction signature is not generated. For more information about safety signature elements, see [Safety Signature on page 16](#).

When a sealed safety Add-On Instruction is downloaded for the first time, a safety instruction signature is automatically generated.

IMPORTANT: Checking or clearing the Report Overflow Faults checkbox in the controller properties changes the safety instruction signature ID for safety Add-On Instructions that include math instructions.

Safety Add-On Instruction Qualification Tests

Safety Add-On Instruction tests must be performed in a separate, dedicated application to verify that unintended influences are minimized. You must follow a well-designed test plan and

perform a unit test of the safety Add-On Instruction that exercises all possible execution paths through the logic, including the valid and invalid ranges of all input parameters.

An independent, third-party review of the safety Add-On Instruction can be required before the instruction is approved for use. An independent, third-party validation may be required for functional safety certification.

Create Signature History Entry

The signature history provides a record for future reference. A signature history entry consists of the instruction signature, the name of the user, the time stamp value, and a user-defined description. Up to six history entries can be stored. You must be offline to create a signature history entry.



The Signature Listing report in the Studio 5000 Logix Designer® application prints the instruction signature, the time stamp, and the safety instruction signature. To print the report, right-click Add-On Instruction in the Controller Organizer and choose Print > Signature Listing.

Export and Import the Safety Add-On Instruction

When you export a safety Add-On Instruction, choose the option to include all referenced Add-On Instructions and user-defined data types in the same export file. By including referenced Add-On Instructions, you make it easier to preserve the signatures. When importing Add-On Instructions, consider these guidelines:

- You cannot import a safety Add-On Instruction into a standard controller project.
- You cannot import a safety Add-On Instruction into a safety controller project that has been safety-locked or one that has a safety signature.
- You cannot import a safety Add-On Instruction while online.
- If you import an Add-On Instruction with an instruction signature into a project where referenced Add-On Instructions or user-defined data types are not available, you may need to remove the signature.

For more information, see the Import/Export Project Components Programming Manual, publication [1756-PM019](#).

Qualification and Verification

After you download the application project that contains the imported safety Add-On Instruction, you must compare the instruction signature value, the date and time stamp, and the safety instruction signature values with the original values you recorded before you exported the safety Add-On Instruction. If they match, the safety Add-On Instruction is valid and you can continue with the validation of your application.

Next, test the application program. This step consists of any combination of Run and Program mode, online or offline program edits, upload and download, and informal testing that is required to get an application to run properly.

To validate the project, perform an engineering test of the application, including the safety system. For more information about requirements, see [Validate the Project on page 69](#).

An independent, third-party review of the safety system can be required before the system is approved for operation. An independent, third-party validation may be required for functional safety certification. For more information about safety assessments, see the Machinery SafeBook 5 Reference Manual, publication [SAFEBK-RM002](#).

Safety Applications

The safety concept assumes the following requirements:

- You are responsible to create, operate, and maintain the safety application.
- You are fully qualified, specially trained, and experienced in safety systems.
- You apply the logic correctly to detect programming errors through strict adherence to specifications, programming, and naming rules.
- You perform a critical analysis of the application and use all possible measures to detect a failure.
- You confirm all application downloads via a manual check of the safety signature.
- You perform a complete functional test of the entire system before the operational startup of a safety-related system. This test includes, but is not limited to, the following:
 - Validate that the overall functionality of the implemented safety functions, including I/O configuration via Add-On Profiles, beyond the limits of the individual devices (boundary testing).
 - Verify that the correct versions of software are used.

Table 6. Effect of Controller Modes on Safety Execution

Controller Mode	Controller Safety Execution
Program	<ul style="list-style-type: none"> • Safety input and output connections are established and maintained. Safety input tags are updated to reflect safety input values. • Safety mapped tags are updated to reflect the standard controller tag values. • Safety task logic is not being scanned.
Test	<ul style="list-style-type: none"> • Safety input and output connections are established and maintained. Safety input tags are updated to reflect safety input values. • Safety mapped tags are updated to reflect the standard controller tag values. • Safety task logic is being scanned.
Run	<ul style="list-style-type: none"> • Safety input and output connections are established and maintained: <ul style="list-style-type: none"> - Safety input tags are updated to reflect safety input values. - The controller sends 'run' safety output packets. • Safety mapped tags are updated to reflect the standard controller tag values. • Safety task logic is being scanned. • All safety task process logic, cross-compare logic outputs. Logic outputs are written to safety outputs.

Table 7. Safety Application Status

Safety Task Status	Safety Rating ² (Up to and Including)	Controller Behavior
Unlocked no signature	Only for development purposes	<ul style="list-style-type: none"> • Safety I/O forces can be present. • Safety I/O forces can be modified. • Safety online editing is allowed. • Safety memory is isolated, but is unprotected (read/write). • Download allowed if a major firmware revision of the offline project matches the target controller.
Locked no signature	Only for development purposes	<ul style="list-style-type: none"> • Safety I/O forces are not allowed. Forces of safety I/O must be removed before locking is possible. • Online editing of the safety task is not allowed. • Safety memory is protected (read-only). • Download is not allowed.
Unlocked with signature	SIL 2/SIL 3 (per controller)	<ul style="list-style-type: none"> • Safety I/O forces are not allowed. Forces of safety I/O must be removed before locking is possible. • Online editing of the safety task is not allowed. • Safety memory is protected (read-only). • Safety signature is unprotected and anyone who has access to the controller can delete it. • Download allowed if a major firmware revision of the offline project matches the target controller.
Locked with signature	SIL 2/SIL 3 (per controller)	<ul style="list-style-type: none"> • Safety I/O forces are not allowed. • Online editing of the safety task is not allowed. • Safety memory is protected (read-only). • Safety signature is protected. You must enter the unlock password to unlock the controller before you can delete the safety signature. • Download is allowed if the major and minor firmware revision and signature of the offline project match the target controller, the project is safety-locked, and the safety task status of the controller is OK. <hr/> <p>IMPORTANT: If the controller is safety-locked and the safety-unlock password is lost and a download is needed, you must perform a Stage 1 reset of the controller.</p>

Application Development and Testing

We recommend that a user who is trained and experienced in safety applications develop the application program for the intended SIL 2 or SIL 3 system. The developer must follow good design practices:

- Use functional specifications, including flowcharts, timing diagrams, and sequence charts.
- Perform a review of safety task logic.
- Perform application validation.

As you develop your safety application, consider the following.

2. To achieve this level, you must adhere to the safety requirements defined in this safety reference documentation.

IMPORTANT:

- The programming application has been certified to clause 7.4.4 of IEC 61508-3 Edition 2 and can be used during the coding lifecycle of controller-based applications and also as an aide in the module test, integration test, and validation test lifecycle phases. As a result, no additional justification for its use during those lifecycle phases is required. If, however, other tools are used, either on their own or with the application, additional justification for those other tools are required. It is your responsibility to verify that other offline tools that are used during all lifecycle phases are selected as a coherent part of the software development activities.
 - It is your responsibility to conduct an assessment to determine the level of reliance that is placed on the programming application and the potential failure mechanisms that can affect the executable software when the application is used in a manner other than what is specified in the product documentation.
 - You must verify that all programming and configuration information that is entered into the programming application, and downloaded to the controller, meets the requirements for your application. See [Confirm the Project on page 70](#).
 - As required by the safety integrity level, the software or design representation must match the characteristics of the application.
 - As required by the safety integrity level, the software or design representation must be compatible with the features that are supported in the programming application and controllers. It is your responsibility to verify that the desired software and design representation are supported in the application and controllers. For example, if the design is represented in a flowchart format, it is your responsibility to convert that design to a ladder diagram.
 - Use of third-party, or internally developed, tools to generate logic automatically to import into the programming application for compilation and download to a controller requires assessment of its suitability at the point in the development cycle where it is selected.
-


Commissioning Lifecycle

The flowchart shows the steps that are required for commissioning a safety system.

An independent, third-party safety assessment can be required before the system is approved for operation. An independent, third-party certification can be required for IEC 61508 SIL 2 or SIL 3 levels.

IMPORTANT: To achieve IEC-62443-4-2 SL 1 security certification, you must enable CIP Security™ before you download a safety application to the controller.

Figure 40. Commission a Safety System

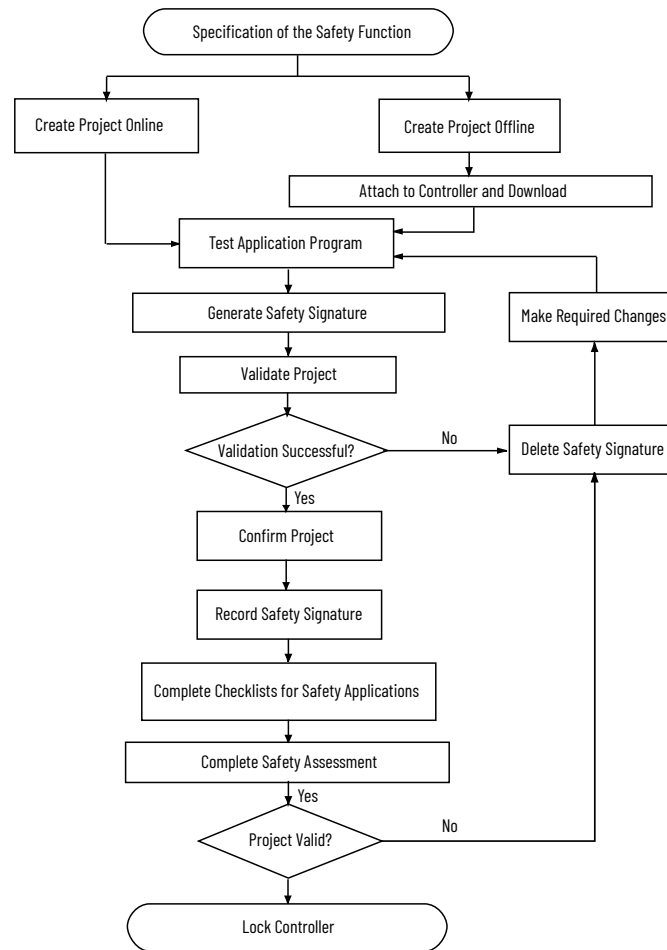

Specification of the Safety Function

You must create a specification for your safety function. Use this specification to verify that program logic correctly and fully addresses the functional and safety control requirements of your application. In some applications, the specification can be presented in various formats. However, the specification must be a detailed description that includes the following (if applicable):

- Sequence of operations
- Flow and timing diagrams
- Sequence charts
- Program description
- Program printout
- Written descriptions of the steps with step conditions and actuators to be controlled, which includes the following:
 - Input definitions
 - Output definitions
 - I/O wiring diagrams and references
 - Theory of operation
- Matrix or table of stepped conditions and the actuators to be controlled, including the sequence and timing diagrams
- Definition of marginal conditions, for example, operating modes and emergency stop

The I/O portion of the specification must contain the analysis of field circuits:

- Sensors (digital or analog)
 - Signal in standard operation (dormant current principle for digital sensors, sensors OFF means no signal)
 - Determination of redundancies that are required for SIL levels
 - Discrepancy monitoring and visualization, including your diagnostic logic
- Actuators
 - Position and activation in standard operation (normally ON)
 - Safe reaction/positioning when switching OFF or power failure
 - Discrepancy monitoring and visualization, including your diagnostic logic

Create the Project

The logic and instructions that are used in programming the application must be the following:

- Easy to understand
- Easy to trace
- Easy to change
- Easy to test

Review and test all logic. Keep safety-related logic and standard logic separate.

Use these labels to identify the application program clearly:

- Name
- Date
- Revision
- Any other useful identification

Test the Application Program

This step consists of any combination of Run and Program modes, online or offline edits, upload and download, and informal testing that is required to get an application to run properly in preparation for the Project Validation test.

Generate the Safety Signature

The safety signature is composed of a safety signature ID and a time stamp. The safety signature ID applies to the entire safety portion of the controller and uniquely identifies each project, including its logic, constant data, and configuration.



ATTENTION: The safety signature is required for the controller to operate at a SIL 2 or SIL 3 rating. Controller operation without a safety signature is only suitable during development.

Before you generate the safety signature, make sure the following requirements are met:

- Your programming tests are complete, but verification testing has not begun.
- The programming software is online with the controller.
- With firmware revision 37 or earlier, the controller must be in Program/Remote Program mode. With firmware revision 38 or later, the controller can be in Remote Run, Program/Remote Program, or Remote Test mode.



ATTENTION: When the controller is in Program mode, outputs are commanded to their Program mode state, which can cause a dangerous situation.

- The controller is safety-unlocked.
- The controller has no safety forces or pending online safety edits.
- If a constant safety tag value was changed online, the project must be saved with an upload of the online tag values.
- The safety task status is OK.

IMPORTANT:

When the safety application has been validated, there can be scenarios that require a redownload even though the safety application has not changed. For example, you make changes to the standard application, but not the safety application.


To verify that the correct safety application is downloaded, manually record the safety signature after initial creation and check the safety signature after every download to make sure that it matches the original sign.

You can generate the safety signature in three ways:

- From the Safety tab of the Controller Properties dialog box, click Generate, as shown in the figure below.
- From the Tools menu, select Safety > Generate Signature.
- From the Safety Status menu, select Generate Signature.


The programming application automatically uploads the safety signature after it is generated.

Figure 41. Generate Safety Signature

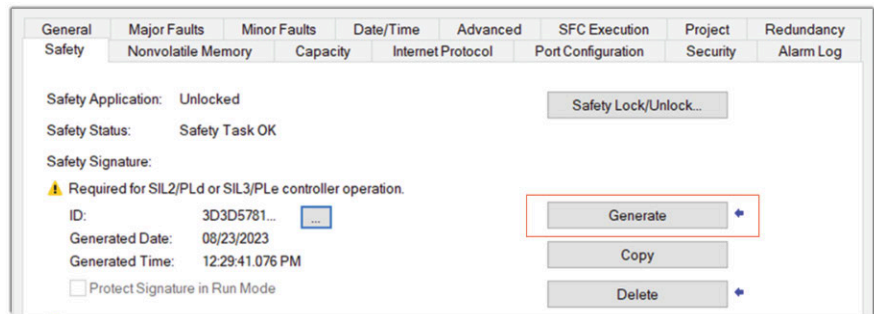

To view and copy the entire 64-character signature ID, click the Ellipse button next to the ID to open the Safety Signature ID dialog box.

Figure 42. Safety Signature ID

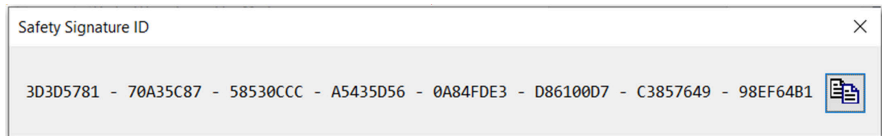

Safety signature creation and deletion are logged in the controller log. For more information on accessing the controller log, refer to Logix 5000 Controllers Information and Status Programming Manual, publication [1756-PM015](#).

When a safety signature exists, the following actions are not permitted in the safety portion of the application:

- Online/offline programming or editing, including safety Add-On Instructions
- Force safety I/O
- Change the inhibit state of safety I/O or producer controllers

- Safety data manipulation, except by safety routine logic
- Download a new safety application

You can update the firmware when a safety signature exists by using the Redundancy System Update (RSU) process.

Copy the Safety Signature

You can use the Copy button to create a record of the safety signature for use in safety project documentation, comparison, and validation. When you click Copy, the safety signature ID, date, and time components are saved to the Windows® clipboard.

Delete the Safety Signature

**ATTENTION:**

When you delete the safety signature, all safety functions are impacted and require additional safety measures while the safety signature is removed.

After you delete the safety signature, you must retest and revalidate your system at some level to meet SIL 2/PLd or SIL 3/PLe.

To delete the safety signature, click Delete. The safety signature cannot be deleted when the following is true:

- The controller is safety-locked.
- The controller is in Run mode with the switch set to RUN.
- The controller is in Run or Remote Run mode with Protect Signature in Run Mode enabled.

Validate the Project

To check your application program for adherence to the specification, you must generate a suitable set of test cases that cover the application. The set of test cases must be filed and retained as the test specification. To determine what to validate for your specific application, refer to IEC 61508 or your industry-specific safety standard.

You must include a set of tests to prove the validity of the formula calculations used in your application logic. Equivalent range tests are acceptable. These are tests within the defined value ranges, at the limits, or in invalid value ranges. The necessary number of test cases depends on the formulas that are used and must comprise critical value pairs.

Active simulation with sources, such as field devices, must also be included, as it is the only way to verify that the sensors and actuators in the system are wired correctly. Verify the operation of programmed functions by manipulating sensors and actuators manually.

You must also include tests to verify the reaction to wiring faults and network communication faults.

Project validation includes tests of fault routines, and input and output channels, to be sure that the safety system operates properly.

To perform a project validation test on the controller, you must perform a full test of your application. You must toggle each sensor and actuator that is involved in every safety function. Be sure to test all shutdown functions, because these functions are not typically exercised during normal operation.

Also, know that a project validation test is valid only for the specific application tested. If the safety application is moved to another installation, you must perform startup and project

validation on the safety application in the context of the new sensors, actuators, wiring, networks, and control system physical equipment.

Revalidation Considerations

The IEC 61508 functional safety standard requires an impact analysis before you upgrade or modify components in a certified, functional safety system. Reference the standard to make sure that you fulfill all requirements as they relate to your application. Consider the following high-level information for impact analysis of safety controller software, hardware, and firmware modification:

- All major and minor firmware releases for safety controller systems are certified for use in safety applications. As part of the certification process, Rockwell Automation tests the safety-related firmware functions, such as the CIP Safety™ communication subsystems, which are embedded safety instruction execution, and safety-related diagnostic functions. The firmware release notes identify changes to safety-related functions.
- Perform an impact analysis of the planned modifications.
 - Review the firmware release notes for changes in safety-related functionality.
 - Review the hardware and firmware compatibility in the Product Compatibility and Download Center (PCDC) to identify potential compatibility conflicts.
 - Plan, analyze, and document the impact of any modification, enhancement, or adaptation of your validated safety system.
 - As part of the upgrade process, remove and regenerate the safety signature.
- Based on the results of the safety impact analysis, choose the appropriate level of hardware and software revalidation. Use the Safety Signature report to determine which safety elements have been modified and require revalidation. If your validation plan does not require revalidation of unchanged elements, your certification effort can be reduced.

Confirm the Project

You must print or view the project, and compare the uploaded safety I/O and controller configurations, safety data, and safety task program logic to make sure that the correct safety components were downloaded, tested, and retained in the safety application program.

If your application program contains a safety Add-On Instruction that has been sealed with an instruction signature, you must also compare the instruction signature, date/time, and safety instruction signature to the values you recorded when you sealed the Add-On Instruction.

The following steps illustrate one method for confirming the project.

1. While online with the controller, save the project.
2. Answer Yes to the Upload Tag Values prompt.
3. With the Studio 5000 Logix Designer® application offline, save the project with a new name, such as Offlineprojectname.acd, where 'projectname' is the name of your project.
This file is the new tested primary project file.
4. Close the project.
5. Move the original project archive file out of its current directory.
You can delete this file or store it in an archival location.
This step is required because if the Studio 5000 Logix Designer® application finds the projectname.acd in this directory, it correlates it with the controller project and does not perform an upload.
6. Upload the project from the controller.

7. Save the uploaded project as Onlineprojectname.acd, where 'projectname' is the name of your project.
8. Answer Yes to the Upload Tag Values prompt.
9. Use the Studio 5000 Logix Designer® Program Compare utility to perform these comparisons:
 - a. Compare all properties of the controller and CIP Safety™ I/O devices.
 - b. Compare all properties of the safety task, safety programs, and safety routines.
 - c. Compare all logic in the safety routines.
10. Verify that all controller and I/O configuration fulfills the requirements of your application specification.

Lock the Controller



ATTENTION: Safety-locking alone does not satisfy SIL 2/PLd or SIL 3/PLe requirements.

The default state of the controller is safety-unlocked. We recommend that you safety-lock the controller to help protect safety control components from modification and help prevent the safety signature from being deleted accidentally. However, safety-locking the controller is not a requirement for SIL 2 or SIL 3.

The safety-lock feature applies only to safety components, such as the safety task, safety programs, safety routines, safety tags, safety Add-On Instructions, safety I/O, and safety signature.

No aspect of safety can be modified while the controller is in the safety-locked state. When the controller is safety-locked, the following actions are not permitted in the safety task:

- Update the firmware without using the Redundancy System Update (RSU) process
- Online or offline programming or editing
- Forcing safety I/O
- Data manipulation of safety components except through routine logic or another controller
- Creating or editing safety Add-On Instructions
- Generating or deleting the safety signature


IMPORTANT: If a safety signature exists and the controller is safety-locked, only projects with a matching safety signature can be downloaded to the controller.

You can place the safety application in a safety-locked state regardless of whether you are online, offline, or you have the original program source. However, no safety forces or pending safety edits can be present. Safety-locked or -unlocked status cannot be modified when the keyswitch is in the RUN position.

Safety-lock and safety-unlock actions are logged in the controller log. For more information on accessing the controller log, see the Logix 5000 Controllers Information and Status Programming Manual, publication [1756-PM015](#).

You can safety-lock and -unlock the controller from the Safety tab of the Controller Properties dialog box. In the Logix Designer application, you can also select Tools > Safety > Safety Lock/Unlock.


Figure 43. Safety Lock/Unlock Button

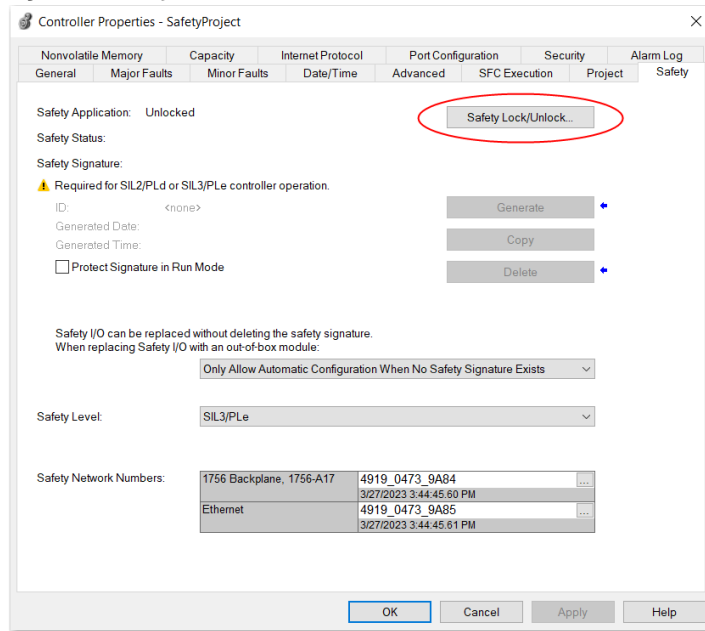

Restrict Access to Safety-lock and Safety-unlock Functionality


To provide additional layers of protection, you can use two methods to restrict access to safety-lock and safety-unlock functionality:

- **FactoryTalk Security**—To comply with IEC-62443-4-2 SL 1 security certification, you must use FactoryTalk Security to configure restricted access to safety-lock and safety-unlock actions. For information about setting these permissions, see the Configure System Security Features User Manual, publication [SECURE-UM001](#).

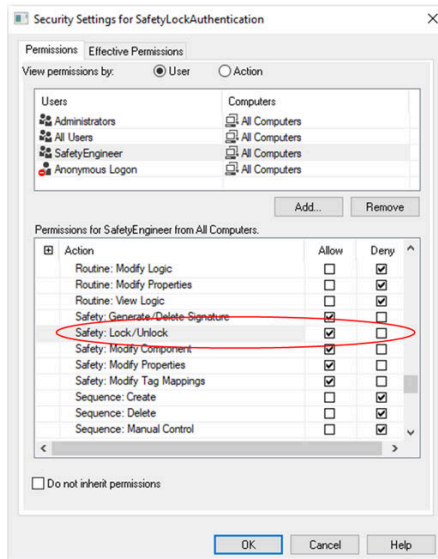

- **Safety passwords**—You can set separate passwords that are required to safety-lock or safety-unlock the controller. Passwords are optional and not required for IEC-62443-4-2


SL 1 security certification. For security certification requirements, see the GuardLogix and Compact GuardLogix User Manual, publication [1756-UM543](#).

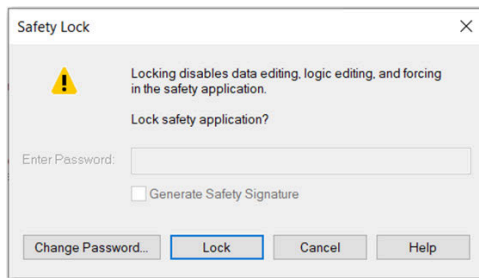

IMPORTANT: For added security, enable CIP Security on the controller before you set password protection. For non-redundant controllers, we recommend that you enable CIP Security on the front Ethernet port of the controller. For more information about CIP Security, see CIP Security with Rockwell Automation Products, publication [SECURE-AT001](#).

To set password protection for safety-lock or safety-unlock actions, follow these steps.

1. On the Logix Designer menu bar, click Tools > Safety > Change Passwords.
2. In the What Password field, select Safety Lock or Safety Unlock.

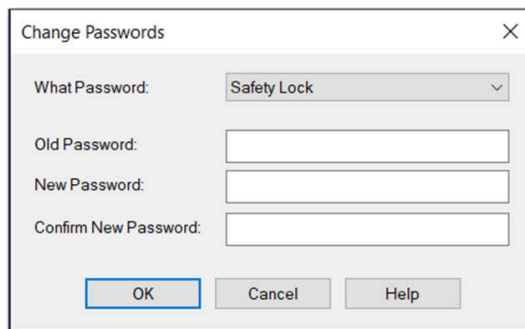

3. Enter the old password, if one exists.
4. Enter and confirm the new password.
5. Click OK.



Passwords can be from 1..40 characters in length and are not case-sensitive. Letters, numerals, and the following symbols can be used: '~!@#\$%^&*()_+,-={}[] \ ; ? / . To clear an existing password, enter a new password of zero length.

IMPORTANT: Rockwell Automation does not provide any form of password or security override services. When products and passwords are configured, Rockwell Automation encourages customers to follow good security practices and to plan accordingly for password management.

Download/Upload a Safety Application Program

Upon download, application testing is required unless a safety signature exists.

IMPORTANT: To verify that the correct safety application is downloaded or restored from a memory card, you must manually check that the safety signature matches the original signature in your safety documentation.

Downloads to a safety-locked controller are allowed only if the safety signature and the firmware revision of the offline project all match what is contained in the target controller and the safety task status of the controller is OK.

IMPORTANT: If the safety signature does not match and the controller is safety-locked, you must unlock the controller to download. In this case, downloading to the controller deletes the safety signature. As a result, you must revalidate the application.

IMPORTANT: To avoid project download failure, do not change the communication adapter name of a chassis containing safety I/O while the safety application has a safety signature.

If the controller contains a safety signature, the safety signature is uploaded in an online save of the project. The option to upload tag values includes both standard and safety tag values.

Store and Load a Project from a Memory Card

Safety controllers support firmware updates and user program storage and retrieval with a memory card. In a GuardLogix® system, only the primary controller uses a memory card.

When you store a safety project on a memory card, we recommend that you select Remote Program as the Load mode. The Load mode specifies the mode that the controller enters after a project load. Before system operation, operator intervention is required to start the controller.

You can initiate a load from a memory card only under these conditions:

- If the controller type specified by the project that is stored on the memory card matches your controller type.
- If the major and minor revisions of the project on the memory card match the major and minor revisions of your controller.

IMPORTANT: A revision mismatch helps prevent only user-initiated loads. Controller-initiated loads overwrite the firmware on the controller with the contents of the memory card.

- If your controller is not in Run mode.

Loading a project to a safety-locked controller is allowed only when the safety signature of the project that is stored on the memory card matches the project on the controller. If the signatures do not match or the controller is safety-locked without a safety signature, you must first unlock the controller before attempting to update the controller via a memory card.

IMPORTANT: If you unlock the controller and initiate a load from the memory card, the safety-lock status, passwords, and safety signature are then set to the values contained on the memory card once the load is complete.

Force Data

All data that is contained in an I/O, produced, or consumed safety tag, including CONNECTION_STATUS, can be forced while the project is safety-unlocked and no safety signature exists. However, forces must be removed, not just disabled, on all safety tags before the safety project can be safety-locked or a safety signature can be generated. You cannot force safety tags while the project is safety-locked or when a safety signature exists.



You can install and remove forces on standard tags regardless of the safety-locked or safety-unlocked state.

Inhibit a Device

You cannot inhibit or uninhibit safety I/O devices or producer controllers under these conditions:

- The application program is safety-locked
- A safety signature exists


Anytime necessary, you can programmatically inhibit and uninhibit with SSV from the standard task:

- Class Name: Module
- Attribute Name: Mode
- Source: Inhibit = 4; Uninhibit = 0

To inhibit a device, follow these steps.

1. Select the device and then select Properties.
2. In the navigation pane, select Connection.
3. On the Connection view, select Inhibit Module and click Apply.

The device is inhibited when the Inhibit Module checkbox is selected. If a communication device is inhibited, all downstream devices are also inhibited.

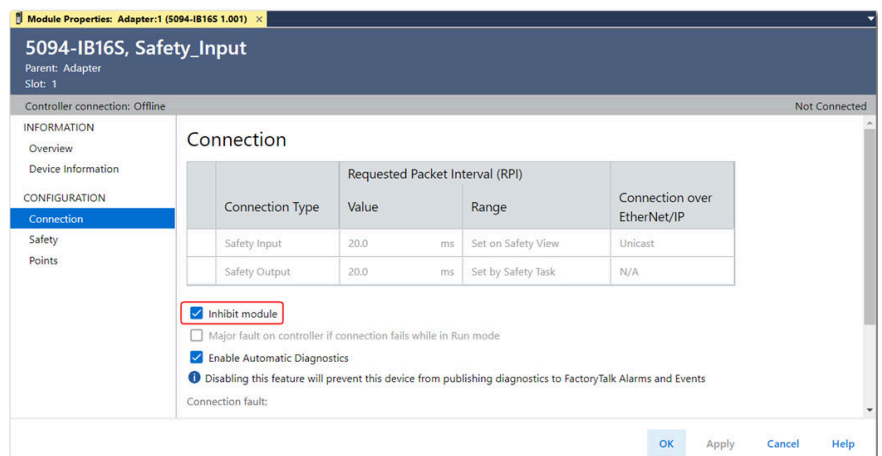

Edit a Safety Application

The following rules apply to changing your safety application program:

- Only authorized, specially trained personnel can make program edits. These personnel must use all supervisory methods available, for example, using the controller switch and software password protections.
- When authorized, specially trained personnel make program edits, they assume the central safety responsibility while the changes are in progress. These personnel must also maintain safe application operation.
- When you edit online, you must use an alternate protection mechanism to maintain the safety of the system.
- You must sufficiently document all program edits, which include the following:
 - Authorization
 - Impact analysis
 - Execution

- Test information
- Revision information
- If online edits exist only in the standard routines, those edits are not required to be validated before returning to normal operation.
- You must make sure that changes to the standard routine, regarding timing and tag mapping, are acceptable to your safety application.
- You can edit the logic portion of your program while offline or online, as described in the following sections.

Offline Edits

When you make offline edits to only standard program elements and the safety signature matches following a download, you can resume operation.

When you make offline edits to the safety program, you must revalidate all affected elements of the application, as determined by the impact analysis, before you resume operation.

Online Edits



ATTENTION: Performing online edits to logic, data, or the configuration can affect the safety functions of the system if the edits are performed while the application is running. Online edits should only be done if necessary. If the edits are not performed correctly, they can stop the application. You must use alternative safety measures and constraints during online edits.

Online edits in standard routines are unaffected by the safety-locked or safety-unlocked state.

The following requirements apply to online edits of safety logic:

- The controller must be safety-unlocked and unsigned. If the controller is locked with safety edits, you must unlock the controller to assemble or cancel the edits.
You assemble edits to make online edits permanently change the controller program.
You cancel edits to reject and delete any unassembled online edits.
- For safety routines, the controller cannot be locked when there is a pending edit, but it can be locked when there is a test edit.
A pending edit is a change to a routine that has been made in the Studio 5000 Logix Designer[®] application, but has not yet been communicated to the controller by accepting the edit.

A test edit is an online edit that has been accepted and causes the controller to execute the new, edited version of logic. The original, unedited version of logic is still in controller memory, but is not executed.

IMPORTANT: When you change certain configuration operands of a safety instruction, you must transition the controller to Program mode and back to Run mode before the changes take effect. For affected operands, see the Logix 5000[®] Controller Safety Application Instruction Set Reference Manual, publication [1756-RM095](#).

You cannot edit standard or safety Add-On Instructions when the controller is online.

When you make online edits to the safety program, you must revalidate all affected elements of the application, as determined by the impact analysis, before you resume operation.

Limit online edits to minor program modifications, such as setpoint changes or minor logic additions, deletions, and modifications.

The safety-lock and safety signature features of the controller affect online edits. For more information, see [Lock the Controller on page 71](#) and [Generate the Safety Signature on page 67](#).

Modification Impact Test


Any modification, enhancement, or adaptation of your validated software must be planned and analyzed for any impact to the functional safety system. All appropriate phases of the software safety lifecycle must be conducted as indicated by the impact analysis. If your validation plan requires cold start or warm start testing of the modification, this can be achieved by transitioning from Program mode to Run mode. Special attention should be paid to the impact of the modification on safety task initialization as described in [Custom Tag Initialization During Prescan on page 56](#).

At a minimum, you must perform these actions:

- Perform functional tests of all impacted software.
- Document all modifications to your software specifications.
- Document all test results.

For detailed information, see IEC 61508-3, Section 7.8 Software Modification.

Figure 44. Online and Offline Edit Process

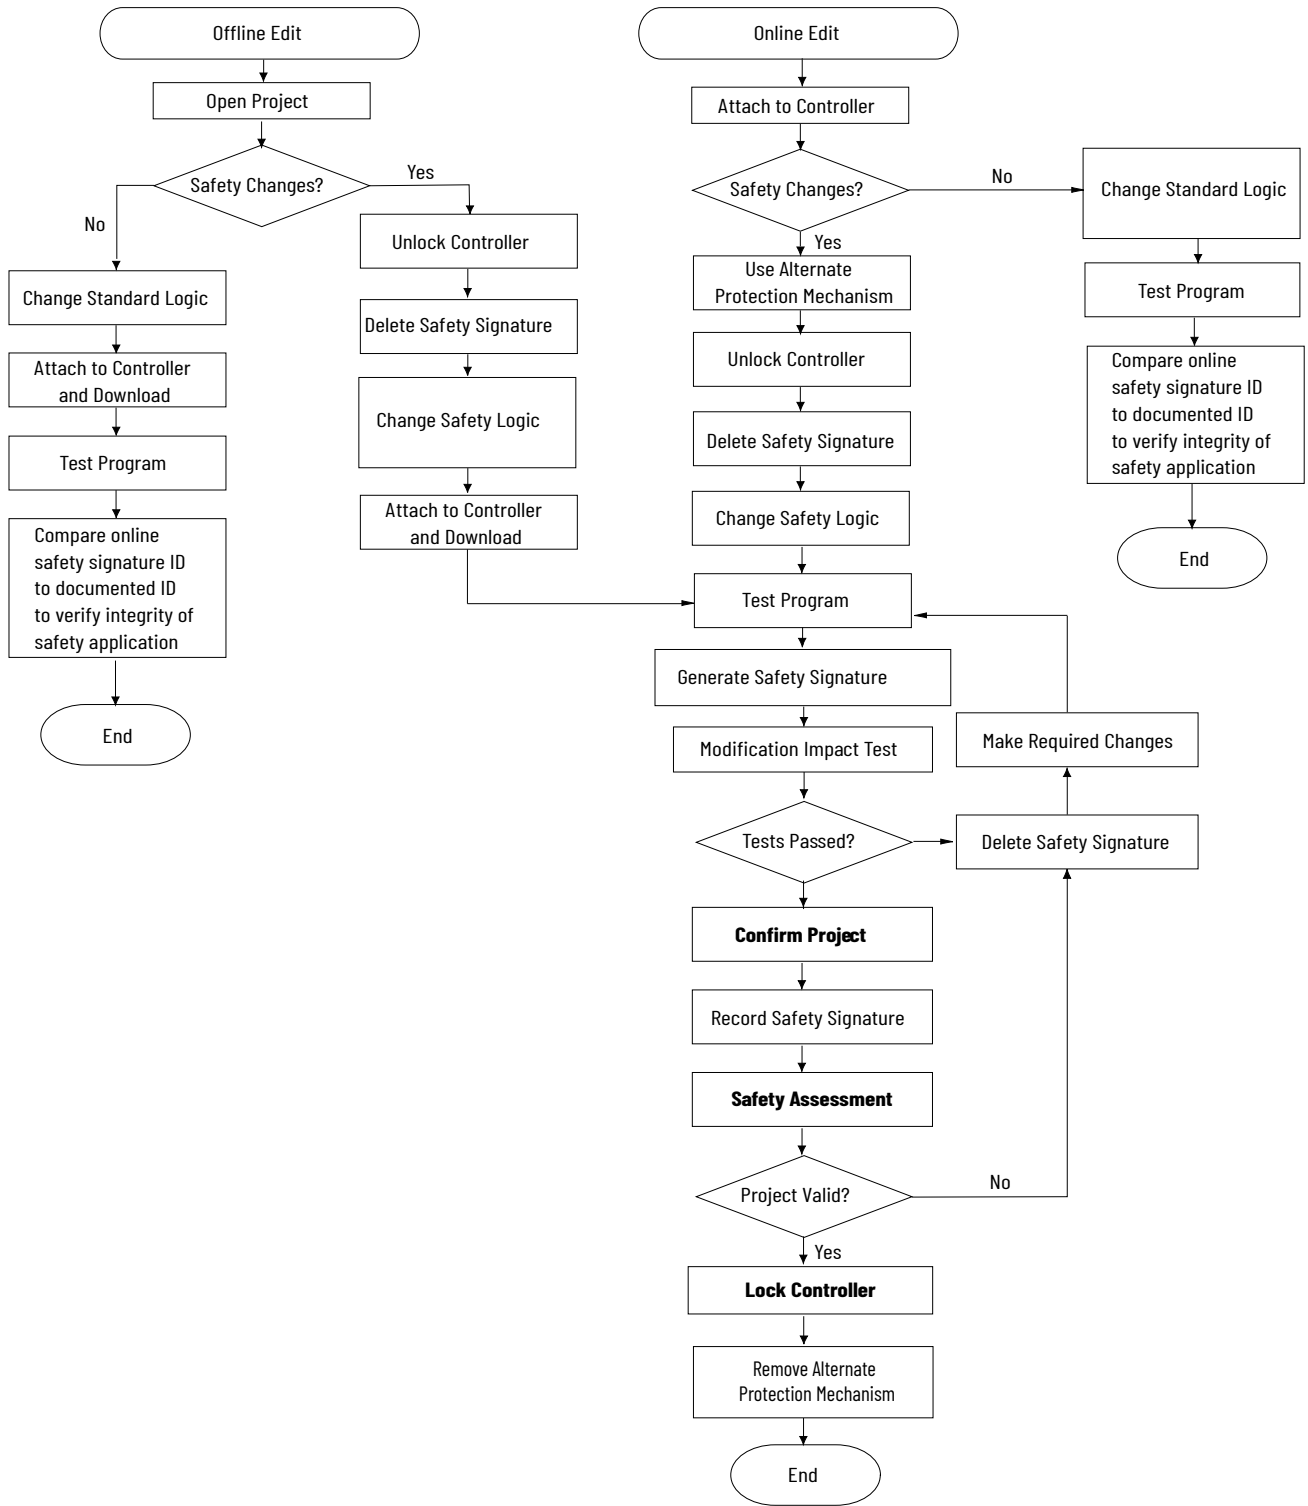

Monitor Safety Status and Handle Faults

There are multiple methods to detect and react to faults in the system. The first way that you can handle faults is to verify that you have completed the checklists for your application as described in [Checklists for Safety Applications on page 111](#).

For details about the operation of status indicators, see the user manual for the controller.

IMPORTANT: Status indicators do not provide excellent reliability for safety functions. Use them only for general diagnostics during commissioning or troubleshooting. Do not attempt to use status indicators to determine operational status.

System Status

You can monitor the system status with the following diagnostic tools.

IMPORTANT: It is your responsibility to determine what data is most appropriate to initiate a shutdown sequence.

Safety I/O Module Diagnostics

IMPORTANT: You are responsible for providing application logic to latch I/O failures and to verify that the system restarts properly.

Safety I/O modules provide pulse test and monitoring capabilities. If the module detects a failure, it sets the offending input or output to its safe state and reports the failure to the controller. The failure indication is made via input or output status and is maintained for a configurable amount of time after the failure is repaired.

I/O Device Connection Status

IMPORTANT: You are responsible for providing application logic to latch I/O failures and to verify that the system restarts properly.

The CIP Safety™ protocol allows the recipients of I/O data to determine the status of that data:

- The controller detects input connection failures and then sets all input data to the safe state and the associated input status to faulted.
- The output device detects output connection failures and then de-energizes its outputs.
- Generally, the safety controller also has input connections from output devices. The safety controller determines the status of these input connections, but the input connection status is not the primary mechanism to de-energize outputs.

De-energize to Trip System

Safety controllers are part of a de-energize to trip system, which means that zero is the safe state. Some, but not all, safety I/O device faults cause all device inputs or outputs to be set to safe state. Faults that are associated to a specific input channel result in that specific channel being set to a safe state. For example, a pulse test fault that is specific to channel 0 results in channel 0 input data being set to the safe state. If a fault is general to the device and not to a specific channel, the combined status bit displays the fault status and all device data is set to the safe state.

Get System Value (GSV) and Set System Value (SSV) Instructions

The GSV and SSV instructions let you get (GSV) and set (SSV) controller system data that is stored in device objects. When you enter a GSV/SSV instruction, the programming software displays the valid object classes, object names, and attribute names for each instruction. Restrictions exist for using the GSV and SSV instructions with safety components.

IMPORTANT:

The safety task cannot perform GSV or SSV operations on standard attributes.

The attributes of safety objects that the standard task can write are only for diagnostic purposes. They do not affect safety task execution.

For more information about GSV and SSV instructions, see the Logix 5000 Controllers General Instructions Reference Manual, publication [1756-RM003](#).

Monitor GuardLogix Safety Status


You can use the following to monitor the controller status:

- Safety partner and task status in the controller properties
- Safety I/O status

Safety Partner and Safety Task Status

The status of the safety partner and safety task appears on the Safety tab of the controller properties.

Figure 45. Safety Task Status

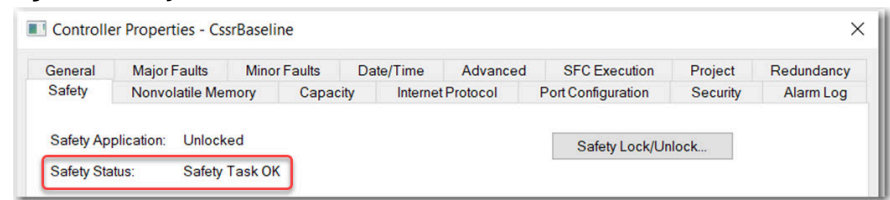


The following statuses can appear in the Safety Status field:

- Safety partner is missing or unavailable (SIL 3).
- Safety partner hardware is incompatible with the primary controller.
- Safety partner firmware is incompatible with the primary controller.
- Safety task inoperable.
- Safety task OK.

Except for the status 'Safety Task OK', the statuses indicate that a nonrecoverable safety fault exists.

The status of the safety partner can be viewed on the Connection tab in the module properties.

Figure 46. Safety Partner Status

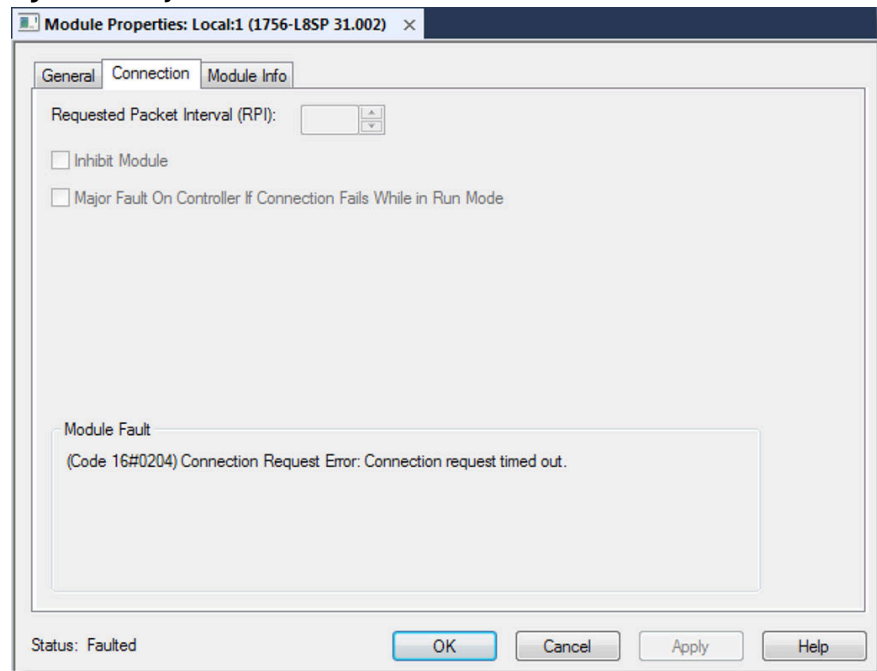

Safety Connection Status

For tags associated with consumed safety data, you can monitor the status of safety connections by using the CONNECTION_STATUS member. For monitoring input and output connections, safety I/O tags have a connection status member called SafetyStatus. Both data types contain 2 bits: ConnectionFaulted and RunMode.

The ConnectionFaulted value indicates whether the safety connection between the safety producer and the safety consumer is Valid (0) or Faulted (1). If ConnectionFaulted is set to Faulted (1) for any reason, the safety data is reset to zero and the RunMode value is set to Idle State (0).

The RunMode value indicates if consumed data is actively being updated by a device that is in the Run Mode (1) or Idle State (0). Idle state is indicated if the connection is closed, the safety task is faulted, or the remote controller or device is in Program mode or Test mode. For safety I/O connections, the RunMode is always inverse the ConnectionFaulted status. It does not provide unique data.

The following table describes the combinations of the ConnectionFaulted and RunMode states.

Table 8. Safety Connection Status

ConnectionFaulted Status	RunMode Status	Safety Connection Operation
0 = Valid	1 = Run	Data is actively being controlled by the producing device. The producing device is in Run mode.
0 = Valid	0 = Idle	The connection is active and the producing device is in the Idle state. The safety data is reset to zero. This applies to consumed connections only.

Table 8. Safety Connection Status (continued)

ConnectionFaulted Status	RunMode Status	Safety Connection Operation
1 = Faulted	0 = Idle	The safety connection is faulted. The state of the producing device is unknown. The safety data is reset to zero and the RunMode value is set to Idle State (0).
1 = Faulted	1 = Run	Invalid state.

If a device is inhibited, the ConnectionFaulted bit is set to Faulted (1) and the RunMode bit is set to Idle (0) for each connection associated with the device. As a result, safety consumed data is reset to zero.



ATTENTION: Safety I/O connections and produced/consumed connections cannot be automatically configured to fault the controller if a connection is lost and the system transitions to the safe state. Therefore, if you must detect a device fault to be sure that the system maintains the required SIL level, you must monitor the safety I/O CONNECTION_STATUS bits and initiate the fault via program logic.

Safety I/O Status

Connection Status (.ConnectionFaulted) is the status of the safety connection between the safety controller and safety I/O module. When the connection is operating properly, this bit is LO (0). When the connection is not operating properly, this bit is HI (1). When the connection status is HI (connection not operating properly), all other module defined tags are LO and considered invalid data.

Point Status is available for both safety inputs (.PtxxInputStatus) and safety outputs (.PtxxOutputStatus). When a point status tag is HI (1), it indicates that individual channel is functioning and wired correctly, and that the safety connection between the safety controller and the safety I/O module on which this channel resides is operating properly.

Combined Status is also available for both safety inputs (.CombinedInputStatus) and safety outputs (.CombinedOutputStatus). When the combined status tag is HI (1), it indicates that all input or output channels on the module are functioning and wired correctly, and that the safety connection between the safety controller and the safety I/O module on which these channels reside is operating properly.

Whether combined status or point status is used is application-dependent. Point status simply provides more granular status.


The dual-channel safety instructions have built in safety I/O status monitoring. Input status and Output status are parameters for the safety input and output instructions. The DCS instruction (and other dual-channel safety instructions) has input status for input channels A and B. The CROUT instruction has input status for Feedbacks 1 and 2, and has output status for the output channels that are driven by the CROUT outputs O1 and O2. The status tags used in these instructions must be HI (1) for the safety instruction output tags (O1 for input instructions and O1/O2 for CROUT) to be energized.

For proper safety instruction operation, it is important to drive the input status and output status tags BEFORE/ABOVE the safety instruction as shown in the following figure.

When you use instructions, such as XIC and OTE, you are responsible for interrogating the safety I/O status:

- Before you use a safety input channel as an interlock, verify that the safety input channel status is HI (1).
- Before you energize a safety output channel, verify that the safety output channel status is HI (1).

Figure 47. Instruction Examples

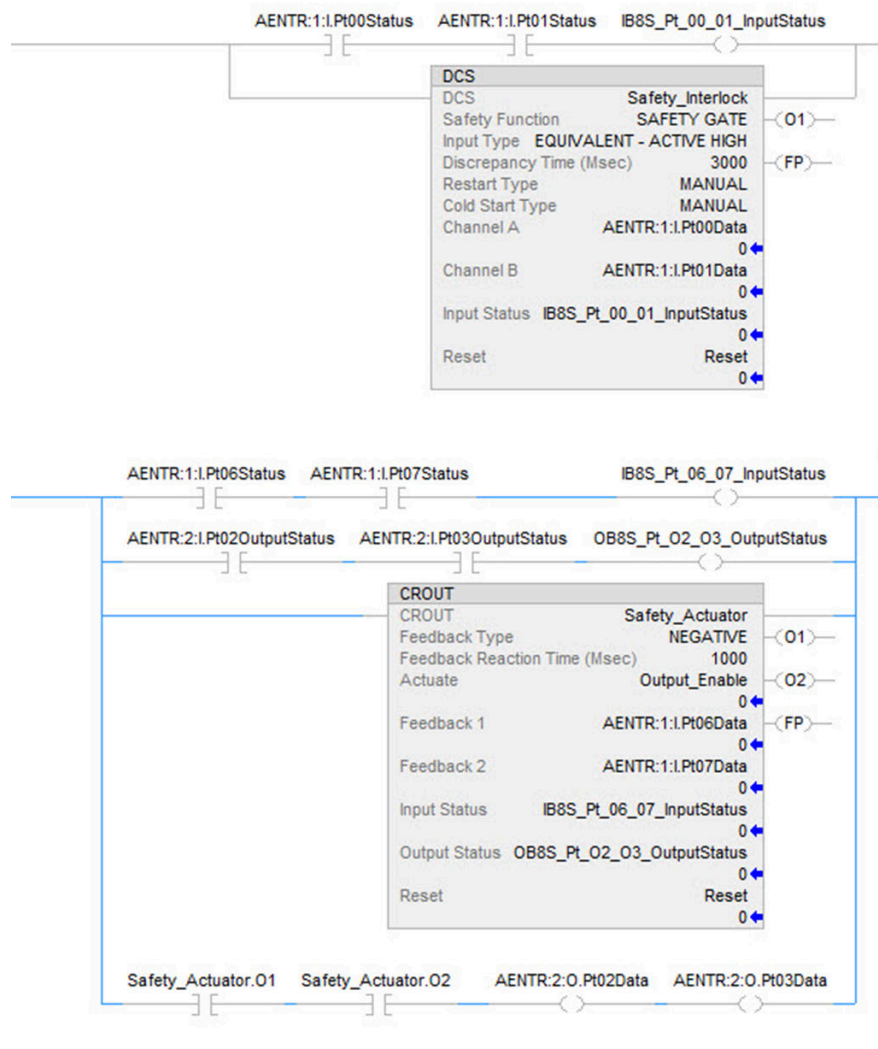

Safety Faults

Safety systems can experience the following faults.

Nonrecoverable Controller Faults

These faults occur when the internal diagnostics of the controller discovers a fault. If a nonrecoverable controller fault occurs, standard and safety task execution stops and outgoing connections stop. Safety I/O devices respond to the loss of output data by transitioning to the safe state. Recovery requires that you download the application program again.

Nonrecoverable Safety Faults in the Safety Application

If a nonrecoverable safety fault occurs in the safety application, the safety logic and the safety protocol are ended. Safety task watchdog and control partnership faults fall into this category.

When the safety task encounters a nonrecoverable safety fault, a standard major recoverable fault is also logged, and the controller proceeds to execute the controller fault handler, if one exists. If the controller fault handler handles this fault, then the standard tasks continue to run, even though the safety task remains faulted.

**ATTENTION:**

Overriding a safety fault does not clear the fault. If you override a safety fault, it is your responsibility to prove that operation of your system is still safe.

You must provide proof to your certifying agency that your system can continue to operate safely after an override of a safety fault.

Several nonrecoverable safety faults can be cleared, with or without a safety task signature, to enable the safety task to run. The safety task inoperable fault requires that you download the application again for the safety task to run.

Recoverable Safety Faults in the Safety Application

If a recoverable fault occurs in a safety program, the system can halt the execution of the safety task, depending upon if the Program Fault Handler in the safety program (if one exists) handles the fault.

When a recoverable fault is cleared programmatically, the safety task continues without interruption.

When a recoverable fault in the safety application is not cleared programmatically, a Type 14, Code 2 recoverable safety fault occurs. The safety task execution is stopped, and safety protocol connections are closed and reopened to reinitialize them. Safety outputs are placed in the safe state and the producer of safety-consumed tags commands the consumers to place them in a safe state, as well.

If the recoverable safety fault is not handled, a standard major recoverable fault is also logged, and the controller proceeds to execute the controller fault handler, if one exists. If the controller fault handler handles this fault, then the standard tasks continue to run, even though the safety task remains faulted.

The occurrence of recoverable faults is an indication that the application code is not protecting itself from invalid data values or conditions. Consider modifying the application to reduce the risk of these faults, rather than handling them at runtime.

**ATTENTION:**

Overriding a safety fault does not clear the fault. If you override a safety fault, it is your responsibility to prove that operation of your system is still safe.

You must provide proof to your certifying agency that your system can continue to operate safely after an override of a safety fault.

View Faults

The Recent Faults dialog box on the Major Faults tab of the Controller Properties dialog box contains two subtabs, one for standard faults and one for safety faults.

The status display on the controller also shows fault codes with a brief status message. For more information about status indicators, see the following:

- ControlLogix 5580 and GuardLogix 5580 Controllers User Manual, publication [1756-UM543](#)
- CompactLogix 5380 and Compact GuardLogix 5380 User Manual, publication [5069-UM001](#)

Fault Codes

Safety controllers show fault codes on the Major Faults tab of the Controller Properties dialog box and in the PROGRAM object, MAJORFAULTRECORD or MINORFAULTRECORD attribute.

IMPORTANT: This manual links to Logix 5000 Controller and I/O Fault Codes and Syslog Messages, [1756-RD001](#); the file automatically downloads when you click the link.

Fault Routine for Safety Applications

If a fault condition occurs that is severe enough for the controller to shut down, the controller generates a major fault and stops the execution of logic.

Some applications do not want all safety faults to shut down the entire system. In those situations, use a fault routine to clear a specific fault and let the standard control portion of your system continue to operate or configure some outputs to remain ON.



ATTENTION:

You must provide proof to your certifying agency that your system can continue to operate safely after an override of a safety fault.

The occurrence of recoverable faults is an indication that the application code is not protecting itself from invalid data values or conditions. Consider modifying the application to eliminate these faults, rather than handling them at runtime.

The controller supports two levels for handling major faults in a safety application:

- Safety Program Fault Routine
- Controller Fault Handler

Both routines can use the GSV and SSV instructions.

Each safety program can have its own fault routine. The controller executes the program's fault routine when an instruction fault occurs. If the program's fault routine does not clear the fault, or if a program fault routine does not exist, the safety task faults and shuts down.

When the safety task faults, a standard major recoverable fault is also logged, and the controller proceeds to execute the controller fault handler, if one exists. If the controller fault handler handles this fault, then the standard tasks continue to run, even though the safety task remains faulted.

The controller fault handler is an optional component that executes when the program fault routine cannot clear the fault or does not exist.

You can create one program for the controller fault handler. After you create that program, you must configure a routine as the main routine.

The Logix 5000 Controllers Major, Minor, and I/O Faults Programming Manual, publication [1756-PM014](#), provides details on creating and testing a fault routine.

GSV/SSV Instructions in a Safety Application

For standard tasks, you can use the GSV instruction to get values for the available attributes. When using the SSV instruction, the software displays only the attributes that you can set.

For the safety task, the GSV and SSV instructions are more restricted. The SSV instructions in safety and standard tasks cannot set bit 0 (major fault on error) in the mode attribute of a safety I/O device.



ATTENTION: Use the SSV instruction carefully. Making changes to objects can cause unexpected controller operation or injury to personnel.

FaultRecord Attributes

Create a user-defined structure to simplify access to the MajorFaultRecord and SafetyTaskFaultRecord attributes.

Table 9. Parameters for Accessing FaultRecord Attributes

Name	Data Type	Style	Description
TimeLow	DINT	Decimal	Lower 32 bits of the fault time stamp value
TimeHigh	DINT	Decimal	Upper 32 bits of the fault time stamp value
Type	INT	Decimal	Fault type (program, I/O, or other)
Code	INT	Decimal	Unique code for this fault (dependent on fault type)
Info	DINT[8]	Hexadecimal	Fault-specific information (dependent on fault type and code)

Fault Information

The SafetyStatus and SafetyTaskFaultRecord attributes can capture information about nonrecoverable faults. Use a GSV instruction in the controller fault handler to capture and store fault information. The GSV instruction can be used in a standard task with a controller fault handler routine that clears the fault and lets the standard tasks continue executing.

For more information on using the GSV and SSV instructions in safety applications, refer to the Input/Output Instructions chapter of the Logix 5000 Controllers General Instructions Reference Manual, publication [1756-RM003](#).

Safety Partner Fault

The 1756-L8SP safety partner has an OK status indicator.

If the SIL configuration is set to SIL 2 and a safety partner is installed in the slot next the safety primary, these actions occur:

- On the 1756-L8SP safety partner, the OK status indicator flashes red.
- The controller logs a Type 14, Code 12 minor fault that indicates that the controller is configured for SIL 2, and a safety partner is present.
- The programming application refuses to download a SIL 2 application.

Safety Application Instructions

Safety application instructions are certified for use in SIL 2 or SIL 3 applications.



ATTENTION: Safety application instructions are the only instructions that can be used in the safety task for SIL 2 or SIL 3 applications.

For more information about using instructions, see the following:

- Logix 5000 Safety Application Instruction Set Reference Manual, publication [1756-RM095](#)
- Logix 5000 Controllers General Instructions Reference Manual, publication [1756-RM003](#)

Safety Instructions

Mnemonic	Name	Description
CROUT	Configurable Redundant Output	Controls and monitors redundant outputs.
DCA	Dual Channel Input - Analog (integer version)	Monitors two analog values for deviation and range tolerance.
DCAF	Dual Channel Input - Analog (floating point version)	Monitors two analog values for deviation and range tolerance.
DCM	Dual Channel Input - Monitor	Monitors dual-input safety devices.
DCS	Dual Channel Input - Stop	Monitors dual-input safety devices whose main purpose is to provide a stop function, such as an E-stop, light curtain, or gate switch.
DCSRT	Dual Channel Input - Start	Energizes dual-input safety devices whose main function is to start a machine safely, for example an enable pendant.
DCST	Dual Channel Input - Stop With Test	Monitors dual-input safety devices whose main purpose is to provide a stop function, such as an E-stop, light curtain, or gate switch. It includes the added capability to initiate a functional test of the stop device.
DCSTL	Dual Channel Input - Stop With Test and Lock	Monitors dual-input safety devices whose main purpose is to provide a stop function, such as an E-stop, light curtain, or gate switch. It includes the added capability to initiate a functional test of the stop device. It can monitor a feedback

Mnemonic	Name	Description
		signal from a safety device and issue a lock request to a safety device.
DCSTM	Dual Channel Input - Stop With Test and Mute	Monitors dual-input safety devices whose main purpose is to provide a stop function, such as an E-stop, light curtain, or gate switch. It includes the added capability to initiate a functional test of the stop device and the ability to mute the safety device.
FSBM	Four Sensor Bi-directional Muting	Automatically disables the protective function of a light curtain temporarily, by using four sensors that are arranged sequentially before and after the sensing field of the light curtain.
SMAT	Safety Mat	Indicates whether the safety mat is occupied.
THRSe	Two-Hand Run Station - Enhanced	Monitors two diverse safety inputs, one from a right-hand push button and one from a left-hand push button, to control one output. Features configurable channel-to-channel discrepancy time and enhanced capability for bypassing a two-hand run station.
TSAM	Two Sensor Asymmetrical Muting	Automatically disables the protective function of a light curtain temporarily, by using two muting sensors that are arranged asymmetrically.
TSSM	Two Sensor Symmetrical Muting	Automatically disables the protective function of a light curtain temporarily, by using two muting sensors that are arranged symmetrically.

Metal Form Instructions

AVC	Name	Description
AVC	Auxiliary Valve Control	Controls an auxiliary valve that is used with a main valve.

AVC	Name	Description
CBIM	Clutch Brake Inch Mode	Used for press applications where minor slide adjustments are required, such as press setup.
CBCM	Clutch Brake Continuous Mode	Used for press applications where continuous operation is desired.
CBSSM	Clutch Brake Single Stroke Mode	Used in single-cycle press applications.
CPM	Crankshaft Position Monitor	Used to determine the slide position of the press.
CSM	Camshaft Monitor	Monitors motion for the start, stop, and run operations of a camshaft.
EPMS	Eight-position Mode Selector	Monitors eight safety inputs to control one of the eight outputs that correspond to the active input.
MMVC	Maintenance Manual Valve Control	Used to drive a valve manually during maintenance operations.
MVC	Main Valve Control	Controls and monitors a main valve.

Ladder Diagram Safety Instructions

Routines in the safety task can use the following types of ladder diagram safety instructions.

When instructions that result in values with decimal place are used with REAL or LREAL operands, Rockwell Automation has verified the precision to 6 decimal places.

Advanced Process

Mnemonic	Name	Description	Logix Designer Application
FGEN	Function Generator	Converts an input based on a piece-wise linear function.	Version 38 or later

Advanced Math

Rockwell Automation has not done independent mathematical analysis of the numerical algorithms used in any of the following advanced math instructions. If you require a specific degree of accuracy, you must functionally test this instruction over your expected input domain.

Mnemonic	Name	Description	Logix Designer Application
EXPT	X to the Power of Y	Returns the value of X to the power of Y.	Version 36 or later
XPY	X to the Power of Y	Returns the value of X to the power of Y.	Version 35 or earlier
LG	Natural Log	Compute the natural log of a number.	All versions
LOG	Log Base 10	Compute the log base 10 of a number.	All versions

Array (File)

Mnemonic	Name	Description	Logix Designer Application
AVE	File Average	Calculate the mean/average over a set of values.	All versions
COP	Copy File	Copy binary data from one tag to another (no type conversion). When you use the COP instruction in a safety routine, you must verify that the length is a constant and that the source and destination length are the same.	All versions
FAL	File Arithmetic and Logic	Perform copy, arithmetic, logic, and function operations on data that is stored in an array.	All versions
FLL	File Fill	Fill the elements of an array with the source value, while leaving the source value unchanged.	All versions
FSC	File Search and Compare	Compare the values in an array, element by element.	All versions
SIZE	Size in Elements	Find the size of a dimension of an array.	All versions

Mnemonic	Name	Description	Logix Designer Application
STD	File Standard Deviation	Calculate the standard deviation over a set of values.	All versions
BSL	Bit Shift Left	Shifts the specified number of bits to the left.	All versions
BSU	Bit Shift Right	Shifts the specified number of bits to the right.	All versions
FFL	Fifo Load	Store a value into an array by using first-in/first-out semantics.	All versions
FFU	Fifo Unload	Retrieve a value from an array by using last-in/first-out semantics.	All versions
LFL	Lifo Load	Store a value into an array by using last-in/first-out semantics.	All versions
LFU	Lifo Unload	Retrieve a value from an array by using last-in/first-out semantics.	All versions

Bit

Mnemonic	Name	Description	Logix Designer Application
ONS	One Shot	Allows an event to occur one time.	All versions
OSR	One Shot Falling	Sets an output bit for one scan on the true-to-false (falling) edge of rung state.	All versions
OSF	One Shot Rising	Sets an output bit for one scan on the false-to-true (rising) edge of rung state.	All versions
OTE	Output Energize	Controls a bit (it performs both Set and Clear operations based on rung state).	All versions
OTL	Output Latch	Set a bit (retentive).	All versions
OOTL	Output Unlatch	Clear bit (retentive).	All versions

Mnemonic	Name	Description	Logix Designer Application
XIC	Examine if Closed	Examines the data bit to set or clear the rung condition.	All versions
XIO	Examine if Open	Examines the data bit to set or clear the rung condition.	All versions

Time/Counter

Mnemonic	Name	Description	Logix Designer Application
CTD	Count Down	Count down.	All versions
CTU	Count Up	Count up.	All versions
RES	Reset	Reset a timer or counter.	All versions
RTO	Retentive Timer On	Accumulate time.	All versions
TOF	Off-delay Timer	Time how long a timer is disabled.	All versions
TON	On-delay Timer	Time how long a timer is enabled.	All versions

Compare

Mnemonic	Name	Description	Logix Designer Application
EQ	Equal To	Test whether two values are equal.	Version 36 or later
EQU	Equal To	Test whether two values are equal.	Version 35 or earlier
CMP	Compare	Perform a comparison on the arithmetic operations that you specify in the expression.	All versions
GE	Greater Than Or Equal To	Test whether one value is greater than or equal to a second value.	Version 36 or later

Mnemonic	Name	Description	Logix Designer Application
GEO	Greater Than Or Equal To	Test whether one value is greater than or equal to a second value.	Version 35 or earlier
GT	Greater Than	Test whether one value is greater than a second value.	Version 36 or later
GRT	Greater Than	Test whether one value is greater than a second value.	Version 35 or earlier
IsINF	If Infinity	Check if floating point value is +/- infinity.	All versions
IsNAN	Is Not a Number	Check if floating point value is Not-a-Number.	All versions
LE	Less Than or Equal To	Test whether one value is less than or equal to a second value.	Version 36 or later
LEQ	Less Than or Equal To	Test whether one value is less than or equal to a second value.	Version 35 or earlier
LT	Less Than	Test whether one value is less than a second value.	Version 36 or later
LES	Less Than	Test whether one value is less than a second value.	Version 35 or earlier
LIMIT	Limit	Test whether a value falls within a specified range.	Version 36 or later
LIM	Limit	Test whether a value falls within a specified range.	Version 35 or earlier
MEQ	Mask Equal To	Pass source and compare values through a mask and test whether they are equal.	All versions
NE	Not Equal	Test whether one value is not equal to a second value.	Version 36 or later
NEQ	Not Equal	Test whether one value is not equal to a second value.	Version 35 or earlier

Move/Logical

Mnemonic	Name	Description	Logix Designer Application
AND	Bitwise AND	Perform bitwise AND operation.	All versions
CLR	Clear	Clear a value.	All versions
MOVE	Move	Copy a value.	Version 36 or later
MOV	Move	Copy a value.	Version 35 or earlier
MVM	Masked Move	Copy a specific part of an integer.	All versions
NOT	Bitwise Not	Perform bitwise NOT operation.	All versions
OR	Bitwise Or	Perform bitwise OR operation.	All versions
SWPB	Swap Byte	Rearrange the bytes of a value.	All versions
XOR	Bitwise Exclusive Or	Perform bitwise exclusive OR operation.	All versions

Program Control

Mnemonic	Name	Description	Logix Designer Application
AFI	Always False Instruction	Forces a rung to false (rung continues to execute).	All versions
EVENT	Trigger Event Task	Triggers one execution of an event task. The event instruction triggers a scan of the standard task.	All versions
JMP	Jump To Label	Scan of logic jumps to a labeled location within the same routine.	All versions
JSR	Jump to Subroutine	Jump to a separate routine.	All versions
LBL	Label	Identifies a target location for a JMP instruction.	All versions

Mnemonic	Name	Description	Logix Designer Application
MCR	Master Control Reset	Forces every rung in a section of logic to execute in the False state.	All versions
NOP	No Operation	Insert a placeholder in the logic.	All versions
RET	Return	Return the results of a subroutine.	All versions
SBR	Subroutine	Accept data that is passed to a subroutine by the JSR instruction.	All versions
TND	Temporary End	Mark a temporary end that halts routine execution.	All versions

Compute/Math

Rockwell Automation has done no independent mathematical analysis of the numerical algorithms used in the S \sqrt RT or SQR instructions. If you require a specific degree of accuracy, you must functionally test this instruction over your expected input domain.

Mnemonic	Name	Description	Logix Designer Application
ABS	Absolute Value	Take the absolute value of a value.	All versions
ADD	Add	Add two values.	All versions
CPT	Compute	Perform the arithmetic operation that is defined in the expression.	All versions
DIV	Divide	Divide two values.	All versions
MOD	Modulo	Determine the remainder after one value is divided by a second value.	All versions
MUL	Multiply	Multiply two values.	All versions
NEG	Negate	Take the opposite sign of a value.	All versions
S \sqrt RT	Square Root	Calculate the square root of a value.	Version 36 or later
SQR	Square Root	Calculate the square root of a value.	Version 35 or earlier

Mnemonic	Name	Description	Logix Designer Application
SUB	Subtract	Subtract two values.	All versions

Trigonometric

Rockwell Automation has not done independent mathematical analysis of the numerical algorithms in any of the following trigonometric instructions. If you require a specific degree of accuracy, you must functionally test this instruction over your expected input domain.

Mnemonic	Name	Description	Logix Designer Application
ACOS	Arc Cosine	Compute the arc-cosine of a number.	Version 36 or later
ACS	Arc Cosine	Compute the arc-cosine of a number.	Version 35 or earlier
ASIN	Arc Sine	Compute the arc-sine of a number.	Version 36 or later
ASN	Arc Sine	Compute the arc-sine of a number.	Version 35 or earlier
ATAN	Arc Tangent	Compute the arc tangent in radians of y/x based on the sign of a value to determine the correct quadrant.	Version 36 or later
ATN	Arc Tangent	Compute the arc tangent in radians of y/x based on the sign of a value to determine the correct quadrant.	Version 35 or earlier
ATAN2	Arc Tangent 2	Compute the arc tangent in radians of y/x based on the signs of both values to determine the correct quadrant.	All versions
COS	Cosine	Compute the cosine of a number.	All versions
SIN	Sine	Compute the sin of a number.	All versions
TAN	Tangent	Compute the tangent of a number.	All versions

I/O

For special considerations when using the GSV and SSV instructions, see the controller user manual.

Mnemonic	Name	Description	Logix Designer Application
GSV	Get System Value	Get controller status information.	All versions
SSV	Set System Value	Set controller status information.	All versions

Math Conversion

Mnemonic	Name	Description	Logix Designer Application
DEG	Degrees	Convert radians into degrees.	All versions
BCD_TO	Convert to Integer	Convert the BCD value to an integer value.	Version 36 or later
FRD	Convert to Integer	Convert the BCD value to an integer value.	Version 35 or earlier
RAD	Radian	Convert degrees into radians.	All versions
TO_BCD	Convert to BCD	Convert the integer value to a BCD value.	Version 36 or later
TOD	Convert to BCD	Convert the integer value to a BCD value.	Version 35 or earlier
TRUNC	Truncate	Remove the fractional part of a value.	Version 36 or later
TRN	Truncate	Remove the fractional part of a value.	Version 35 or earlier

Drive Safety Instructions

Motion safety instructions are available when using a GuardLogix® 5580 or Compact GuardLogix® 5380 controller and safe speed or position inputs with the Studio 5000 Logix Designer® application, version 31 or later.

IMPORTANT:

If you use motion direct commands with a Kinetix® 5500 drive, Kinetix®5700 servo drive, or a PowerFlex® 527 drive, see the user manual for the drive for information on how to use this feature in safety applications:

- Kinetix 5500 Servo Drives User Manual, publication [2198-UM001](#)
- Kinetix 5700 Servo Drives User Manual, publication [2198-UM002](#)
- PowerFlex® 527 Adjustable Frequency AC Drive User Manual, publication [520-UM002](#)
- PowerFlex 755/755T Integrated Safety - Safe Torque Off Option Module User Manual, publication [750-UM004](#)
- PowerFlex 755/755T Integrated Safety Functions Option Module User Manual, publication [750-UM005](#)

Mnemonic	Name	Description
SBC	Safe Brake Control	The Safe Brake Control (SBC) instruction: <ul style="list-style-type: none"> • Controls safety outputs that actuate a brake. • Sets timing between brake and Torque Off Request outputs. • Monitors brake feedback and I/O status.
SDI	Safe Direction	The Safe Direction instruction monitors position of a motor or axis to detect movement of more than a defined amount in the unintended direction.
SFX	Safe Feedback Scaling	The Safety Feedback Interface instruction converts motor velocity and position feedback from a drive module into user scaling units. It also defines an absolute reference position.
SLP	Safe Limited Position	The Safely-limited Position instruction monitors the position of a motor or axis to verify that the position does not deviate above or below defined limits.
SLS	Safely-limited Speed	The Safely-limited Speed instruction monitors the speed of an axis and sets the SLS Limit output if the speed exceeds the Active Limit input value for the instruction.
SOS	Safe Operating Stop	The Safe Operating Stop instruction monitors the speed or position of a motor or axis to verify that the deviation from standstill speed or

Mnemonic	Name	Description
		position is not more than a defined amount.
SS1	Safe Stop 1	The Safe Stop 1 instruction monitors the deceleration of an axis according to the specified velocity ramp to zero speed and controls its output (O1) to initiate Safe Torque Off (STO).
SS2	Safe Stop 2	The Safe Stop 2 instruction initiates and monitors the motor deceleration within set limits to verify that the motor is brought to an operational stop. Once stopped, SS2 continues to monitor the operational stop of the motor.

Safety Reaction Times

The input reaction time is the time from when the signal changes on an input terminal to when safety data is sent to the controller.

The output reaction time is the time from when safety data is received from the controller to when the output terminal changes state.

For information on how to determine the input and output reaction times, see the product documentation for your specific safety I/O device.

Connection Reaction Time Limit

The Connection Reaction Time Limit (CRTL) is the maximum age of safety packets on the associated connection. If the age of the data that is used by the consuming device exceeds the CRTL, a connection fault occurs.

The CRTL is defined by the values in the following table.

Table 10. Connection Reaction Time Limit Values

Value	Default	Description
Requested packet interval (RPI)	10 ms (input RPI)	The RPI determines how often the input and output packets are placed on the network.
Timeout multiplier	2	The timeout multiplier determines the number of retries before a timeout occurs. IMPORTANT: For any safety connection, do not set the timeout multiplier lower than 2. If the timeout multiplier is lower than 2, you risk the controller not meeting time coordination requirements during a loss of redundancy.
Network delay multiplier	200%	The network delay multiplier accounts for known delays on the network. When known delays occur, timeouts can be avoided with this parameter.

If you adjust these values, then you can adjust the CRTL. If a valid packet is not received within the CRTL, the safety connection times out, and the input and output data is placed in the safe state (Off).

IMPORTANT: The default values generate an input connection reaction time limit of 40 ms. If no edits are made to the defaults, verify this connection reaction time limit is used in the safety reaction time calculations.

IMPORTANT: For applications with safety I/O, the default connection reaction time limit can result in connection loss to the safety I/O modules. In some cases, it is necessary to increase the values from their defaults. Make sure that you use the new connection reaction time limit in the safety reaction time calculations.

The following equations determine the CRTL:

Input Connection Reaction Time Limit = Input RPI x [Timeout Multiplier + Network Delay Multiplier]

Output Connection Reaction Time Limit = Safety Task Period x [Timeout Multiplier + Network Delay Multiplier - 1]

The CTRL is shown on the Safety view of the Module Properties dialog box.

Figure 48. Connection Reaction Time Limit

INFORMATION	Safety						
	Connection Type	Requested Packet Interval (RPI)	Connection Reaction Time Limit		Max Observed Network Delay		Action
Overview	Safety Input	10 ms	40.1 ms	1.7 ms	ms	Reset	←
Device Information	Safety Output	20 ms	60 ms	3.7 ms	ms	Reset	←
CONFIGURATION							
Connection							
Safety							
Points							

Specify the Requested Packet Interval (RPI)

The RPI specifies the period that data updates over a connection. For example, an input module produces data at the RPI that you assign.

For safety input connections, you can set the RPI on the Safety view of the Module Properties dialog box. The RPI is entered in 1 ms increments.

The CTRL is adjusted immediately when you change the RPI value.

Figure 49. Requested Packet Interval

INFORMATION	Safety						
	Connection Type	Requested Packet Interval (RPI)	Connection Reaction Time Limit		Max Observed Network Delay		Action
Overview	Safety Input	10 ms	40.1 ms	1.7 ms	ms	Reset	←
Device Information	Safety Output	20 ms	60 ms	3.7 ms	ms	Reset	←
CONFIGURATION							
Connection							
Safety							
Points							

For safety output connections, the RPI is fixed at the safety task period. If the corresponding CTRL is not satisfactory, you can adjust the safety task period on the Safety Task Properties dialog box.

For typical applications, the default CTRL for input connections of 4 x RPI and the default CTRL for output connections of 3 x RPI is usually sufficient. For more complex requirements, use the Advanced button to modify the CTRL parameters.

View the Maximum Observed Network Delay

The maximum observed network delay is shown on the Safety view of the Module Properties dialog box. When online, click Reset to reset the maximum observed network delay.

Figure 50. Reset the Max Observed Network Delay


INFORMATION Overview Device Information CONFIGURATION Connection Safety Points	Safety					
	Connection Type	Requested Packet Interval (RPI)	Connection Reaction Time Limit		Max Observed Network Delay	
	Safety Input	10 ms	40.1 ms	1.7 ms	ms	Reset ←
Safety Output	20 ms	60 ms	3.7 ms	ms	Reset ←	

System Reaction Time

To determine the system reaction time of any control chain, add the reaction times of all the components of the safety chain:

System Reaction Time = Sensor Reaction Time + Logix System Reaction Time + Actuator Reaction Time

Figure 51. System Reaction Time

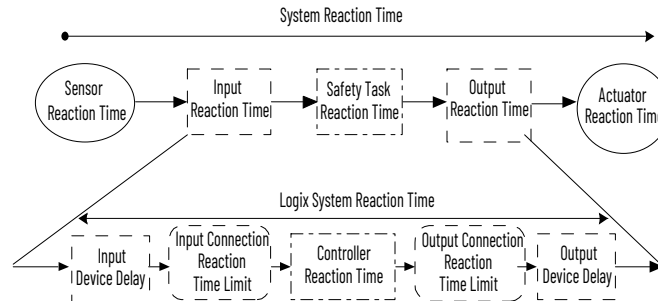

Safety Task Reaction Time

The safety task reaction time is the worst-case delay from any input change that is presented to the controller until the output producer sets the processed output. To determine the safety task reaction time, use the following equation:

$$\text{Safety task reaction time} = (\text{safety task period} + \text{safety task watchdog}) \times 1.01$$

The multiplier is for potential clock drift.

Safety Task Period and Safety Task Watchdog

The safety task period is the interval at which the safety task executes.

The safety task watchdog time is the maximum permissible time for safety task processing. If the time to process a safety task exceeds the safety task watchdog time, a nonrecoverable safety fault occurs in the controller, which results in a transition to the safe state (Off).

You define the safety task watchdog time, which must be less than or equal to the safety task period. You can set the safety task watchdog time in the safety task properties. This value can be modified online, regardless of controller mode, but it cannot be changed when the controller is safety-locked or once a safety signature is created.


Logix System Reaction Time

The following sections provide information on how to calculate the Logix system reaction time.

Simple Input-Logic-Output Chain

This section describes the Logix system reaction time for any simple input-logic-output chain.

Figure 52. Worst Case Reaction Time

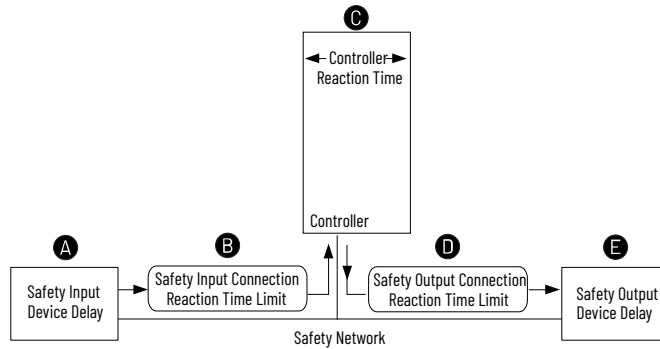


The Logix system reaction time for any simple input to logic to output chain consists of the following components.

Item	Description
A	Safety input device reaction time plus input delay time, if applicable.
B	Safety input connection reaction time limit. Read from the Module Properties dialog box in the Logix Designer application, this value is a multiple of the safety input device connection RPI.
C	Controller reaction time. See Safety Task Reaction Time on page 103 .
D	Safety output connection reaction time limit. Read from the Module Properties dialog box in the Logix Designer application, this value is a multiple of the safety task period.
E	Safety output device reaction time.

Logic Chain Using Produced/Consumed Safety Tags

This section describes the Logix system reaction time for any input to controller A logic to controller B logic to output chain.

Figure 53. Reaction Time with Produced/Consumed Safety Tags

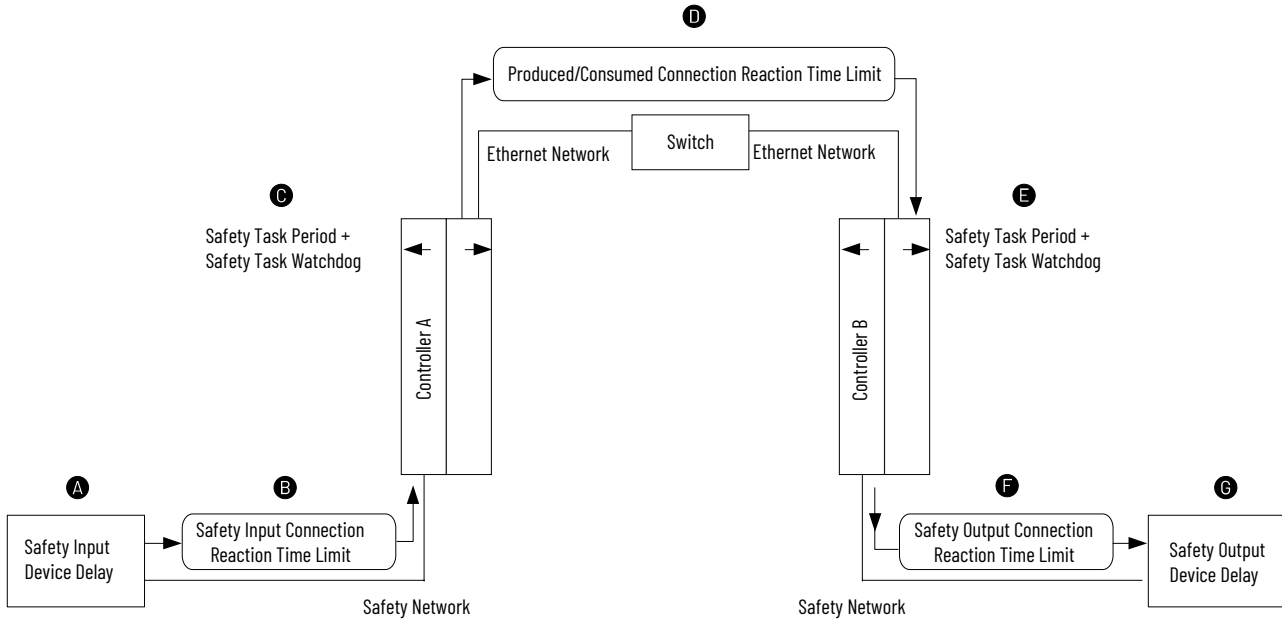

The Logix system reaction time for any input to controller A logic to controller B logic to output chain consists of the following components.

Item	Description
A	Safety input device reaction time plus input delay time, if applicable
B	Safety input connection reaction time limit
C	Safety task period plus safety task watchdog time for controller A
D	Produced/consumed safety connection reaction time limit
E	Safety task period plus safety task watchdog time for controller B
F	Safety output connection reaction time limit
G	Safety output device reaction time

Factors That Affect Logix Reaction-time Components

A number of factors can influence the Logix system reaction time components.

Network traffic and EMC create a lower limit for the values that you can successfully use for the timeout multiplier and network delay multiplier.

The instructions in your safety task and any higher priority tasks in the controller create a lower limit for the values that you can successfully use for Safety Task Period and Safety Task Watchdog.

Table 11. System Reaction Time Components

Reaction Time Component	Factors
Input device delay	<ul style="list-style-type: none"> • Input device reaction time • On-Off and Off-On delay settings for each input channel
Safety input connection reaction time limit	<ul style="list-style-type: none"> • Input device settings: <ul style="list-style-type: none"> - Requested packet interval (RPI) - Timeout multiplier - Network delay multiplier • The amount of network communication traffic. • The EMC environment of the system
Safety task period and safety task watchdog	<ul style="list-style-type: none"> • Safety task period setting • Safety task watchdog setting • The number and execution time of instructions in the safety task The instructions in your safety task create a lower limit for the values that you can successfully use for the safety task period and safety task watchdog.
Output connection reaction time limit	<ul style="list-style-type: none"> • Safety task period setting • Output device settings: <ul style="list-style-type: none"> - Timeout multiplier - Network delay multiplier • The amount of network communication traffic • The EMC environment of the system
Output module delay	Output module reaction time

Configure the Safety Input Module Delay Time

To configure input module delay time in the Logix Designer application, follow these steps.

1. In the configuration tree, right-click the safety input module and select Properties.
2. In the navigation pane, select Points.
3. Adjust the input delay time as required for your application.

Figure 54. Input Delay Time

Point	Point Mode	Test Source	Input Delay Time		Diagnostics
			Off → On	On → Off	
00	Safety	None	5 ms	5 ms	
01	Safety	None	0 ms	0 ms	
02	Not Used	None	0 ms	0 ms	
03	Not Used	None	0 ms	0 ms	
04	Not Used	None	0 ms	0 ms	
05	Not Used	None	0 ms	0 ms	
06	Not Used	None	0 ms	0 ms	

Configure the Input and Output Safety Connection Reaction Time Limits

To configure connection reaction time limit settings, follow these steps.

1. In the configuration tree, right-click your safety I/O module and select Properties.
2. In navigation pane, select Safety.
3. On the Safety view, click Advanced.

Connection Type	Requested Packet Interval (RPI)	Connection Reaction Time Limit		Max Observed Network Delay Time	Action
Safety Input	10 ms	40.1 ms			Reset
Safety Output	20 ms	60 ms			Reset

4. On the Advanced Connection Reaction Time Limit dialog box, configure the parameters and click OK.

IMPORTANT: The values you define for the timeout multiplier and the network delay multiplier provide resilience for variations in network reliability and performance. Use caution when reducing the values as this increases the likelihood of false trips.

Parameter	Input Value	Output Value
Requested Packet Interval (RPI)	10 ms	20 ms
Timeout multiplier	2	2
Network delay multiplier	200%	200%
Connection reaction time limit	40.1 ms	60 ms


Configure the Safety Task Period and Watchdog

The safety task is a periodic timed task.

To configure the safety task period and watchdog, follow these steps.

1. In the configuration tree, right-click the safety task.
2. On the Task Properties dialog box, select the Configuration tab.
3. Configure the parameters as described in [Safety Task on page 47](#).

Figure 55. Safety Task Configuration

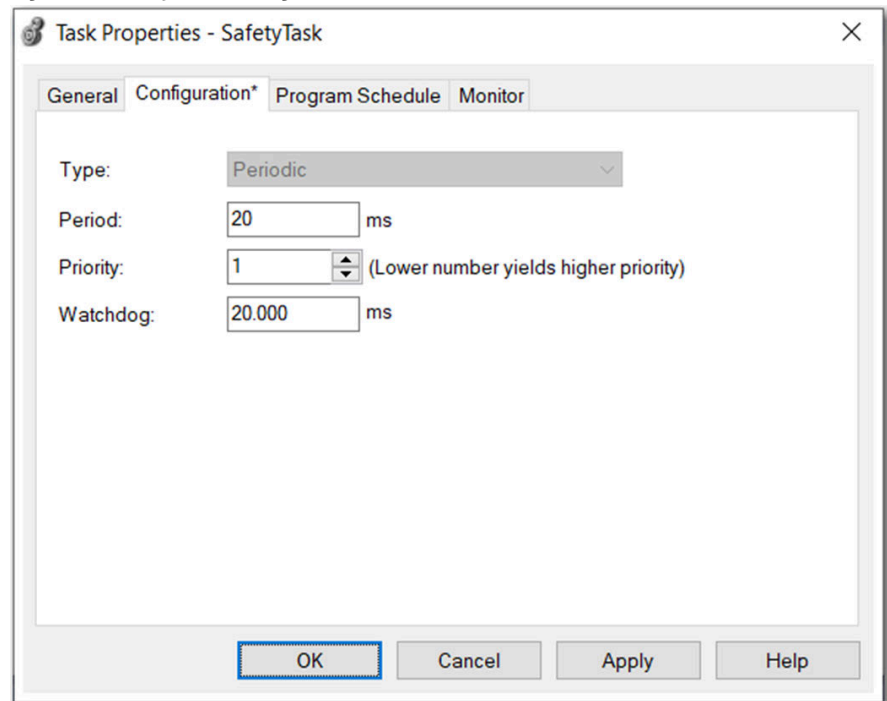


The priority of the safety task is not a safety concern, as the safety task watchdog monitors if a higher priority task interrupts the task.

Access Produced/Consumed Tag Data

To access safety tag connection data, follow these steps.

1. In the configuration tree, right-click Controller Tags and select Edit Tags.
2. In the Tag Editor, right-click the name of the tag and select Edit Properties.
3. Click Connection.
4. On the Safety tab, click Advanced.

Figure 56. Advanced Options Dialog Box

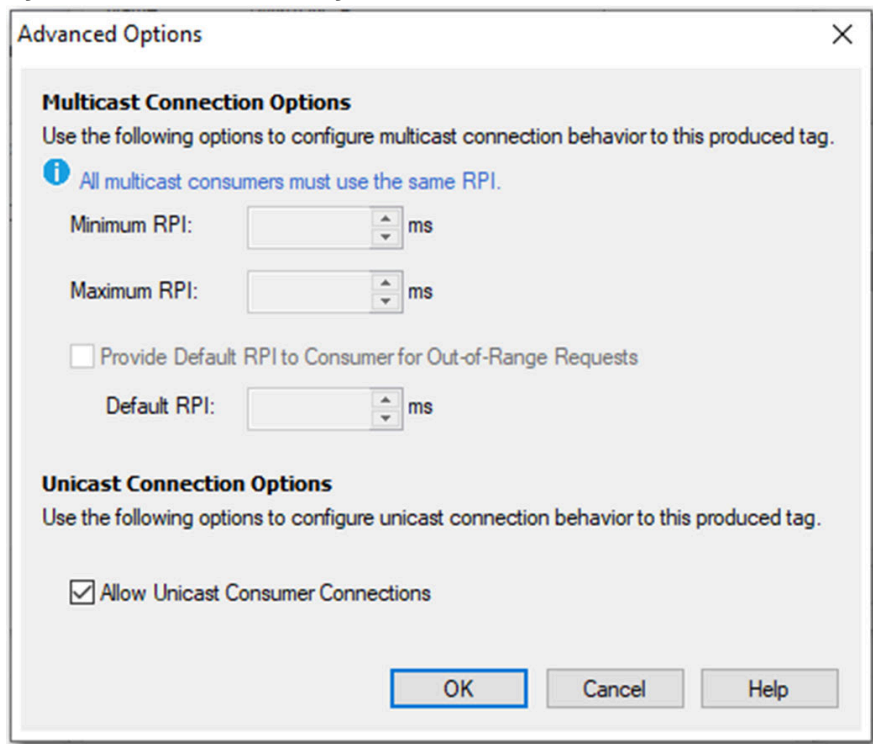

Checklists for Safety Applications

Checklists for safety applications are required to plan, program, and start a safety application. Use the checklists as planning guides and during project validation testing. When you use the checklists as planning guides, they can be saved as a record of the plan.

The checklists provide a sample of safety considerations and are not intended to be a complete list of items to verify. Your particular safety application can have additional safety requirements.



Make copies of the checklists to keep for future use.

Checklist for the Controller System

✓	System Requirements
	Are you using only the certified components for your SIL level, with the corresponding firmware release, as listed at https://rok.auto/certifications?
	Have you calculated the safety response time of the system for each safety function?
	Does the response time of the system include both the user-defined safety-task program watchdog (software watchdog) time and the safety task rate/period?
	Is the system response time in proper relation to the process safety time?
	Is the system response time in proper relation to the process safety time?
	Have you performed all appropriate project validation tests?
	If necessary, have you created a prescan routine to initialize safety critical data?
	Have you determined how your system can handle faults?
	Does each network in the safety system have a unique safety network number?
	Is each safety device configured with the correct safety network number?
	Have you generated a safety signature?
	Have you uploaded and recorded the safety signature for future comparison?
	After a download, have you verified that the safety signature in the controller matches the recorded safety signature?
	Do you have an alternate mechanism in place to preserve the safety integrity of the system when making online edits?

✓	System Requirements
	Have you considered the checklists for using SIL inputs and outputs?

Checklist for Safety Inputs

For programming or startup, an individual checklist can be completed for every safety input in the system. This method is the only way to make sure that the requirements are fully and clearly implemented. This checklist can also be used as documentation on the connection of external wiring to the application program.

✓	Input Device Requirements
	Have you followed installation instructions and precautions to conform to applicable safety standards?
	Have you performed project validation tests on the system and devices?
	Are control, diagnostics, and alarm functions performed in sequence in application logic?
	Have you uploaded and compared the configuration of each device to the configuration sent by the configuration tool?
	Are devices wired in compliance with the target standard and required safety level?
	Have you verified that the electrical specifications of the sensor and input are compatible?

Checklist for Safety Outputs

For programming or startup, an individual requirement checklist must be completed for every safety output in the system. This method is the only way to make sure that the requirements are fully and clearly implemented. This checklist can also be used as documentation on the connection of external wiring to the application program.

✓	Output Device Requirements
	Have you followed installation instructions and precautions to conform to applicable safety standards?
	Have you performed project validation tests on the system and devices?
	Have you uploaded and compared the configuration of each device to the configuration sent by the configuration tool?
	Have you verified that test outputs are not used as safety outputs?
	Are devices wired in compliance with the target standard and required safety level?

✓	Output Device Requirements
	Have you verified that the electrical specifications of the output and the actuator are compatible?

Checklist to Develop a Safety Application Program

Use the following checklist to help maintain safety when you create or modify a safety application program.

✓	System Requirements
	Are you using version 31 or later of the Studio 5000 Logix Designer® application?
	Were the programming guidelines followed during the creation of the safety application program?
	Does the safety application program contain only a ladder diagram?
	Does the safety application program contain only safety instructions?
	Does the safety application program clearly differentiate between safety and standard tags?
	Are only safety tags used for safety routines?
	Have you verified that safety routines do not attempt to read from or write to standard tags?
	Have you verified that no safety tags are aliased to standard tags and vice versa?
	Is each safety output tag correctly configured and connected to a physical output channel?
	Have you verified that all mapped tags have been conditioned in safety application logic?
	Have you defined the process parameters that the fault routines monitor?
	Have you sealed any safety Add-On Instructions with an instruction signature and recorded the safety instruction signature? Optional for one time use Add-On Instructions. Required Add-On Instructions are reused on different applications.
	Did you measure potential alarm bursts during system commissioning and change the project if measured scan times are not acceptable?
	Has an independent safety reviewer reviewed the program, if necessary?
	Has the review been documented and signed?

History of Changes

This appendix contains the new or updated information for each revision of this publication. These lists include substantive updates only and are not intended to reflect all changes. Translated versions are not always available for each revision.

Table 12. 1756-RM012I-EN-P, March 2025

Change
Added information about choosing an automatic configuration setting
Added security certification information to Commissioning Lifecycle section
Added important information to Download the Safety Application Program section
Added Restricted Access to Safety Lock/Unlock section
Revised the GuardLogix® system checklist

Table 13. 1756-RM012H-EN-P, November 2023

Change
Added catalog numbers 1756-L81ESXT, 1756-L82ESXT, 1756-L83ESXT, 1756-L84ESXT, and 1756-L8SPXT
Added security certification information to Commissioning Lifecycle section
Corrected maximum application rating for Safety Add-On Instructions
Updated temperature in the footnote of the Safety Parameters table to reflect GuardLogix-XT™ range

Table 14. 1756-RM012G-EN-P, November 2023

Change
Added new chapter about the safety signature: Chapter 2, Safety Signature
Added catalog number 1756-L85ES
Updated text and screen shot for I/O replacement options
Added new section, Safety Signatures Elements, to Chapter 6
Added Safety Signature Report to safety revalidation considerations
Added requirement to initialize safety critical AOI tag values in AOI prescan logic
Updated safety instructions throughout Appendix A
Added information about the safety signature element for AOIs

Table 15. 1756-RM012F-EN-P, November 2022

Change
Added GuardLogix-XT™ catalog numbers
Revised Compact GuardLogix® 5380 SIL 3 Controllers section in Chapter 2
Moved Use of Human Interfaces section from Chapter 5 to Chapter 2
Added SIL 2 and SIL 3 Considerations for Safety I/O Modules section to Chapter 3
Moved Differentiate Between Standard and Safety section from Chapter 5 to 1756-UM543
Added Safety Programs, Safety Routines, and Safety Tags sections to Chapter 5
Added safety mapped tags
Revised safety signature content
Revised Generate the Safety Signature section in Chapter 6
Revised Lock the Controller section in Chapter 6
Added Safety Programming Considerations chapter
Added First Scan Safety Tag Initialization section to Chapter 7
Added Develop a Fault Routine section to Chapter 8
Moved safety fault codes from Chapter 8 to 1756-RD001
Added Use GSV/SSV Instructions in a Safety Application section to Chapter 8
Added ATAN2 safety instruction
Added information about connection reaction time limit
Added checklist item for GuardLogix® system

Table 16. 1756-RM012E-EN-P, March 2022

Change
Restructured and updated the Additional Resources table
Updated GuardLogix® 5580 controllers and safety partner in chassis illustration
Added content about on-delay and off-delay functions for input signals
Added content about the safety I/O configuration signature
Added content about electronic keying implications for safety I/O device replacement
Added new section about point operation types

Table 16. 1756-RM012E-EN-P, March 2022 (continued)

Change
Added new section about safety I/O configuration variations
Added considerations for assigning safety network numbers (SNNs)
Added content about tag mapping
Added content to safety application status table
Added new section about revalidation considerations for the commissioning lifecycle
Revised content about inhibiting a device

Table 17. 1756-RM012D-EN-P, August 2020

Change
Clarified safety signature information
Added safety signature ID definition

Table 18. 1756-RM012C-EN-P, May 2020

Change
Added Compact GuardLogix® 5380 SIL 3 controllers information
Updated text in the Differentiate Between Standard and Safety section
Updated text in the SIL 2 and SIL 3 Safety Application Differences section

Rockwell Automation Support

Use these resources to access support information.

Technical Support Center	Find help with how-to videos, FAQs, chat, user forums, and product notification updates.	rok.auto/support
Local Technical Support Phone Numbers	Locate the telephone number for your country.	rok.auto/phonesupport
Technical Documentation Center	Quickly access and download technical specifications, installation instructions, and user manuals.	rok.auto/techdocs
Literature Library	Find installation instructions, manuals, brochures, and technical data publications.	rok.auto/literature
Product Compatibility and Download Center (PCDC)	Get help determining how products interact, check features and capabilities, and find associated firmware.	rok.auto/pcdc

Documentation Feedback

Your comments help us serve your documentation needs better. If you have any suggestions on how to improve our content, complete the form at rok.auto/docfeedback.

Waste Electrical and Electronic Equipment (WEEE)



At the end of life, this equipment should be collected separately from any unsorted municipal waste.





Rockwell Automation maintains current product environmental information on its website at rok.auto/pec.

Allen-Bradley, ArmorBlock, Compact 5000, CompactBlock, CompactLogix, ControlLogix, expanding human possibility, Guard I/O, GuardLogix, GuardLogix-XT, Kinetix, Logix 5000, On-Machine, POINT Guard I/O, POINT I/O, PowerFlex, Rockwell Automation, RSLogix 5000, Stratix, Studio 5000, and Studio 5000 Logix Designer are trademarks belonging to Rockwell Automation, Inc.

CIP, CIP Safety, ControlNet, DeviceNet, and EtherNet/IP are trademarks of ODVA, Inc.

Trademarks not belonging to Rockwell Automation are property of their respective companies.

Rockwell Otomasyon Ticaret A.Ş. Kar Plaza İş Merkezi E Blok Kat:6 34752 İçerenköy, İstanbul, Tel: +90 (216) 5698400 EEE Yönetmeliğine Uygundur

Connect with us.    

rockwellautomation.com — expanding **human possibility**[®]

AMERICAS: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000

EUROPE/MIDDLE EAST/AFRICA: Rockwell Automation NV, Pegasus Park, De Kleetlaan 12a, 1831 Diegem, Belgium, Tel: (32) 2663 0600

ASIA PACIFIC: Rockwell Automation SEA Pte Ltd, 2 Corporation Road, #04-05, Main Lobby, Corporation Place, Singapore 618494, Tel: (65) 6510 6608

UNITED KINGDOM: Rockwell Automation Ltd., Pitfield, Kiln Farm, Milton Keynes, MK11 3DR, United Kingdom, Tel: (44)(1908) 838-800